


KHGP

JOB NAME ______
ENGINEER _____
CONTRACTOR _____
TAG

HORIZONTAL HIGH PERFORMANCE FAN COIL UNIT, SERIES A 2 PIPE OR 4 PIPE COOLING/HEATING W/MIXING BOX

SUBMITTAL SHEET

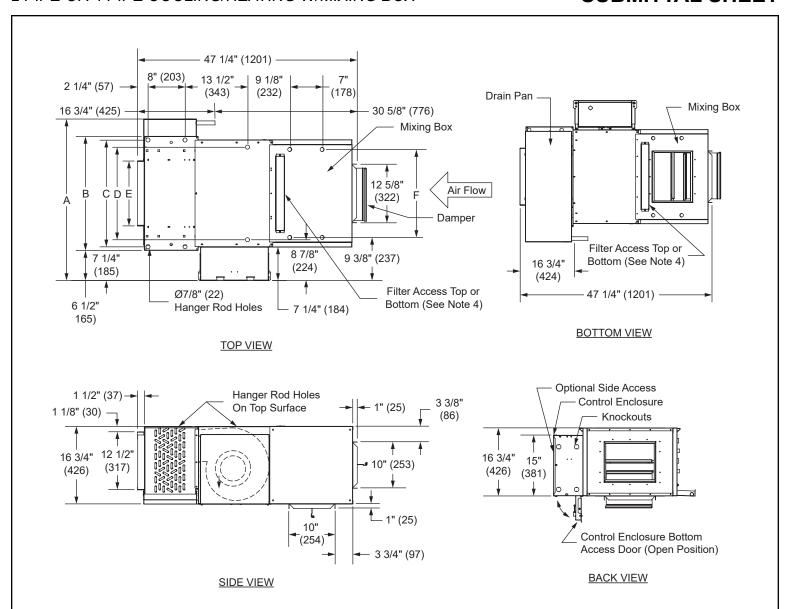

DIMENSIONS						
UNIT SIZE	Α	В	С	D	E	F
06	34-7/8" (886)	24-5/8" (721)	23-1/8" (587)	20" (508)	14" (356)	19" (483)
08	39-7/8" (1013)	29-5/8" (737)	28-1/8" (714)	25" (635)	19" (483)	24" (610)
10	43-7/8" (1114)	33-5/8" (838)	32-1/8" (816)	29" (737)	23" (584)	28" (711)
12	48-7/8" (1241)	38-5/8" (965)	37-1/8" (943)	34" (864)	28" (711)	33" (838)
14	53-7/8" (1368)	43-5/8" (1092)	42-1/8" (1070)	39" (991)	33" (838)	38" (965)
16	58-7/8" (1495)	48-5/8" (1219)	47-1/8" (1197)	44" (1118)	38" (965)	43" (1092)
18	63-7/8" (1622)	53-5/8" (1346)	52-1/8" (1324)	49" (1245)	43" (1092)	48" (1219)
20	67-7/8" (1724)	57-5/8" (1448)	56-1/8" (1426)	53" (1346)	47" (1194)	52" (1321)

NOTES:

- All dimensions in Inches (millimeters). All dimensions ±1/4" (6mm). Metric values are soft conversion.
- 2. Right hand unit shown, Left hand unit opposite.
- Standard control enclosure is mounted on unit side opposite cooling coil connections and includes (4) knockouts on (2) sides. Provide sufficient clearance to access electrical controls and comply with applicable codes and ordinances.
- 4. No Side Filter Access with Mixing Box.

Revision Date:11/1/2021 Form: FCS10-KHGP-GRWC2 Replaces: NEW SHEET 1 OF 1