
JOB NAME	
ARCHITECT	
<b>ENGINEER</b>	
CONTRACTOR	
LOCATION	

SUBMITTAL SHEET Form Number TUS0336 Effective Date 10/03 replaces New



## KQFS / KQFP

## HOT WATER COILS - 1 ROW & 2 ROW LH DISCHARGE VENT AND DRAIN

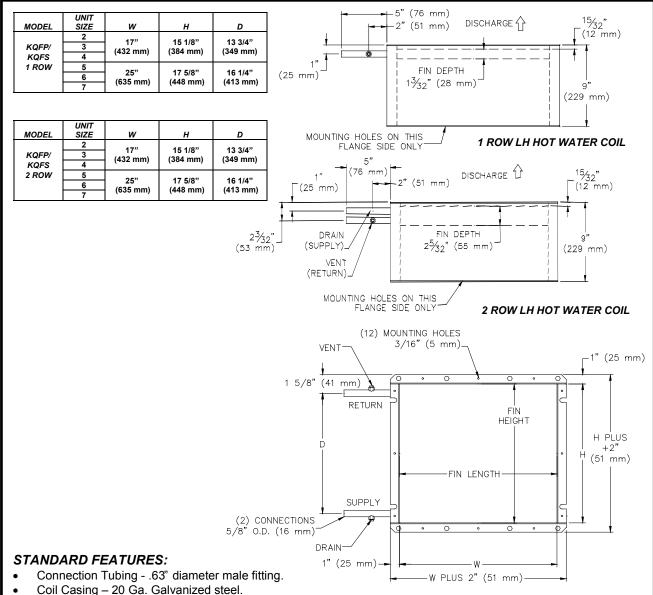

- Coil Tubing .50" diameter x .017" thick copper.
- Coil Fins .0045" thick aluminum, 10 per inch, mechanically bonded to tubing.
- Coils are leak tested to 400 psi
- Coils are not for steam applications

## NOTE:

- Dimensions are given in inches and (mm) 1)
- KQFP with induced mounted coils use RH water coil. (see TUS0335)