


KQFS-FA Unit Size 4

JOB NAME **ENGINEER** CONTRACTOR TAG

SUBMITTAL SHEET

Hot Water Heat with Electronic Controls

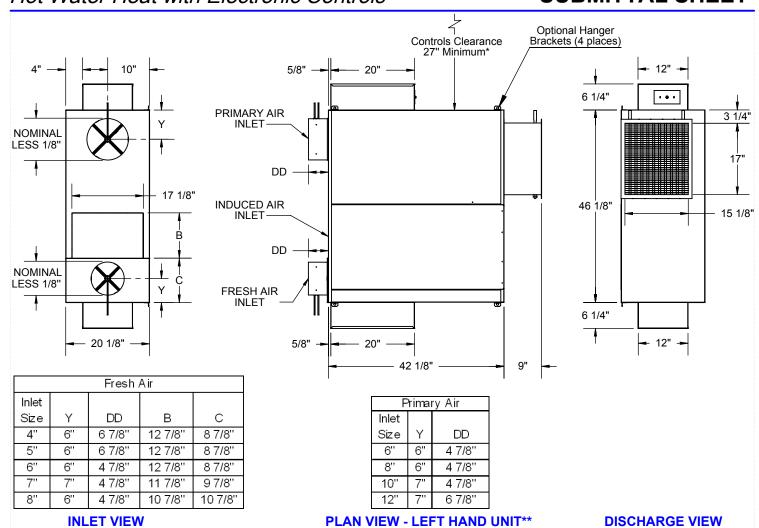

STANDARD FEATURES:

- 20GA. Galvanized Steel Construction
- Steel Control Enclosures for Electronic Components
- 1/2" Thick Dual Density Fiberglass Insulation Meeting NFPA 90A and UL181 Safety Requirements
- 1/4 HP Single Speed, Single Phase, Permanently Lubricated PSC Motor
 - □ 208/240V □ 120V
- **□** 277 V
- Field Adjustable Fan Speed Control
- Bottom Access Panel for Service
- · Integral Induced Air Attenuator
- · 4 Quadrant, Center Averaging Inlet Flow Sensor
- · Factory Supplied 24 Volt Control Transformer for Electronic Controls
- ETL Listed
- Performance Data per AHRI Standard 880
 - * Check NEC for Unit Clearance Requirements
- ** Primary Inlet Location Determines Orientation of Unit

)PI	\square	NΖ	ΔI	FF.	ΔΤΙ	JR	ES:

- Liners
 - □ 3/8" Cellular Insulation
- No Liner
- ☐ 1" Dual density Fiberglass Insulation
- □ 13/16" Steriliner Duct Board Insulation
- ☐ Solid Metal Liner with 1/2" Dual Density Fiberglass
- □ 1/2" Foil Encapsulated Fiberglass Insulation
- ☐ 1" Foil Encapsulated Fiberglass Insulation
- ☐ Perforated Metal Liner with 1/2" Dual Density Fiberglass
- Hot Water Coils
 - □1-Row Water Coil
 - ☐ L/H Coil Connection
- □ 2-Row Water Coil □ R/H Coil Connection

□ Right Hand Controls

- □ Coil Vent Drain
- ☐ Linear Averaging Inlet Sensor
- Left Hand Controls
- Motor Fusing
- Motor Toggle Disconnect Switch ■ Dust Tight Control Enclosure

- ☐ Cam Lock Access
- ☐ Construction Type Air Filter 14" x 19" x 1"
- □ Hanger brackets

(Not available with Sterilwall or Perforated Wall Liner)

Form: TUS07-400-WHDNA-0 **Replaces: NEW SUBMITTAL FORM** Revision Date: 08/10