


## **KLPS Unit Size 1**

## Cooling Only with Electronic Controls

JOB NAME **ENGINEER** CONTRACTOR TAG

## SUBMITTAL SHEET

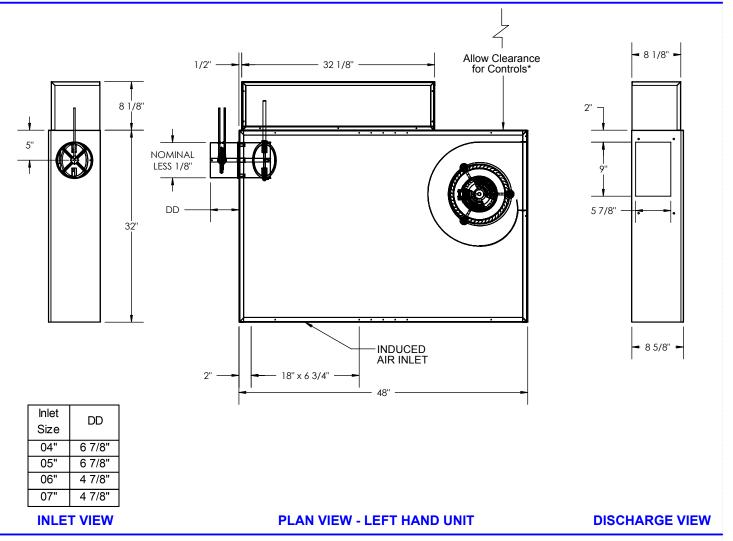

## STANDARD FEATURES:

- 20GA. Galvanized Steel Construction
- Steel Control Enclosure for Electronic Components
- 1/2" Thick Dual Density Fiberglass Insulation Meeting NFPA 90A and UL181 Safety Requirements
- 1/3 HP ECM Motor with Permanently Lubricated Ball

Bearings and Constant Airflow Program

- ☐ Manual Control ☐ 0-10Vdc Remote Control
- ☐ 2-10Vdc Remote Control
- □ 120V □ 208/240V □ 277V
- Bottom Access Panel for Service
- 4 Quadrant, Center Averaging Inlet Flow Sensor
- Factory Supplied 24 Volt Control Transformer for Electronic Controls
- ETL Listed
- Performance Data per AHRI Standard 880

0	РΤ	٦(	7	N	Α	F	F	Δ-	ГΙ	I	R	F	S

- Liners
- ☐ 1/2" Cellular Insulation
- ☐ 1/2" Foil Encapsulated Fiberglass Insulation
- □ No Liner
- ☐ Left Hand Controls ☐ Right Hand Controls
- ☐ Motor Toggle Disconnect Switch ☐ Motor Fusing
- ☐ Dust Tight Control Enclosure ☐ Hanger Brackets
- ☐ Linear Averaging Inlet Flow Sensor
- ☐ Construction Type Air Filter 18 7/8 x 7 1/2" x 1"
- ☐ Dual Access Panels for Service
- ☐ Cam-Locks (Dual Access Panel Only)

\*Check NEC for Unit Clearance Requirements

Form: TUS01-100-CODNA-4 Revision Date: 09/20 Replaces: TUS01-100-CODNA-3