


## **KLPS-D Unit 2**

JOB NAME
ENGINEER
<b>CONTRACTOR</b>
TAG

$\mathbf{c}$	IDI	N /1 I =	ΓT <i>A</i>	<b>.</b> .	$\sim$ 1		
<b>~</b> 1	IKI	VII		<b>.</b> .	-> F	11	_
	, ,			~_		-	_

## Hot Water Heat with Electronic Controls

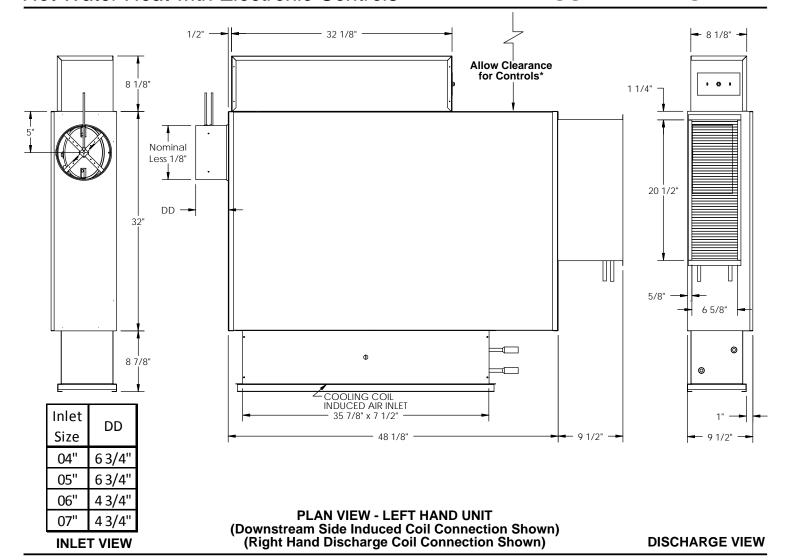

## STANDARD FEATURES:

- 20GA. Galvanized Steel Construction
- Steel Control Enclosure for Electronic Components
- 1/2" Thick Dual Density Fiberglass Insulation Meeting NFPA 90A and UL181 Safety Requirements
- 1/3 HP ECM Motor with Permanently Lubricated Ball
- Bearings and Constant Airflow Program
- ☐ Manual Control ☐ 0-10Vdc Remote Control ☐ 2-10Vdc Remote Control
- □ 120V □ 208/240V □ 277V
- Bottom Access Panel for Service
- Sensible Cooling Coil Factory Installed on Induced Air Inlet Supplied with Drip Tray \*\*
- 4 Quadrant, Center Averaging Inlet Flow Sensor
- Factory Supplied 24 Volt Control Transformer for Electronic Controls
- ETL Listed
- Performance Data per AHRI Standard 880
- Construction Type Air Filter 19" x 8 5/8" x 1" x 2

## **OPTIONAL FEATURES:**

- Liners
- □ 1/2" Cellular Insulation
- ☐ 1/2" Foil Encapsulated Fiberglass Insulation
- □ No Liner
- Cooling Coil Connection
  - ☐ Upstream Side □ Downstream Side

☐ Right Hand

☐ Motor Fusing

☐ Hanger Brackets

☐ Right Hand Controls

- **Heating Coil Connection**
- ☐ Left Hand ☐ Left Hand Controls
- ☐ Motor Toggle Disconnect Switch
- ☐ Dust Tight Control Enclosure
- ☐ Linear Averaging Inlet Flow Sensor
- ☐ Merv Type 8 Air Filter 19" x 8 5/8" x 1" x 2
- ☐ Dual Access Panels for Service
- ☐ Cam-Locks (Dual Access Panel Only)
  - \* Check NEC for Unit Clearance Requirements
  - \*\* See Submittal Form TUS-03-135-000CP

Revision Date: 09/20 Form: TUS03-200-WHDNA-2 Replaces: TUS03-200-WHDNA-1