

KLPS-D

Introduction: KLPS-D

The KLPS-D is a chilled series fan terminal unit designed to work with a dedicated outdoor air system (DOAS). The KLPS-D offers a sensible only cooling coil installed on the induced air inlet. It comes in four sizes to accommodate any zone requirement or ceiling height restriction. The size 1 unit is only 8 5/8" and size 2 is only 9 1/2" tall, both of which are designed to handle a small zone. The size 3 unit is 11" tall and will accommodate small to medium zones and the size 5 unit is 17" tall and will handle larger zones. The primary air inlet is sized to handle the fresh air zone ventilation requirements supplied from a DOAS air handler. The return air from the ceiling plenum passes through the sensible cooling coil and mixes with a fresh air provided by the primary inlet and supplies the required amount of conditioned air into the zone. The standard hot water and electric heat options are also available making the KLPS-D the ultimate single design solution for a buildings heating and cooling needs.

MODEL

KLPS-D - DOAS Construction, Chilled Series Fan Powered Terminal Unit

FEATURES

- Unit size 1: Ultra low profile at only 8 5/8" tall.
- Unit size 2: Ultra low profile at only 9 1/2" tall.
- Unit size 3: Only 11" high to accommodate installation in low height ceiling plenum spaces.
- Unit size 5: Only 17" high for extra capacity applications.
- Airflow capacities: Range up to 1550 CFM to allow airflow control for commercial applications.
- Cooling coil on the induced air inlet provides conditioned air into the space to handle the sensible cooling load.
- Heavy gage galvanized steel casing for unit strength and product durability.
- Several casing liner options provide quiet and clean operation.
- Fully removable, bottom access panel included with each unit for easy access to all internal components.
- Control enclosure located on left-hand or right-hand side for easier installation.
- Single point electrical connection minimizes number of ceiling plenum electrical connections.
- Energy efficient ECM (electronically commutated motor) fan motor.
- Manual adjustable speed controller or Building Management System compatible remote adjustable speed controller.
- Isolated motor/blower assembly limits casing acoustical transmission.
- ETL listings are under UL 1995 electrical safety.
- External filter option allows quick and easy access for routine replacement. MERV 8 filter available.
- Factory mounted digital controls may be customized for many building systems.
- Auxiliary heat offers a wide range of options, including electric and hot water heat.
- LineaHeat solid state electronic proportional control of electric heat is available with or without leaving air temperature control.
- AC solid state relays offer silent operation for staged electric heat.
- Revit models are available at www.krueger-hvac.com/revit.

KLPS-D Unit Capacities
KLPS-D UNIT CAPACITIES WITH ECM MOTOR


Unit Size	Inlet Size	KLPS-D with ECM Motor							
		Primary Airflow		Fan Airflow		Motor HP	Motor Amps		
		Max.	Min.	Max.	Min.		120V	208/240V	277V
1	4	230	40	775	105	1/3	5.0	3.3	2.6
	5	320	60						
	6	515	90						
	7	700	120						
2	4	230	40	875	135	1/3	5.0	3.3	2.6
	5	320	60						
	6	515	90						
	7	700	120						
3	4	230	40	1000	150	1/3	5.0	3.3	2.6
	5	320	60						
	6	515	90						
	7	700	120						
	8	920	160						
5	6	515	90	1625	250	1/2	7.7	5.0	4.1
	7	700	120						
	8	920	160						
	10	1430	250						

NOTES: KLPS-D maximum primary airflow (CFM) is based on 1.00" WG differential pressure signal from inlet airflow sensor until the value reaches maximum fan CFM for that unit size. A properly balanced unit will be set so the maximum primary CFM is never greater than the fan CFM. Minimum recommended airflow (CFM) is based on 0.03" WG differential pressure of the inlet airflow sensor, or 0 CFM. 0.03" WG is equal to 15%–20% of the nominal flow rating of the terminal. Less than 15%-20% may result in greater than +/-5% control of box flow. Maximum/minimum fan airflow (CFM) is based on 0.10"/0.60" WG external downstream static pressure. See page B2-109 for complete fan curves.

KLPS-D Damper Leakage
KLPS-D, DAMPER LEAKAGE DETAIL

Inlet Size	Damper Leakage		
	1.5" WG CFM	3.0" WG CFM	6.0" WG CFM
4	4	5	7
5	4	5	7
6	4	5	7
7	4	5	7
8	4	5	7
10	4	5	7

NOTES: Damper leakage is measured with the damper fully closed using an actuator. A precision low flow orifice is used upstream of the unit to measure the leakage rate as a function of the measured upstream static pressure. Leakage testing conducted in accordance with ASHRAE 130-2008.

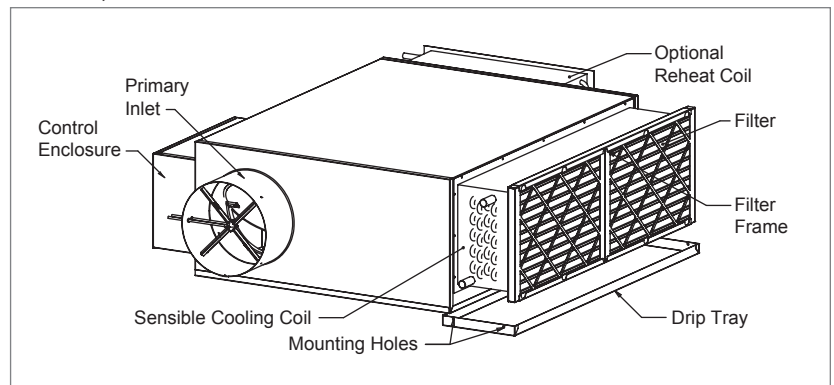KLPS-D Unit Attributes
KLPS-D, ANGLED VIEW


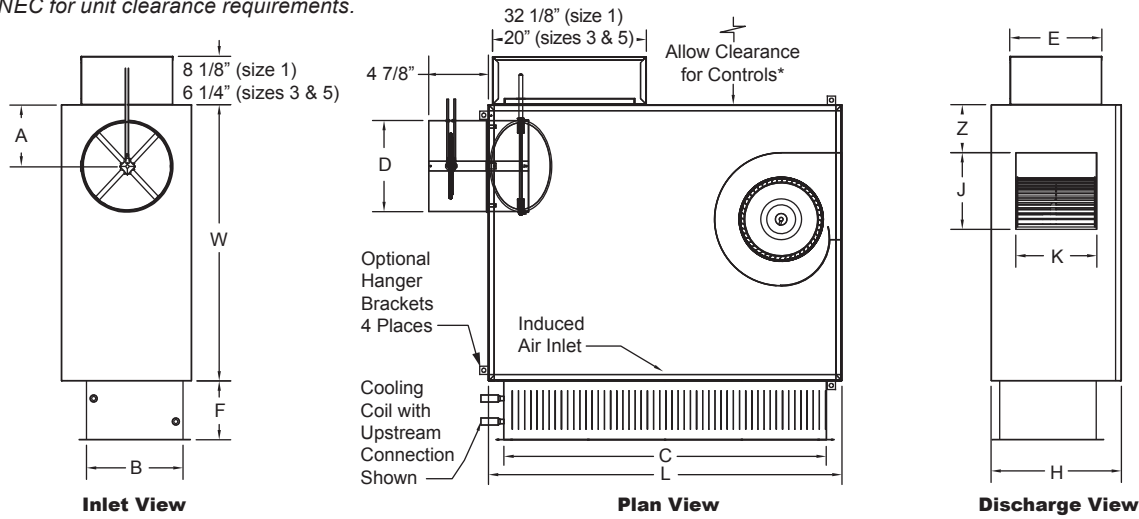
FAN POWERED TERMINAL UNITS

KLPS

KLPS-D Base Unit Dimensional Information

KLPS-D BASE UNIT, INLET, PLAN, AND DISCHARGE VIEWS

* Check NEC for unit clearance requirements.



FAN POWERED TERMINAL UNITS

KLPS-D BASE UNIT, DIMENSIONAL DETAILS

Unit Size	ECM HP	L	W	H	Cooling Coil		E	Discharge		Z	F		
					B	C		J	K		2 Row	4 Row	6 Row
1	1/3	48"	32"	8 5/8"	7 1/2"	36"	8 1/8"	10"	5 7/8"	2"	7 7/8"	7 7/8"	10"
2	1/3	48"	32"	9 1/2"	7 1/2"	36"	8 1/8"	10"	5 7/8"	2"	7 7/8"	7 7/8"	10"
3	1/3	40"	26"	11"	8 3/4"	36"	9 5/8"	9"	6 7/8"	2 1/4"	7 7/8"	7 7/8"	10"
5	1/2	46"	36"	17"	12 1/2"	42"	12"	10"	10 5/8"	6 1/4"	7 7/8"	7 7/8"	10"

Unit Size	1				2				3				5				
Inlet Size	04	05	06	07	04	05	06	07	04	05	06	07	08	06	07	08	10
A	5"	5"	5"	5"	5"	5"	5"	5"	5"	6"	5"	6"	5"	5"	6"	6"	7"
D	3 7/8"	4 7/8"	5 7/8"	6 7/8"	3 7/8"	4 7/8"	5 7/8"	6 7/8"	3 7/8"	4 7/8"	5 7/8"	6 7/8"	7 7/8"	5 7/8"	6 7/8"	7 7/8"	9 7/8"

NOTE: Left-hand base unit with electronic control enclosure shown; right-hand is available.

KLPS-D Base Unit Features & Options

STANDARD FEATURES

- 20 gage galvanized steel casing construction.
- Available in unit sizes 1, 2, 3, and 5.
- Control enclosure for electronic components.
- 1/2" thick, dual density fiberglass insulation that meets NFPA 90A and UL 181 safety requirements.
- [120, 208/240, or 277 volt, single-voltage] ECM motor.
- Manual or remote adjustable speed controller.
- Removable bottom panel allows easy access to all internal components for maintenance.
- Four quadrant, center averaging airflow sensor.
- Includes 24 volt control transformer.
- Sensible Cooling Coil factory installed on induced air inlet with drip tray.
- Construction type air filter, two per unit, unit size 1 (18 7/8"x7 1/2"x1"), unit size 2 (18 7/8"x8 3/8"x1"), unit size 3 (18 1/2"x10"x1"), unit size 5 (22"x14 1/2"x1").
- ETL listed; adherence to UL 1995 and CSA C22.2 No. 236.95

OPTIONAL FEATURES


- Liners: 1/2" or 1" Cellular insulation, 1/2" or 1" Foil encapsulated fiberglass insulation, Sterilwall, Perforated doublewall, 1" Dual density fiberglass. *NOTE: 1" thick liner options are available on unit size 5 only.*
- Linear averaging airflow sensor.
- Left-hand or right-hand control enclosure.
- Upstream or downstream cooling coil connection.
- Motor toggle disconnect switch.
- Motor fusing.
- MERV 8 air filter, two per unit, unit size 1 (18 7/8"x 7 1/2" x1"), unit size 2 (18 7/8"x8 3/8"x1"), unit size 3 (18 1/2"x10"x1"), and unit size 5 (22"x14 1/2"x1").
- Dust tight control enclosure.
- Hanger brackets.
- Dual access panels with optional Cam locks.

KLPS-D

© KRUEGER 2012

KLPS-D Unit with Hot Water Heat Dimensional Information

KLPS-D UNIT WITH HOT WATER HEAT, INLET, PLAN, AND DISCHARGE VIEWS

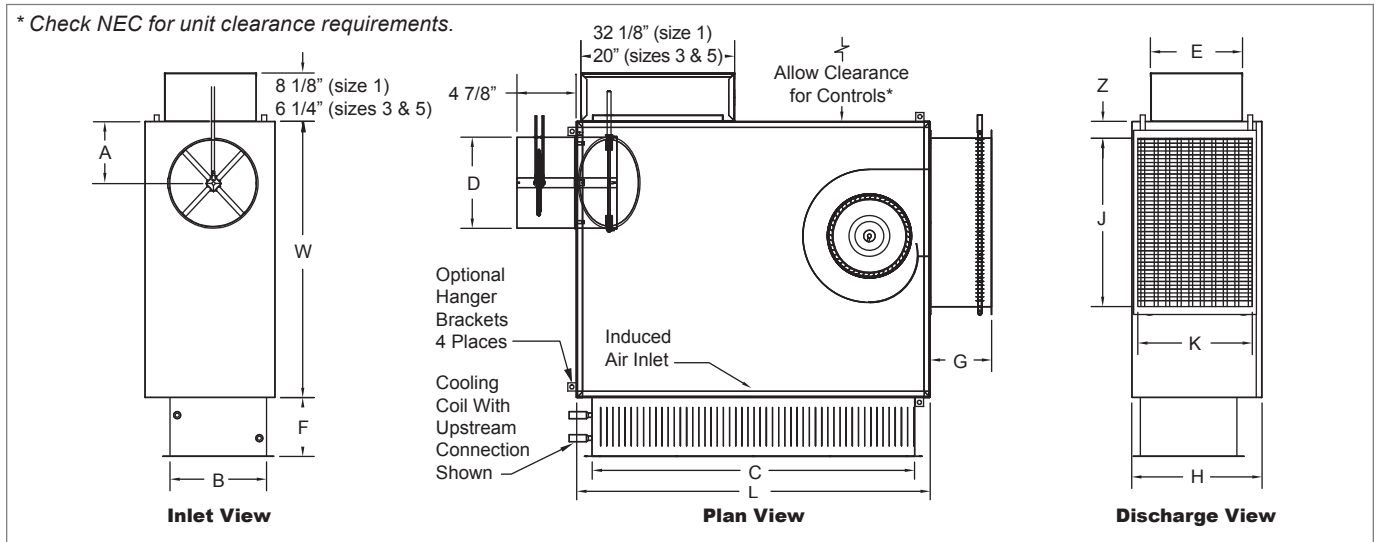

KLPS-D UNIT WITH HOT WATER HEAT, DIMENSIONAL DETAILS

Unit Size	ECM HP	L	W	H	Cooling Coil		E	Discharge		Z	F			G	
					B	C		J	K		2 Row	4 Row	6 Row	1 Row	2 Row
1	1/3	48"	32"	8 5/8"	7 1/2"	36"	8 1/8"	20 1/2"	7 5/8"	1 1/2"	7 7/8"	7 7/8"	10"	9 1/2"	9 1/2"
2	1/3	48"	32"	9 1/2"	7 1/2"	36"	8 1/8"	20 1/2"	7 5/8"	1 1/2"	7 7/8"	7 7/8"	10"	9 1/2"	9 1/2"
3	1/3	40"	26"	11"	8 3/4"	36"	9 5/8"	21 1/8"	8 3/4"	1"	7 7/8"	7 7/8"	10"	9 1/2"	9 1/2"
5	1/2	46"	36"	17"	12 1/2"	42"	12"	22"	15"	2 1/4"	7 7/8"	7 7/8"	10"	8"	9 3/16"

Unit Size	1				2				3				5				
Inlet Size	04	05	06	07	04	05	06	07	04	05	06	07	08	06	07	08	10
A	5"	5"	5"	5"	5"	5"	5"	5"	5"	6"	5"	6"	5"	5"	6"	6"	7"
D	3 7/8"	4 7/8"	5 7/8"	6 7/8"	3 7/8"	4 7/8"	5 7/8"	6 7/8"	3 7/8"	4 7/8"	5 7/8"	6 7/8"	7 7/8"	5 7/8"	6 7/8"	7 7/8"	9 7/8"

NOTE: Left-hand base unit with electronic control enclosure shown; right-hand is available.

KLPS-D Unit with Hot Water Heat Features & Options

STANDARD FEATURES

- 20 gage galvanized steel casing construction.
- Available in unit sizes 1, 2, 3, and 5.
- Control enclosure for electronic components.
- 1/2" thick, dual density fiberglass insulation that meets NFPA 90A and UL 181 safety requirements.
- [120, 208/240, or 277 volt, single-voltage] ECM motor.
- Manual or remote adjustable speed controller.
- Removable bottom panel allows easy access to all internal components for maintenance.
- Four quadrant, center averaging airflow sensor.
- Flanged discharge connection on hot water coil.
- Includes 24 volt control transformer.
- Sensible Cooling Coil factory installed on induced air inlet with drip tray.
- Construction type air filter, two per unit, unit size 1 (18 7/8"x7 1/2"x1"), unit size 2 (18 7/8"x8 3/8"x1"), unit size 3 (18 1/2"x10"x1"), unit size 5 (22"x14 1/2"x1").
- ETL listed; adherence to UL 1995 and CSA C22.2 No. 236.95.


OPTIONAL FEATURES

- Liners: 1/2" or 1" Cellular insulation, 1/2" or 1" Foil encapsulated fiberglass insulation, Sterilwall, Perforated doublewall, 1" Dual density fiberglass. NOTE: 1" thick liner options are available on unit size 5 only.
- Linear averaging airflow sensor.
- Left-hand or right-hand control enclosure.
- Left-hand or right-hand hot water coil connection.
- Upstream or downstream cooling coil connection.
- Motor toggle disconnect switch.
- Motor fusing.
- MERV 8 air filter, two per unit, unit size 1 (18 7/8"x7 1/2"x1"), unit size 2 (18 7/8"x8 3/8"x1"), unit size 3 (18 1/2"x10"x1"), and unit size 5 (22"x14 1/2"x1").
- Dust tight control enclosure.
- Hanger brackets.
- Dual access panels with optional Cam locks.

KLPS-D Unit with Electric Heat Dimensional Information

KLPS-D UNIT WITH ELECTRIC HEAT, INLET, PLAN, AND DISCHARGE VIEWS

* Check NEC for unit clearance requirements.

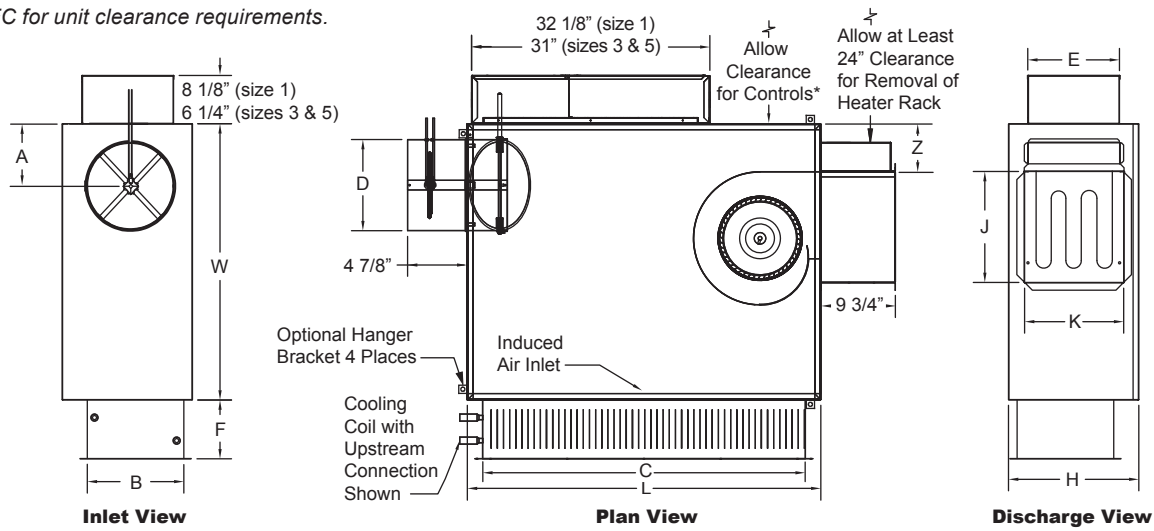

KLPS-D UNIT WITH ELECTRIC HEAT, DIMENSIONAL DETAILS

Unit Size	ECM HP	L	W	H	Cooling Coil		E	Discharge		Z	F		
					B	C		J	K		2 Row	4 Row	6 Row
1	1/3	48"	32"	8 5/8"	7 1/2"	36"	8 1/8"	10 1/2"	7 3/4"	1 1/8"	7 7/8"	7 7/8"	10"
2	1/3	48"	32"	9 1/2"	7 1/2"	36"	8 1/8"	10 1/2"	7 3/4"	1 1/8"	7 7/8"	7 7/8"	10"
3	1/3	40"	26"	11"	8 3/4"	36"	9 5/8"	10 1/2"	8 3/8"	1 1/8"	7 7/8"	7 7/8"	10"
5	1/2	46"	36"	17"	12 1/2"	42"	12"	14 1/2"	12 7/8"	6 1/4"	7 7/8"	7 7/8"	10"

Unit Size	1				2				3				5				
Inlet Size	04	05	06	07	04	05	06	07	04	05	06	07	08	06	07	08	10
A	5"	5"	5"	5"	5"	5"	5"	5"	5"	6"	5"	6"	5"	5"	6"	6"	7"
D	3 7/8"	4 7/8"	5 7/8"	6 7/8"	3 7/8"	4 7/8"	5 7/8"	6 7/8"	3 7/8"	4 7/8"	5 7/8"	6 7/8"	7 7/8"	5 7/8"	6 7/8"	7 7/8"	9 7/8"

NOTES: Left-hand base unit with electronic control enclosure shown; right-hand is available. See page B2-97 for electric heat standard features.

KLPS-D Unit with Electric Heat Features & Options

STANDARD FEATURES

- 20 gage galvanized steel casing construction.
- Available in unit sizes 1, 2, 3, and 5.
- Control enclosure for electronic components.
- 1/2" thick, dual density fiberglass insulation that meets NFPA 90A and UL 181 safety requirements.
- [120, 208/240, or 277 volt, single-voltage] ECM motor.
- Manual or remote adjustable speed controller.
- Removable bottom panel allows easy access to all internal components for maintenance.
- Four quadrant, center averaging airflow sensor.
- Flanged discharge connection on electric heat coil.
- Single point electrical connection.
- Includes 24 volt control transformer.
- Sensible Cooling Coil factory installed on induced air inlet with drip tray.
- Construction type air filter, two per unit, unit size 1 (18 7/8"x7 1/2"x1"), unit size 2 (18 7/8"x8 3/8"x1"), unit size 3 (18 1/2"x10"x1"), unit size 5 (22"x14 1/2"x1").
- ETL listed; adherence to UL 1995 and CSA C22.2 No. 236.95.


OPTIONAL FEATURES

- LineaHeat solid state electronic controlled heater with or without leaving air temperature control.
- Liners: 1/2" or 1" Cellular insulation, 1/2" or 1" Foil encapsulated fiberglass insulation, Sterilwall, Perforated doublewall, 1" Dual density fiberglass. *NOTE: 1" thick liner options are available on unit size 5 only.*
- Linear averaging airflow sensor.
- Left-hand or right-hand control enclosure.
- Upstream or downstream cooling coil connection
- MERV 8 air filter, two per unit, unit size 1 (18 7/8"x7 1/2"x1"), unit size 2 (18 7/8"x8 3/8"x1"), unit size 3 (18 1/2"x10"x1"), and unit size 5 (22"x14 1/2"x1").
- Fused or non-fused door interlocking disconnect.
- Dust tight control enclosure.
- Hanger brackets.
- Motor fusing.
- AC Solid State Relays.
- Manual reset cutout.
- Fuse-block.
- Dual access panels with optional Cam locks.

FAN POWERED TERMINAL UNITS

KLPS

© KRUEGER 2012

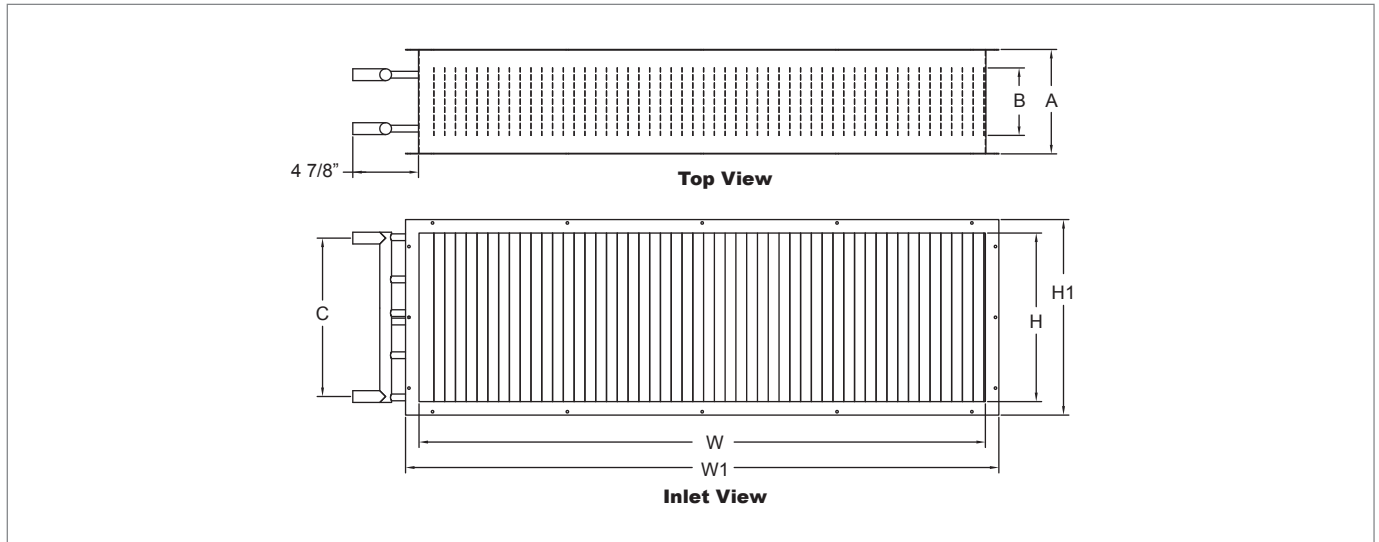KLPS-D Cooling Water Coil Dimensional Information
KLPS-D COOLING WATER COIL, PLAN AND FRONT VIEWS

KLPS-D COOLING WATER COIL, DIMENSIONAL DETAILS

Unit Size	Number of Rows	W	H	W1	H1	A	B	C
1	2	36"	$7\frac{1}{2}$ "	38"	$7\frac{5}{8}$ "	$7\frac{7}{8}$ "	$2\frac{1}{8}$ "	$6\frac{3}{4}$ "
	4					$7\frac{7}{8}$ "	$4\frac{3}{8}$ "	
	6					10"	$6\frac{1}{2}$ "	
2	2	36"	$7\frac{1}{2}$ "	38"	$8\frac{1}{2}$ "	$7\frac{7}{8}$ "	$2\frac{1}{8}$ "	$6\frac{3}{4}$ "
	4					$7\frac{7}{8}$ "	$4\frac{3}{8}$ "	
	6					10"	$6\frac{1}{2}$ "	
3	2	36"	$8\frac{3}{4}$ "	38"	$10\frac{1}{4}$ "	$7\frac{7}{8}$ "	$2\frac{1}{8}$ "	8"
	4					$7\frac{7}{8}$ "	$4\frac{3}{8}$ "	
	6					10"	$6\frac{1}{2}$ "	
5	2	42"	$12\frac{1}{2}$ "	44"	$14\frac{1}{2}$ "	$7\frac{7}{8}$ "	$2\frac{1}{8}$ "	$11\frac{3}{4}$ "
	4					$7\frac{7}{8}$ "	$4\frac{3}{8}$ "	
	6					10"	$6\frac{1}{2}$ "	

KLPS-D Cooling Water Coil Features
STANDARD FEATURES

- Cooling coils are shipped from the factory attached to the induction inlet.
- Drip tray ships loose from the factory to be attached to the water coil in the field.
- Filter rack is shipped from the factory attached to the water coil.
- Connection Tubing: $\frac{7}{8}$ " O. D. male solder.
- Coil Casing: 18 gage galvanized steel.
- Coil Tubing: $\frac{1}{2}$ " O. D. x 0.016" thick copper.
- Coil Fins: 0.0045" thick aluminum, 10 per inch; mechanically bonded to tubing.

NOTES: Entering water temperature must be above dew point to prevent condensation on coil.
 Typical design entering water temperature for cooling coil ranges from 55°F to 60°F .

KLPS-D Cooling Water Coil Performance Data

KLPS-D COOLING WATER COIL PERFORMANCE DATA

FAN POWERED TERMINAL UNITS

Unit Size	Rows	GPM	Head Loss	Cooling Coil Airflow, CFM & Resulting Sensible MBH								
				150	225	300	375	450	525	600	675	750
1 & 2	2	1.0	0.15	-1.8	-2.3	-2.7	-3.0	-3.2	-3.4	-3.6	-3.7	-3.8
		2.0	0.50	-2.0	-2.7	-3.2	-3.6	-4.0	-4.3	-4.6	-4.8	-5.0
		4.0	1.02	-2.1	-2.8	-3.4	-3.9	-4.3	-4.7	-5.1	-5.4	-5.6
		6.0	1.69	-2.1	-2.9	-3.5	-4.1	-4.5	-5.0	-5.3	-5.7	-6.0
		Air Pressure Drop		0.01	0.01	0.02	0.04	0.05	0.06	0.08	0.10	0.12
	4	1.0	0.29	-2.5	-3.4	-4.0	-4.5	-4.9	-5.2	-5.4	-5.6	-5.8
		2.0	0.99	-2.6	-3.7	-4.6	-5.4	-6.0	-6.6	-7.1	-7.5	-7.9
		4.0	3.39	-2.7	-3.9	-4.9	-5.9	-6.7	-7.5	-8.2	-8.8	-9.4
		6.0	6.95	-2.7	-3.9	-5.0	-6.0	-7.0	-7.8	-8.6	-9.4	-10.0
		Air Pressure Drop		0.01	0.03	0.05	0.07	0.09	0.12	0.16	0.19	0.23
	6	1.0	0.44	-2.7	-3.8	-4.6	-5.2	-5.7	-6.1	-6.4	-6.6	-6.8
		2.0	1.49	-2.8	-4.0	-5.2	-6.1	-7.0	-7.7	-8.4	-8.9	-9.4
4.0		5.08	-2.8	-4.1	-5.4	-6.5	-7.6	-8.6	-9.5	-10.4	-11.2	
6.0		10.42	-2.8	-4.2	-5.4	-6.7	-7.8	-8.9	-9.9	-10.9	-11.8	
Air Pressure Drop		0.02	0.04	0.07	0.10	0.14	0.18	0.23	0.29	0.35		

Unit Size	Rows	GPM	Head Loss	Cooling Coil Airflow, CFM & Resulting Sensible MBH								
				300	375	450	525	600	675	750	825	900
3	2	1.0	0.18	-2.9	-3.2	-3.4	-3.6	-3.8	-4.0	-4.1	-4.2	-4.3
		2.0	0.60	-3.4	-3.8	-4.2	-4.6	-4.9	-5.2	-5.4	-5.6	-5.8
		4.0	1.23	-3.6	-4.1	-4.6	-5.0	-5.4	-5.7	-6.0	-6.3	-6.6
		6.0	2.05	-3.7	-4.3	-4.8	-5.3	-5.7	-6.1	-6.4	-6.7	-7.0
		Air Pressure Drop		0.02	0.03	0.04	0.05	0.06	0.08	0.09	0.11	0.13
	4	1.0	0.34	-4.1	-4.6	-5.0	-5.3	-5.6	-5.8	-6.0	-6.1	-6.3
		2.0	1.18	-4.7	-5.5	-6.2	-6.8	-7.3	-7.7	-8.1	-8.5	-8.8
		4.0	4.02	-5.0	-5.9	-6.8	-7.6	-8.4	-9.0	-9.7	-10.2	-10.8
		6.0	8.25	-5.0	-6.1	-7.0	-7.9	-8.8	-9.5	-10.3	-10.9	-11.6
		Air Pressure Drop		0.03	0.05	0.07	0.09	0.12	0.15	0.18	0.21	0.25
	6	1.0	0.51	-4.6	-5.3	-5.8	-6.2	-6.5	-6.7	-6.9	-7.0	-7.2
		2.0	1.76	-5.2	-6.2	-7.1	-7.8	-8.5	-9.1	-9.6	-10.1	-10.5
4.0		6.00	-5.3	-6.5	-7.6	-8.7	-9.6	-10.5	-11.3	-12.1	-12.8	
6.0		12.30	-5.4	-6.6	-7.8	-8.9	-10.0	-11.0	-11.9	-12.8	-13.6	
Air Pressure Drop		0.05	0.08	0.11	0.14	0.18	0.22	0.26	0.31	0.36		

Unit Size	Rows	GPM	Head Loss	Cooling Coil Airflow, CFM & Resulting Sensible MBH								
				450	550	650	750	850	950	1050	1150	1250
5	2	1.0	0.3	-4.3	-4.7	-5.0	-5.2	-5.4	-5.4	-5.6	-5.7	-5.8
		2.0	0.9	-5.3	-5.9	-6.4	-6.9	-7.3	-7.4	-7.7	-8.0	-8.2
		3.0	1.9	-5.6	-6.4	-7.1	-7.6	-8.2	-8.3	-8.8	-9.1	-9.5
		4.0	3.2	-5.8	-6.7	-7.4	-8.1	-8.7	-8.9	-9.4	-9.8	-10.2
		Air Pressure Drop		0.01	0.02	0.03	0.04	0.05	0.06	0.07	0.08	0.09
	4	1.0	0.5	-5.9	-6.4	-6.8	-7.1	-7.3	-7.5	-7.6	-7.7	-7.8
		2.0	1.8	-7.1	-8.1	-8.9	-9.6	-10.2	-10.8	-11.2	-11.6	-12.0
		3.0	3.6	-7.4	-8.6	-9.7	-10.6	-11.5	-12.3	-12.9	-13.5	-14.1
		4.0	6.0	-7.6	-8.9	-10.1	-11.2	-12.2	-13.1	-13.9	-14.7	-15.4
		Air Pressure Drop		0.03	0.04	0.06	0.07	0.09	0.11	0.13	0.15	0.18
	6	1.0	0.4	-6.3	-6.9	-7.3	-7.5	-7.7	-7.9	-8.0	-8.1	-8.2
		2.0	1.5	-7.7	-8.9	-9.9	-10.7	-11.4	-12.0	-12.5	-13.0	-13.3
4.0		5.1	-8.1	-9.7	-11.1	-12.5	-13.7	-14.8	-15.8	-16.7	-17.6	
6.0		10.5	-8.2	-9.9	-11.5	-13.0	-14.4	-15.7	-16.9	-18.1	-19.2	
Air Pressure Drop		0.04	0.06	0.08	0.11	0.13	0.16	0.19	0.23	0.26		

NOTES: All data is based on 75°F entering air, 57°F entering water, at an altitude of 0 ft. Program calculations assume 0% glycol. Water temperature of must be above dew point throughout the building to prevent condensation on coil. Typical entering water temperature for cooling coil ranges from 55°F to 62°F.


The MBH values listed above is the sensible MBH for the CFM that is induced through the cooling coil. The latent MBH is provided by the primary air and is added to the sensible MBH to create the Total Cooling MBH.

KLPS


© KRUEGER 2012

KLPS-D ECM Fan Curves


KLPS-D, ECM FAN CURVE, UNIT SIZE 1

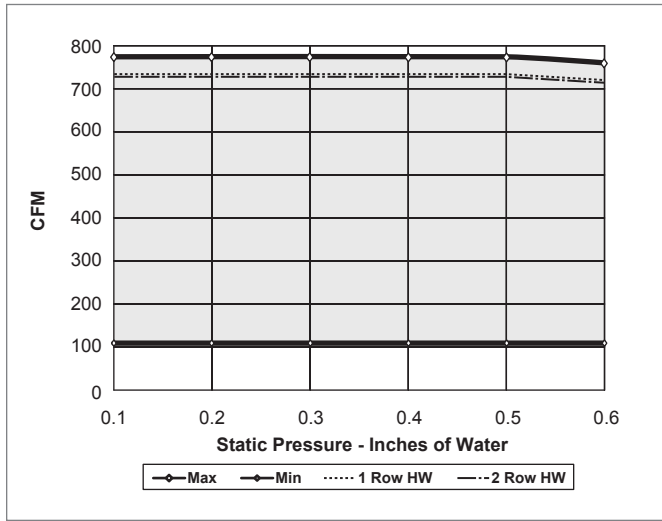


KLPS-D, ECM FAN CURVE, UNIT SIZE 2

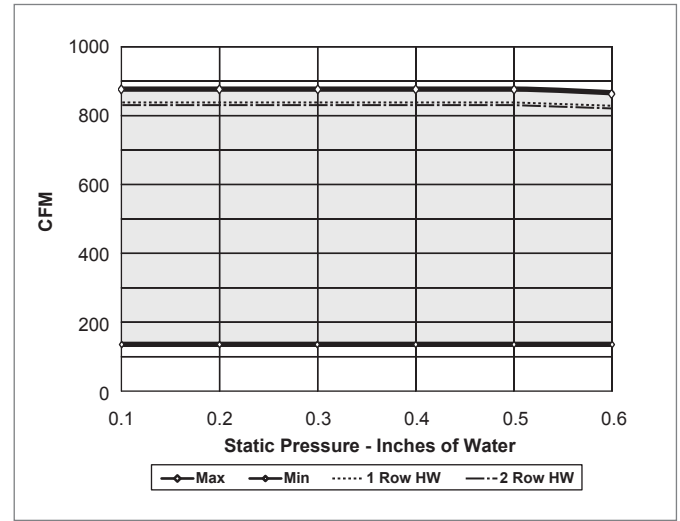

KLPS-D, ECM FAN CURVE, UNIT SIZE 3

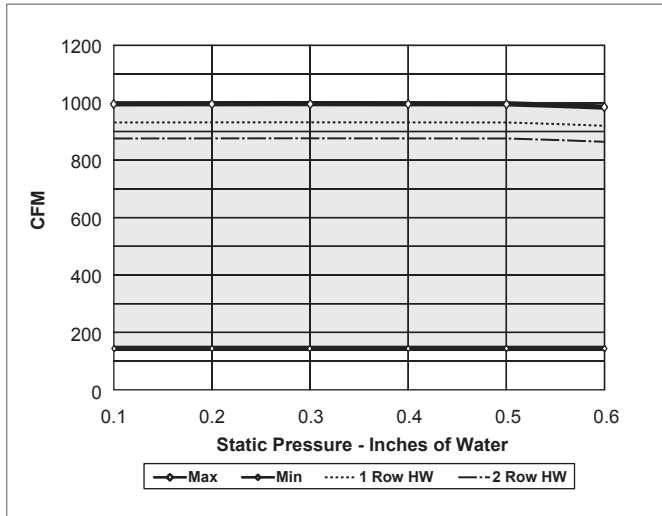

KLPS-D, ECM FAN CURVE, UNIT SIZE 5

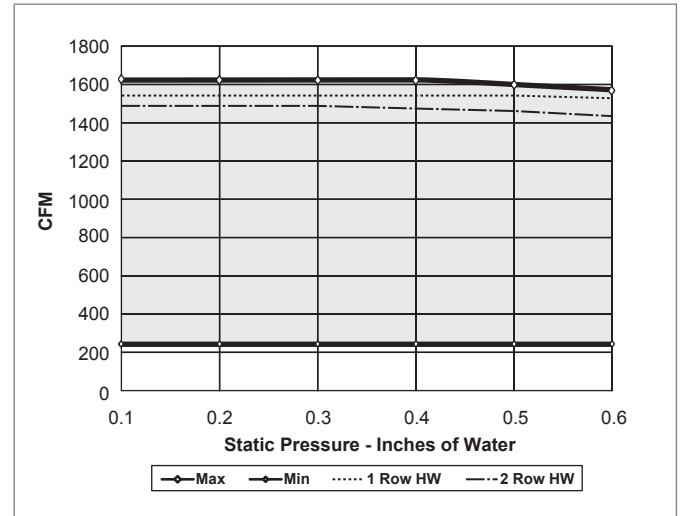

NOTES: Manual or remote adjustable speed controller is standard with each unit. Fan curves indicate the maximum and minimum achievable airflows. See Product Description section, page B2-88 for definitions of manual and remote adjustable speed controllers. Units must be selected to operate within the airflow and external static pressure ranges shown.

Fan curves are based on a 6 row cooling coil installed on the induced air inlet.

FAN POWERED TERMINAL UNITS

KLPS

KLPS-D | Chilled Series Flow

KLPS-D Discharge Sound Performance Data

KLPS-D, DISCHARGE SOUND DATA

FAN POWERED TERMINAL UNITS

Unit Size	Inlet Size	Primary Flow Rate		Fan Flow Rate		Min. Δ Ps		Fan Only							Fan + Primary @ 0.75" Δ Ps							Fan + Primary @ 1.5" Δ Ps									
								Octave Band Sound Power, Lw							Lp	Octave Band Sound Power, Lw							Lp	Octave Band Sound Power, Lw							Lp
								CFM	(L/s)	CFM	(L/s)	"WG	(Pa)	2	3	4	5	6	7	NC	2	3	4	5	6	7	NC	2	3	4	5
1	4	40	(19)	200	(94)	0.003	(0.74)	58	52	52	47	42	35	-	58	52	52	47	42	35	-	58	52	52	47	42	35	-			
		75	(35)	325	(153)	0.010	(2.60)	64	60	59	56	53	48	-	64	60	59	56	53	48	-	64	60	59	56	53	48	-			
		125	(59)	450	(212)	0.029	(7.21)	69	66	65	63	60	57	24	69	66	65	63	60	57	26	69	66	65	63	60	57	26			
		175	(83)	575	(271)	0.057	(14.14)	72	70	69	67	65	64	29	72	70	69	67	65	64	30	72	70	69	67	65	64	30			
		232	(109)	675	(319)	0.100	(24.85)	75	73	71	70	69	68	33	75	73	71	70	69	68	33	75	73	71	70	69	68	33			
1	5	63	(30)	200	(94)	0.003	(0.75)	58	52	52	47	42	35	-	58	52	52	47	42	35	-	58	52	52	47	42	35	-			
		150	(71)	325	(153)	0.017	(4.24)	64	60	59	56	53	48	-	64	60	59	56	53	48	-	64	60	59	56	53	48	-			
		225	(106)	450	(212)	0.038	(9.55)	69	66	65	63	60	57	24	69	66	65	63	60	57	26	69	66	65	63	60	57	26			
		300	(142)	575	(271)	0.068	(16.97)	72	70	69	67	65	64	29	72	70	69	67	65	64	29	72	70	69	67	65	64	29			
		363	(171)	675	(319)	0.100	(24.85)	75	73	71	70	69	68	33	75	73	71	70	69	68	33	75	73	71	70	69	68	33			
1	6	150	(71)	200	(94)	0.011	(2.76)	58	52	52	47	42	35	-	60	54	54	49	42	35	-	60	55	55	49	44	37	-			
		225	(106)	325	(153)	0.025	(6.21)	64	60	59	56	53	48	-	66	60	61	56	53	48	22	67	62	62	58	54	48	23			
		300	(142)	450	(212)	0.044	(11.04)	69	66	65	63	60	57	24	69	66	65	63	60	57	24	71	68	67	64	60	57	27			
		375	(177)	575	(271)	0.069	(17.25)	72	70	69	67	65	64	29	72	70	69	67	65	64	29	74	72	71	69	65	64	32			
		450	(212)	675	(319)	0.100	(24.85)	75	73	71	70	69	68	33	75	73	71	70	69	68	33	77	75	74	72	69	68	35			
3	6	150	(71)	300	(142)	0.011	(2.76)	61	55	55	53	46	42	-	61	55	55	53	46	42	-	61	55	55	53	46	42	-			
		225	(106)	450	(212)	0.025	(6.21)	66	60	59	58	53	49	-	66	60	59	58	53	49	-	66	60	59	58	53	49	-			
		300	(142)	600	(283)	0.044	(11.04)	70	64	63	62	58	55	24	70	64	63	62	58	55	24	70	64	63	62	58	55	24			
		375	(177)	750	(354)	0.069	(17.25)	73	67	65	65	62	59	25	73	67	65	65	62	59	25	73	67	65	65	62	59	25			
		450	(212)	900	(425)	0.100	(24.85)	76	69	67	67	65	62	28	76	69	67	67	65	62	28	76	69	67	67	65	62	28			
3	8	180	(85)	300	(142)	0.011	(2.76)	61	55	55	53	46	42	-	61	55	55	53	46	42	-	61	55	55	53	46	42	-			
		270	(127)	450	(212)	0.025	(6.21)	66	60	59	58	53	49	-	66	60	59	58	53	49	-	66	60	59	58	53	49	-			
		360	(170)	600	(283)	0.044	(11.04)	70	64	63	62	58	55	24	70	64	63	62	58	55	24	70	64	63	62	58	55	24			
		450	(212)	750	(354)	0.069	(17.25)	73	67	65	65	62	59	25	73	67	65	65	62	59	25	73	67	65	65	62	59	25			
		540	(255)	900	(425)	0.100	(24.85)	76	69	67	67	65	62	28	76	69	67	67	65	62	28	76	69	67	67	65	62	28			
5	6	100	(47)	500	(236)	0.004	(0.99)	62	57	53	54	48	40	-	62	57	53	54	48	40	-	62	57	53	54	48	40	-			
		200	(94)	700	(330)	0.016	(3.98)	67	61	58	59	54	48	-	67	61	58	59	54	48	-	67	61	58	59	54	48	-			
		300	(142)	1000	(472)	0.036	(8.94)	71	66	64	65	60	56	23	71	66	64	65	60	56	23	71	66	64	65	60	56	23			
		400	(189)	1300	(614)	0.064	(15.90)	75	70	68	69	65	62	27	75	70	68	69	65	62	27	75	70	68	69	65	62	27			
		500	(236)	1500	(708)	0.100	(24.85)	77	72	70	71	68	66	30	77	72	70	71	68	66	30	77	72	70	71	68	66	30			
5	8	300	(142)	500	(236)	0.011	(2.76)	62	57	53	54	48	40	-	62	57	53	54	48	40	-	62	58	53	54	48	40	-			
		420	(198)	700	(330)	0.022	(5.41)	67	61	58	59	54	48	-	67	61	58	59	54	48	-	67	61	58	59	54	48	-			
		600	(283)	1000	(472)	0.044	(11.04)	71	66	64	65	60	56	23	71	66	64	65	60	56	23	71	66	64	65	60	56	23			
		780	(368)	1300	(614)	0.075	(18.66)	75	70	68	69	65	62	27	75	70	68	69	65	62	27	75	70	68	69	65	62	27			
		900	(425)	1500	(708)	0.100	(24.85)	77	72	70	71	68	66	30	77	72	70	71	68	66	30	77	72	70	71	68	66	30			
5	10	350	(165)	500	(236)	0.011	(2.76)	62	57	53	54	48	40	-	62	57	53	54	48	40	-	62	58	53	54	48	40	-			
		490	(231)	700	(330)	0.022	(5.41)	67	61	58	59	54	48	-	67	61	58	59	54	48	-	67	61	58	59	54	48	-			
		700	(330)	1000	(472)	0.044	(11.04)	71	66	64	65	60	56	23	71	66	64	65	60	56	23	71	66	64	65	60	56	23			
		910	(429)	1300	(614)	0.075	(18.66)	75	70	68	69	65	62	27	75	70	68	69	65	62	27	75	70	68	69	65	62	27			
		1050	(496)	1500	(708)	0.100	(24.85)	77	72	70	71	68	66	30	77	72	70	71	68	66	30	77	72	70	71	68	66	30			

NOTES: Discharge sound power is the sound emitted from the unit discharge. All sound data is based on tests conducted in accordance with AHRI 880-11 and corrected for end reflection. ΔPs is the difference in static pressure from inlet to discharge. Sound power levels are in dB, re 10⁻¹² Watts. NC application data is from AHRI Standard 885-08 Appendix E, as a function of flow rate shown. Dash indicates a NC is less than 20. See Krueger's selection software for specific sound data for optional liners; 1/2" dual density shown. See Krueger's Terminal Unit Engineering section for reductions and definitions.

KLPS-D Radiated Sound Performance Data

KLPS-D, RADIATED SOUND DATA

Unit Size	Inlet Size	Primary Flow Rate		Fan Flow Rate		Min. Δ Ps		Fan Only							Fan + Primary @ 0.75" Δ Ps							Fan + Primary @ 1.5" Δ Ps						
								Octave Band Sound Power, Lw							Lp	Octave Band Sound Power, Lw							Lp	Octave Band Sound Power, Lw				
		CFM	(L/s)	CFM	(L/s)	"WG	(Pa)	2	3	4	5	6	7	NC		2	3	4	5	6	7	NC		2	3	4	5	6
1	4	40	(19)	200	(94)	0.003	(0.74)	47	44	44	40	31	23	18	47	44	44	40	31	23	18	47	44	44	40	31	23	18
		75	(35)	325	(153)	0.010	(2.60)	55	52	51	47	39	32	25	55	52	51	47	39	32	25	55	52	51	47	39	32	25
		125	(59)	450	(212)	0.029	(7.21)	60	57	55	51	45	37	30	60	57	55	51	45	37	30	60	57	55	51	45	37	30
		175	(83)	575	(271)	0.057	(14.14)	64	61	58	55	49	42	33	64	61	58	55	49	42	33	64	61	58	55	49	42	33
1	5	232	(109)	675	(319)	0.100	(24.85)	66	63	60	57	51	45	35	66	63	60	57	51	45	35	66	63	60	57	51	45	35
		63	(30)	200	(94)	0.003	(0.75)	47	44	44	40	31	23	18	47	44	44	40	31	23	18	47	44	44	40	31	23	18
		150	(71)	325	(153)	0.017	(4.24)	55	52	51	47	39	32	25	55	52	51	47	39	32	25	55	52	51	47	39	32	25
		225	(106)	450	(212)	0.038	(9.55)	60	57	55	51	45	37	30	60	57	55	51	45	37	30	62	60	57	51	45	37	32
1	6	300	(142)	575	(271)	0.068	(16.97)	64	61	58	55	49	42	33	64	63	60	55	49	42	35	66	64	61	57	49	42	36
		363	(171)	675	(319)	0.100	(24.85)	66	63	60	57	51	45	35	66	66	63	57	51	45	38	69	68	64	60	53	47	39
		150	(71)	200	(94)	0.011	(2.76)	47	44	44	40	31	23	18	49	47	46	40	31	23	20	50	49	47	40	31	25	21
		225	(106)	325	(153)	0.025	(6.21)	55	52	51	47	39	32	25	56	55	53	47	39	32	27	58	56	54	49	39	34	29
3	6	300	(142)	450	(212)	0.044	(11.04)	60	57	55	51	45	37	30	62	60	57	51	45	37	32	63	62	59	54	47	40	34
		375	(177)	575	(271)	0.069	(17.25)	64	61	58	55	49	42	33	66	64	61	55	49	42	36	67	66	62	58	51	44	37
		450	(212)	675	(319)	0.100	(24.85)	66	63	60	57	51	45	35	68	67	63	59	51	45	39	70	69	65	61	54	47	40
		150	(71)	300	(142)	0.011	(2.76)	61	56	57	57	50	40	31	61	56	57	57	50	40	31	61	56	57	57	50	40	31
3	8	225	(106)	450	(212)	0.025	(6.21)	62	57	57	58	51	41	32	62	57	57	58	51	41	32	62	57	57	58	51	41	32
		300	(142)	600	(283)	0.044	(11.04)	62	57	58	58	52	42	33	64	59	60	60	52	43	35	65	60	60	60	52	44	35
		375	(177)	750	(354)	0.069	(17.25)	63	58	58	59	53	42	33	66	61	61	61	55	45	36	66	61	61	61	55	45	36
		450	(212)	900	(425)	0.100	(24.85)	63	58	59	59	53	42	34	67	62	62	62	56	46	37	67	62	62	62	57	47	37
5	6	180	(85)	300	(142)	0.011	(2.76)	61	56	57	57	50	40	31	61	56	57	57	50	40	31	61	56	57	57	50	40	31
		270	(127)	450	(212)	0.025	(6.21)	62	57	57	58	51	41	32	62	57	57	58	51	41	32	62	57	57	58	51	41	32
		360	(170)	600	(283)	0.044	(11.04)	62	57	58	58	52	42	33	64	59	60	58	52	44	35	65	60	60	60	54	44	35
		450	(212)	750	(354)	0.069	(17.25)	63	58	58	59	53	42	33	65	61	61	61	55	45	36	66	61	61	61	55	45	36
5	8	540	(255)	900	(425)	0.100	(24.85)	63	58	59	59	53	42	34	67	62	62	62	56	47	37	67	62	62	62	57	47	37
		100	(47)	500	(236)	0.004	(0.99)	58	53	52	48	40	28	26	58	53	52	48	40	31	26	58	53	52	48	40	32	26
		200	(94)	700	(330)	0.016	(3.98)	62	57	56	52	45	35	30	62	57	56	52	45	37	30	62	57	56	52	45	38	30
		300	(142)	900	(425)	0.036	(8.94)	64	60	59	55	49	40	34	64	60	59	55	49	40	34	64	60	59	55	49	42	34
5	10	400	(189)	1100	(519)	0.064	(15.90)	66	62	61	58	52	44	36	66	62	61	58	52	44	36	66	62	61	58	52	44	36
		500	(236)	1300	(614)	0.100	(24.85)	68	64	63	60	54	48	38	68	64	63	60	54	48	38	68	64	63	60	54	48	38
		300	(142)	500	(236)	0.013	(3.17)	58	53	52	48	40	28	26	58	53	52	48	40	35	26	58	55	52	48	40	36	26
		450	(212)	725	(342)	0.027	(6.66)	62	57	56	53	45	36	31	62	57	56	53	45	39	31	62	57	56	53	45	40	31
5	10	570	(269)	950	(448)	0.046	(11.44)	65	60	59	56	50	41	34	65	60	59	56	50	41	34	65	60	59	56	50	44	34
		750	(354)	1200	(566)	0.070	(17.50)	67	63	62	59	53	46	37	67	63	62	59	53	46	37	67	63	62	59	53	46	37
		840	(396)	1400	(661)	0.100	(24.85)	69	65	64	61	56	49	39	69	65	64	61	56	49	39	69	65	64	61	56	49	39
		350	(165)	500	(236)	0.011	(2.76)	58	53	52	48	40	28	26	58	53	52	48	40	34	26	58	54	52	48	40	35	26
5	10	500	(236)	750	(354)	0.025	(6.21)	62	58	57	53	46	37	31	62	58	57	53	46	39	31	62	58	57	53	46	40	31
		700	(330)	1000	(472)	0.044	(11.04)	65	61	60	57	50	43	35	65	61	60	57	50	43	35	65	61	60	57	50	43	35
		875	(413)	1250	(590)	0.069	(17.25)	68	64	63	60	54	47	38	68	64	63	60	54	47	38	68	64	63	60	54	47	38
		1050	(496)	1500	(708)	0.100	(24.85)	70	66	65	62	57	51	40	70	66	65	62	57	51	40	70	66	65	62	57	51	40

NOTES: Radiated sound power is the sound transmitted through the casing walls. All sound data is based on tests conducted in accordance with AHRI 880-11. Sound power levels are in dB, re 10⁻¹² Watts. ΔPs is the difference in static pressure from inlet to discharge. NC application data is from AHRI Standard 885-08 Appendix E. All data points listed are application ratings outside the scope of the Certification Program. See Krueger's selection program for specific sound data for optional liners; 1/2", dual density liner shown. Dash indicates a NC is less than 20. See Krueger's Terminal Unit Engineering section for reductions and definitions.

KLPS Control Information**CONTROL SEQUENCE OF OPERATION**

The standard KLPS sequence of operation has the induced airflow fan operating continuously, providing a constant volume of discharge air to the conditioned space.

HEATING MODE

When the zone is at maximum heating demand, the primary air damper maintains a minimum flow and the fan runs constantly, inducing the maximum amount of warm ceiling plenum air. Electric or hot water heat, if supplied, operates at maximum capacity.

As the zone temperature rises, the optional heat, if supplied, cycles off. The fan continues to induce a maximum amount of ceiling plenum air. As the zone temperature rises above the thermostat setpoint, the KLPS unit enters the cooling mode.

COOLING MODE

As the zone temperature rises above setpoint, the primary air damper begins to modulate toward the full open damper position. As the amount of conditioned primary air increases, the amount of induced ceiling plenum air decreases proportionally.

When the conditioned zone is maximum cooling demand, the primary air damper will maintain a constant maximum flow setting. With pressure independent controls, the damper will maintain the maximum flow setting regardless of system pressure fluctuations. The fan will discharge virtually 100% primary air if installed and balanced properly.

NIGHT SETBACK

One of the most popular KLPS control arrangements is the night setback feature. With this control arrangement, the KLPS induced air fan will operate whenever central system pressure is sensed (day mode). When the central system is off (night mode), the KLPS induced air fan and optional heat will cycle on in response to thermostat demand.

CONTROL OPTIONS

- **Pneumatic Controls:** Pressure independent control packages are available with or without hot water or electric heat, night shutdown and/or unoccupied heating. All control arrangements include an inlet flow sensor and fan speed controller.
- **Analog Controls:** Pressure independent control packages are available with or without hot water or electric heat, automatic or remote night shutdown and automatic night setback. All control arrangements include an inlet flow sensor, control enclosure, fan speed controller, transformer to 24 volts, and wall thermostat to match the control type.
- **Direct Digital Controls:** Smart Equipment control packages are provided and programmed by the factory for in-house mounting, piping, and wiring.
 - BACnet Compatible: 7201-7209
 - Standalone: 6201-6209

Other digital control packages can be supplied to the factory for mounting, piping, and wiring.

Contact your Krueger representative for a complete list of direct digital control arrangements.

- **No Control Unit:** Units are factory supplied without controls, assuming that the unit is being used for field mounting of direct digital control equipment. This arrangement includes an inlet flow sensor, control enclosure, fan speed controller, transformer to 24 volts, and fan relay.

NOTES: Visit Krueger's website at www.krueger-hvac.com or contact your local Krueger representative for a complete list of direct digital control arrangements.

To prevent the blower from spinning backwards, the simplest solution is to require that the building control system energize the series box fans prior to starting the central system air handler. Some DDC controls for series boxes have a start-up procedure that closes the damper, de-energizes the fan, (resets to zero on the pressure transducer while the damper is closed) and then returns control to the unit. Most manufacturers' Series Fan boxes are designed to maximize starting torque to overcome this backward rotation. If, however, the primary airflow is available for long enough, and the fan speed control is set at a low enough value, any series fan terminal can be expected to start and operate backward. This will not damage the unit, and it will deliver approximately 60% of designed airflow. Until the space load exceeds 60% of the design load, it is probable that no one will notice the unit is running backward. When the thermostat calls for more than 60% of the design load the excess primary will spill into the plenum and the likely result will be cold plenum air 'falling' from return grilles onto room occupants. No manufacturer offers a mechanical device to prevent backward rotation. Krueger can supply a special sequence that employs a pressure sensor installed in the high-pressure side of the inlet sensor to detect any airflow in the primary duct and energize the fan if the building's control system cannot be properly configured to avoid this problem.

KLPS Control Information

The following list shows the standard control arrangements available with the KLPS product offering. Each control approach offers a variety of pressure independent operating functions; combinations of control functions are identified by the Krueger control package number.

PNEUMATIC CONTROL ARRANGEMENTS

- 1300 - Single Function Controller; DA-NO with or without Hot Water or Electric Heat
- 1301 - Single Function Controller; DA-NO with or without Hot Water or Electric Heat and with Night Shutdown
- 1302 - Single Function Controller; DA-NO with or without Hot Water or Electric Heat, with Night Shutdown, and Unoccupied Heating
- 1303 - Single Function Controller; RA-NC with or without Hot Water or Electric Heat
- 1304 - Single Function Controller; RA-NC with or without Hot Water or Electric Heat and with Night Shutdown
- 1305 - Single Function Controller; RA-NC with or without Hot Water or Electric Heat, with Night Shutdown and Unoccupied Heating
- 1306 - Multi-function Controller; DA-NO with or without Hot Water or Electric Heat
- 1307 - Multi-function Controller; DA-NO with or without Hot Water or Electric Heat and with Night Shutdown
- 1308 - Multi-function Controller; DA-NO with or without Hot Water or Electric Heat, with Night Shutdown and Unoccupied Heating
- 1309 - Multi-function Controller; DA-NC with or without Hot Water or Electric Heat
- 1310 - Multi-function Controller; DA-NC with or without Hot Water or Electric Heat and with Night Shutdown
- 1311 - Multi-function Controller; DA-NC with or without Hot Water or Electric Heat, with Night Shutdown and Unoccupied Heating
- 1312 - Multi-function Controller; RA-NC with or without Hot Water or Electric Heat
- 1313 - Multi-function Controller; RA-NC with or without Hot Water or Electric Heat and with Night Shutdown
- 1314 - Multi-function Controller; RA-NC with or without Hot Water or Electric Heat, with Night Shutdown and Unoccupied Heating
- 1315 - Multi-function Controller; RA-NO with or without Hot Water or Electric Heat
- 1316 - Multi-function Controller; RA-NO with or without Hot Water or Electric Heat and with Night Shutdown
- 1317 - Multi-function Controller; RA-NO with or without Hot Water or Electric Heat, with Night Shutdown and Unoccupied Heating

Pneumatic Control Legend:

- DA - Direct Acting Thermostat
- RA - Reverse Acting Thermostat
- NO - Normally Open Damper Position
- NC - Normally Closed Damper Position
- Single Function Controller - Provides Single Function, DA-NO or RA-NC
- Multi-function Controller - Capable of Providing DA-NO, DA-NC, RA-NC or RA-NO Functions

ANALOG CONTROL ARRANGEMENTS

- 2200 - Cooling Only
- 2201 - Cooling Only with Automatic Night Shutdown
- 2203 - Cooling Only with Automatic Night Setback
- 2204 - Cooling with On/Off Hot Water Heat
- 2205 - Cooling with On/Off Hot Water Heat and Automatic Night Shutdown
- 2207 - Cooling with On/Off Hot Water Heat and Automatic Night Setback
- 2208 - Cooling with Proportional Hot Water Heat
- 2209 - Cooling with Proportional Hot Water Heat and Automatic Night Shutdown
- 2211 - Cooling with Proportional Hot Water Heat and Automatic Night Setback
- 2212 - Cooling with Up to Two Stages of Electric Heat
- 2213 - Cooling with Up to Two Stages of Electric Heat and Automatic Night Shutdown
- 2215 - Cooling with Up to Two Stages of Electric Heat and Automatic Night Setback
- 2217 - Cooling/heating with Automatic Changeover
- 2218 - Cooling with Proportional Electric Heat

DIRECT DIGITAL CONTROL ARRANGEMENTS

Visit Krueger's website at www.krueger-hvac.com or contact your Krueger representative for a complete list of factory mounted direct digital control arrangements.

KLPS, KLPS-D Engineering Specification & Configuration**KLPS UNIT**

Fan powered terminal unit size 1 shall be ultra low profile not exceeding 8 5/8" in height or 48" in length, or unit sizes 2 - 4 shall be a low profile type not exceeding 11" in height and 41" in length, or unit size 5 shall be a low profile type unit not exceeding 17" in height and 47" in length, completely factory assembled and wired with motor, blower, mixing plenum, and primary air damper contained in a single unit housing. Unit shall be Krueger model KLPS.

The induced air fan shall operate continuously during central system operation. Primary airflow controller shall compensate for central system pressure fluctuations. When room temperature requires maximum heating, the (direct digital) (analog) (pneumatic) pressure independent velocity controller maintains the minimum primary airflow setting by modulating the damper. The electric heating coil or hot water coil, if supplied, is energized (activated). As room temperature begins to rise, the heating coil is de-energized (deactivated). As room temperature rises above the setpoint, the primary air damper will modulate to maintain room temperature. When the room temperature calls for maximum cooling, the velocity controller maintains the maximum primary airflow setting.

To prevent the fan/motor from running in the backward direction, the unit induced air fan shall be field wired so that it is electrically or pneumatically interlocked with the central system fan.

Terminals shall be tested by use of the AHRI Standard 880. The terminal unit shall be ETL listed as a complete assembly. All electrical components shall be UL listed and installed in accordance with the National Electric Code. All electrical components shall be mounted in sheet metal control enclosures. Electrical connection shall be single point.

Unit casing shall be constructed of not less than 20 gage galvanized steel. Unit discharge shall be rectangular, suitable for flanged duct connections.

Unit labels shall be adhered to each unit including model size, airflow (CFM), balancing chart, and tagged data.

KLPS unit shall be equipped with a factory installed airflow sensing device. Provide a K4 LineaCross, four quadrant, multi-point center averaging sensor with an amplified signal.

- **(Optional)** Provide a linear, multi-point, velocity averaging sensor with an amplified signal.

Provide balancing taps to allow for easy airflow verification.

Fan motor and all interior components must be accessible through a removable bottom access panel.

Fan shall be of the forward curve, centrifugal type. The fan motor shall be single speed (120, 208/240, 277), 60 cycle, single phase, energy efficient design, permanently lubricated, using permanent split capacitor for starting and be specifically designed for use with an SCR fan speed controller. Motor must have thermal overload protection. The fan motor shaft shall be connected directly to the fan and fan motor shall be isolated from the unit casing to prevent transmission of vibration.

- **(Optional)** ECM Fan Motor: The fan motor shall be [120, 208/240, or 277 volt, single-phase] ECM (electronically commutated motor) fan motors including either a manual or remote adjustable speed controller. The manual adjustable speed controller is field set with a digital display, alternating between RPM and percentage full airflow. The remote adjustable speed controller provides a means to remotely set and/or adjust the fan speed.

The radiated and discharge attenuation factors for the specified NC levels shall be based on attenuation factors from AHRI Standard 885-08 Appendix E, which includes room absorption, environmental adjustment factor, duct insertion, end reflection and duct branching.

Unit casing shall be lined with 1/2" thick, 1 1/2 lb. dual density fiberglass insulation that meets UL 181 and NFPA 90A. Insulation shall be attached to the unit casing by adhesive and weld pins.

- **(Optional)** Cellular Insulation; Unit casing shall be lined with 1/2" or 1" (size 5 only) thick, 1 1/2 lb. density, smooth surface, polyolefin, closed-cell, foam insulation for fiber free application. Cellular insulation meets UL 181 and NFPA 90A and does not support mold or bacteria growth. Insulation shall be attached to the unit casing by adhesive and weld pins.
- **(Optional)** Sterilwall Insulation: Unit casing shall be lined with 1/2", 1 1/2 lb. dual density fiberglass insulation that meets UL 181 and NFPA 90A, enclosed between the unit casing and a non-perforated internal sheet metal cover

extending over the fiberglass insulation, as well as covering the liner cut edges.

- **(Optional)** Perforated Doublewall Insulation: Unit casing shall be lined with 1/2", 1 1/2 lb. dual density fiberglass insulation that meets UL 181 and NFPA 90A, enclosed between the unit casing and a perforated internal sheet metal cover extending over the fiberglass insulation, as well as covering the liner cut edges.
- **(Optional)** Foil Encapsulated Insulation: Unit casing shall be lined with foil reinforced, wrapped edges, 1/2" or 1" (size 5 only) thick, 1 1/2 lb. density fiberglass insulation that meets UL 181 and NFPA 90A. Insulation shall be attached to the unit casing by adhesive and weld pins.
- **(Optional - Unit Size 5 Only)** Steriliner Insulation: Unit casing shall be lined with 13/16" thick, 4 lb. density, rigid board insulation with fiber reinforced foil covering insulation fibers that meets UL 181 and NFPA 90A. Liner shall be attached to unit casing by adhesive and weld pins with foil tape sealing the insulation cut edges.
- **(Optional - Unit Size 5 Only)** 1" Thick Insulation: Unit casing shall be lined with 1" thick, 1 1/2 lb. dual density fiberglass insulation that meets UL 181 and NFPA 90A. Insulation shall be attached to the unit casing by adhesive and weld pins.
- **(Optional)** No Liner: Unit casing shall be equipped with no internal insulation liner.

ELECTRIC HEAT COILS

Electric coils shall be supplied by the terminal unit manufacturer and shall be ETL listed in accordance with UL standards. Construct coil casing with minimum of 20 gage galvanized steel. Elements shall be 80/20 Ni-Cr and supported by ceramic insulators. The integral control panel shall be housed in a NEMA 2 enclosure with hinged access door for access to all controls and safety devices.

Electric coils shall contain a primary automatic reset thermal cutout and differential pressure airflow switch for proving of airflow.

- **(Optional)** Electric coils shall include fused or non-fused door interlocking disconnect switch, AC solid state relay, fuse-block, manual reset cutout, and/or dust tight enclosure construction.
- **(Optional)** LineaHeat solid state electronic proportional control of electric heat shall meet the requirements of ASHRAE Standard 62, Addenda N.

KLPS, KLPS-D Engineering Specification & Configuration

- **(Optional)** LineaHeat solid state electronic controlled heater with control of the leaving air temperature limiting the unit discharge temperature to a set value.

HOT WATER COILS

Hot water coil casing shall be constructed with minimum 20 gage galvanized steel with flanged discharge for attachment to downstream ductwork. Coils shall be factory installed on the terminal unit. Fins shall be rippled and corrugated heavy gage aluminum, mechanically bonded to

tubes. Tubes shall be copper with minimum wall thickness of 0.016" and with male solder header connections. Coils shall be leak tested to 400 psi. Number of coil rows and circuits shall be selected to provide performance as required by the plans. Coil performance data shall be based on tests run in accordance with AHRI Standard 410.

SENSIBLE COOLING COIL (KLPS-D)

Cooling water coil casing shall be constructed with minimum 18 gage galvanized steel with filter frame to accept 1" construction type or MERV 8 filter. Coils

shall be factory installed on the induced air inlet of terminal unit. Fins shall be rippled and corrugated heavy gage aluminum, mechanically bonded to tubes. Tubes shall be copper with minimum wall thickness of 0.016" and with male solder header connections. Coils shall be leak tested to 400 psi. Number of coil rows and circuits shall be selected to provide performance as required by the plans. Coil performance data shall be based on tests run in accordance with AHRI Standard 410.

1. SERIES: (XXXXX)

- KLPS - Low Profile Fan Powered Terminal Unit
- KLPS-D - Low Profile Fan Powered Terminal Unit, Dedicated Outdoor Air System

2. SENSOR TYPE: (X)

- 1 - Linear Averaging
- 3 - K4 LineaCross (Four Quadrant)

3. LINER TYPE: (X)

- 0 - 1/2" Liner
- 1 - 1" Liner ^
- 2 - Steriliner ^
- 3 - No Liner ^
- 4 - Sterilwall with 1/2" Dual Density
- 6 - 1/2" Foil Encapsulated
- 9 - 1" Foil Encapsulated ^
- A - Perforated Doublewall with 1/2" Dual Density
- F - 1/2" Cellular
- H - 1" Cellular ^

4. UNIT CASING CONTROLS: (XX)

- 1L - Left-hand Side, 20 Gage
- 1R - Right-hand Side, 20 Gage
- 2L - Left-hand Side, 20 Gage, Dual Access Panels
- 2R - Right-hand Side, 20 Gage, Dual Access Panels

5. UNIT SIZE: (X)

- 1 - Inlet Sizes: 4", 5", 6", 7"
- 2 - Inlet Sizes: 4", 5", 6", 7", 8"
- 3 - Inlet Sizes: 4", 5", 6", 7", 8", 10"
- 4 - Inlet Sizes: 10", 8" x 14"
- 5 - Inlet Sizes: 6", 7", 8", 10", 12", 14"

6. INLET CODE: (XX)

- 04 - 4" Round
- 05 - 5" Round
- 06 - 6" Round
- 08 - 8" Round
- 10 - 10" Round
- 12 - 12" Round
- 14 - 14" Round
- 12 - 8" x 14" Rectangle ^^^

7. MOTOR VOLTAGE: (X)

- 1 - 120V, 1-Phase
- 2 - 208/240V, 1-Phase
- 3 - 277V, 1-Phase
- 4 - ECM Motor, 120V, 1-Phase **
- 5 - ECM Motor, 208/240V, 1-Phase **
- 6 - ECM Motor, 277V, 1-Phase **

8. CONTROL TYPE: (XXXX)

- (2XXX) - Analog
- (7XXX) - Digital, BACnet Compatible
- (6XXX) - Digital, Standalone
- (XXXX) - Factory Mounted, Provided by Others
- (1XXX) - Pneumatic

9. UNIT ACCESSORIES: (Up to 6)

- 0 - None
- A - Motor Toggle Disconnect *
- F - Fan Motor Fuse
- P - Cam Lock for Access Panels ^^
- R - Induction Inlet Filter, Construction Type
- S - Hanger Brackets
- 1 - 2 Row Cooling Coil, Upstream Piping Connection *
- 2 - 2 Row Cooling Coil, Downstream Piping Connection *
- 3 - 4 Row Cooling Coil, Upstream Piping Connection *
- 4 - 4 Row Cooling Coil, Downstream Piping Connection *
- 5 - 6 Row Cooling Coil - Upstream Piping Connection *
- 6 - 6 Row Cooling Coil - Downstream Piping Connection *
- M - MERV 8 Filter **

10. WATER HEAT: (ROWS/CONNECTION HAND) (XXX)

- 000 - N/A / None
- W11 - 1 Row/Right
- W12 - 2 Row/Right
- W21 - 1 Row/Left
- W22 - 2 Row/Left

11. ELECTRIC HEAT: (XX)

- LINEAHEAT: (XX)**
- 00 - None
- E1 - 120v/1-Phase
- E2 - 208v/1-Phase
- E3 - 240v/1-Phase
- E4 - 277v/1-Phase
- E6 - 208v/3-Phase/3-Wire
- E9 - 480v/3-Phase/4-Wire
- L1 - 120v/1-Phase
- L2 - 208v/1-Phase
- L3 - 240v/1-Phase
- L4 - 277v/1-Phase
- L6 - 208v/3-Phase/3-Wire
- L9 - 480v/3-Phase/4-Wire

12. ELECTRIC HEAT STEPS: (X)

- 0 - None
- 1 - 1-Stage
- 2 - 2-Stage
- 3 - 3-Stage

13. HEAT COIL ACCESSORIES: (X) (X) (X) (X)

- 0 - None
- C - Fuse Block
- F - Manual Reset Cutout
- G - Dust-tight Construction
- H - Staged Solid State Relays
- K - Door-interlocking Fused Disconnect
- L - Door-interlocking Non-fused Disconnect

* Motor Toggle Disconnect not available with electric heat.

** Manual or remote adjustable speed controller for ECM motor option is required.

^ Liner Available on unit size 5 only.

^^ Cam Locks ONLY available with casing configurations 2R' & '2L'.

^^^ KLPS Size 4 Only.

* Available on KLPS-D only.

** Available with ECM Motor only.