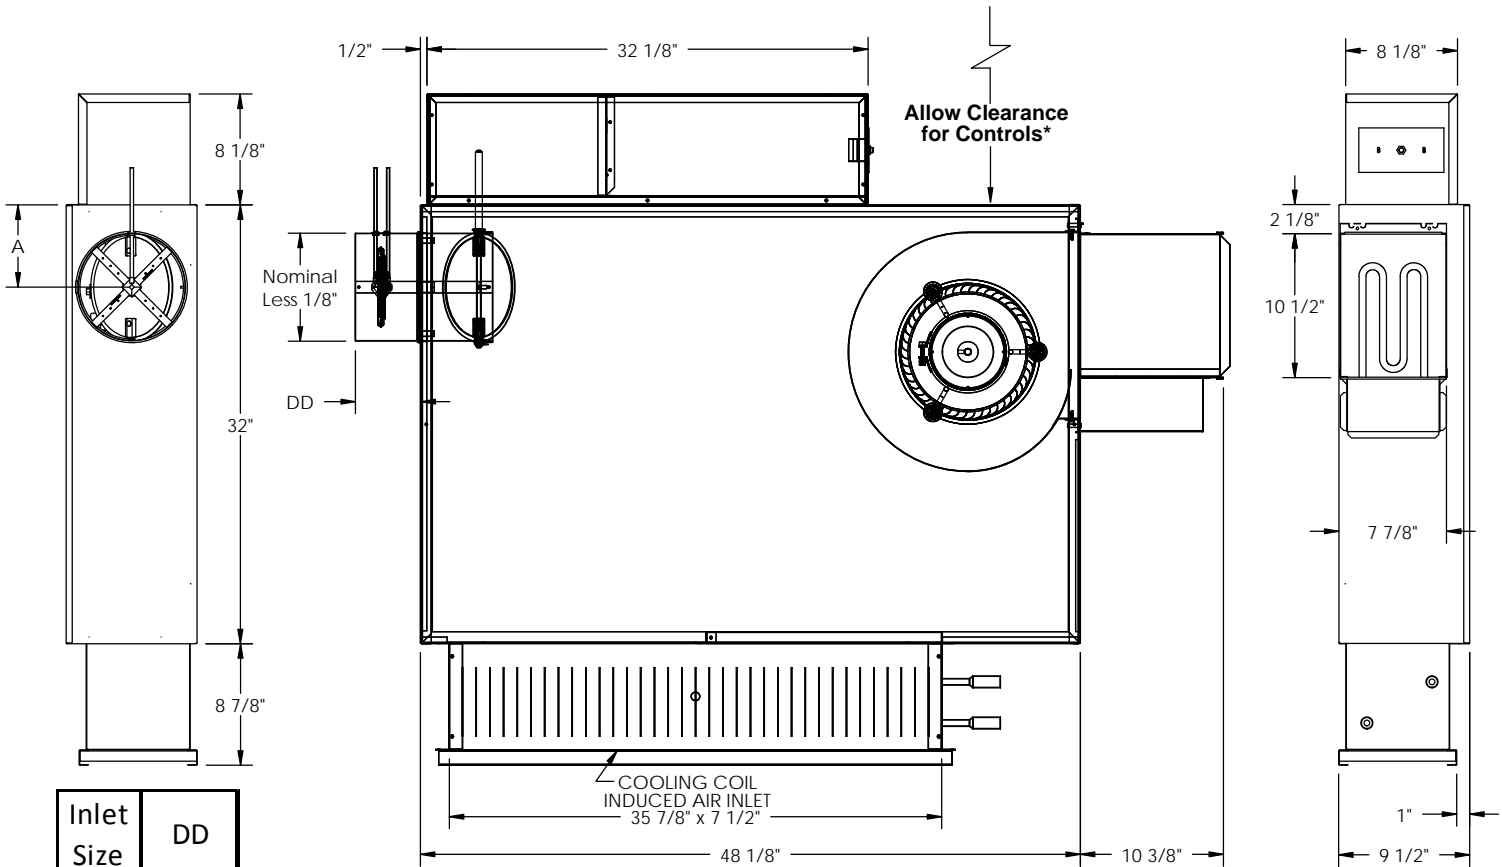


KLPS-D Unit 2
Electric Heat with Electronic Controls
SUBMITTAL SHEET


Inlet Size	DD
04"	6 3/4"
05"	6 3/4"
06"	4 3/4"
07"	4 3/4"

PLAN VIEW - LEFT HAND UNIT
 (Downstream Side Induced Coil Connection Shown)

DISCHARGE VIEW
STANDARD FEATURES:

- 20GA. Galvanized Steel Construction
- Steel Control Enclosure for Electronic Components
- 1/2" Thick Dual Density Fiberglass Insulation Meeting NFPA 90A and UL181 Safety Requirements
- 1/3 HP ECM Motor with Permanently Lubricated Ball Bearings and Constant Airflow Program
 - Manual Control
 - 0-10Vdc Remote Control
 - 2-10Vdc Remote Control
 - 120V 208/240V 277V
- Bottom Access Panel for Service
- Sensible Cooling Coil Factory Installed on Induced Air Inlet Supplied with Drip Tray **
- 4 Quadrant, Center Averaging Inlet Flow Sensor
- Factory Supplied 24 Volt Control Transformer for Electronic Controls
- ETL Listed
- Performance Data per AHRI Standard 880
- Construction Type Air Filter – 19" x 8 5/8" x 1" x 2

OPTIONAL FEATURES:

- Liners
 - 1/2" Cellular Insulation
 - 1/2" Foil Encapsulated Fiberglass Insulation
 - No Liner
- Cooling Coil Connection
 - Upstream Side
 - Downstream Side
 - Left Hand Controls
 - Right Hand Controls
 - Motor Toggle Disconnect Switch
 - Motor Fusing
 - Dust Tight Control Enclosure
 - Hanger Brackets
 - 24VAC SSR
 - LineaHeat Controlled SSR Heat
 - Discharge Temperature Sensor
- Door Interlocking Disconnect Switch
 - Fused
 - Non-Fused
- Merv Type 8 Air Filter – 19" x 8 5/8" x 1" x 2
- Dual Access Panels for Service
 - Cam-Locks (Dual Access Panel Only)

* Check NEC for Unit Clearance Requirements

** See Submittal Form TUS-03-135-000CP