

KHF - SERIES A






Horizontal Fan Coil Units | Low Profile



DIMENSIONAL DATA | KHFE | REAR RETURN

FAN COIL UNITS | HORIZONTAL, LOW PROFILE







KHF - SERIES A

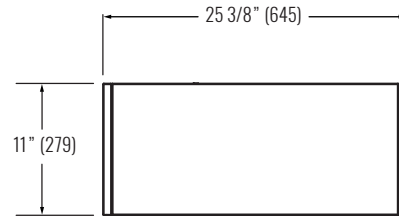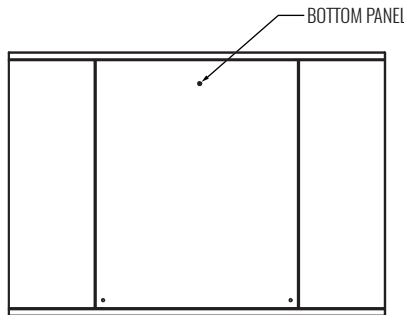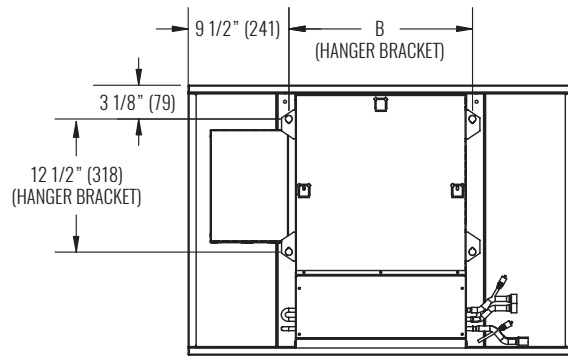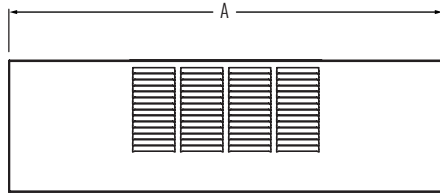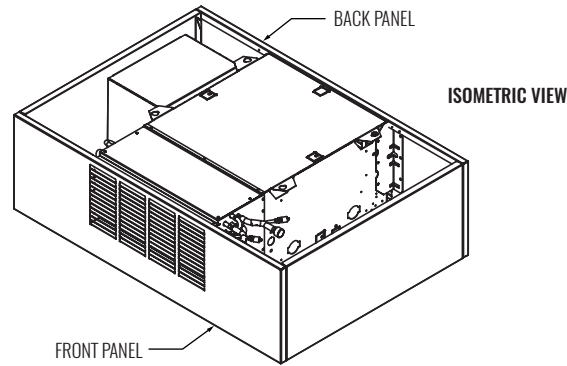

| UNIT SIZE | A | B |
|-----------|----------------|----------------|
| 02 | 36 1/4" (921) | 17 1/4" (438) |
| 03 | 39 1/2" (1003) | 20 1/2" (521) |
| 04 | 44 1/2" (1130) | 25 1/2" (648) |
| 06 | 51 1/4" (1302) | 32 1/4" (819) |
| 08 | 58 1/4" (1480) | 39 1/4" (997) |
| 09 | 62 1/2" (1588) | 43 1/2" (1105) |
| 10 | 72 1/4" (1835) | 53 1/4" (1353) |
| 12 | 80 1/4" (2038) | 61 1/4" (1556) |

NOTES: All dimensions are inches (millimeters). All dimensions $\pm 1/4"$ (6mm). Metric values are soft conversions. Left-hand unit shown, right-hand unit opposite. Provide sufficient clearance to access electrical controls and comply with applicable codes and ordinances. Drain piping should be routed through casing opening indicated to provide proper slope. Bottom panel removable for access to filter and fan assembly. Corner panels are removable to access electrical enclosure, coil and valve pack. Internal insulation of field piping may be required. Field piping casing penetrations must be cut in the field to match individual job requirements. All dimensions also apply to units with Electric Heat Only.

DIMENSIONAL DATA | KHFE | REAR RETURN (CONTINUED)

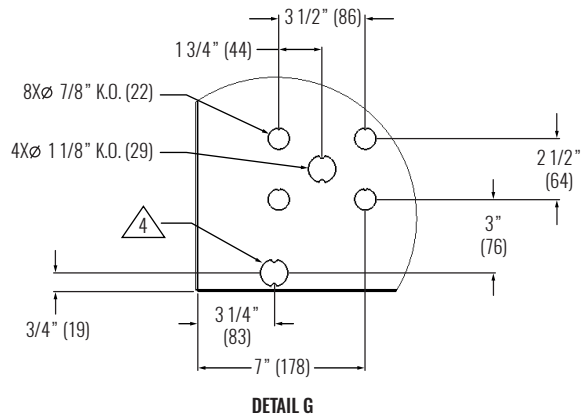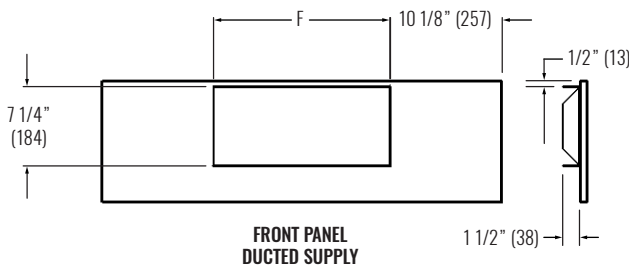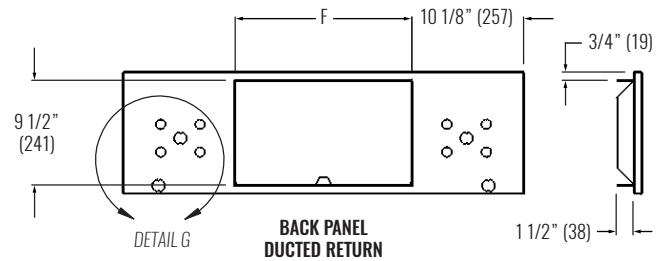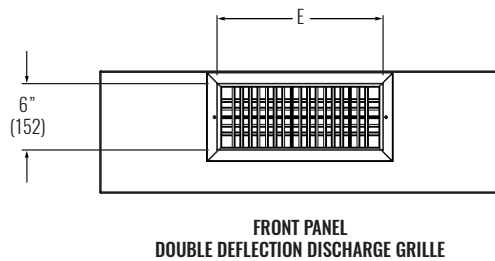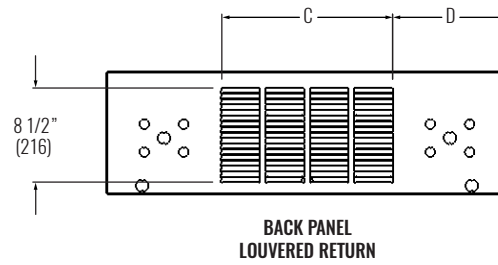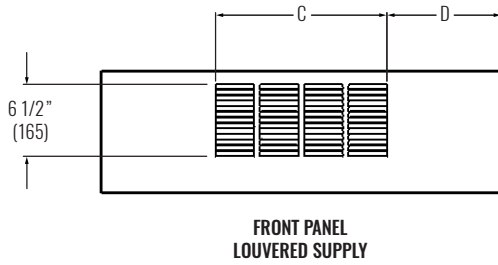

| UNIT SIZE | C | D | E | F |
|-----------|----------------|---------------|------------|----------------|
| 02 | 15 1/2" (394) | 10 3/8" (264) | 15" (381) | 16" (406) |
| 03 | 15 1/2" (394) | 12" (305) | 18" (457) | 19 1/4" (489) |
| 04 | 23 1/2" (597) | 10 1/2" (267) | 23" (584) | 24 1/4" (616) |
| 06 | 27 1/2" (699) | 11 7/8" (302) | 30" (762) | 31" (787) |
| 08 | 35 1/2" (902) | 11 3/8" (289) | 37" (940) | 38" (965) |
| 09 | 39 1/2" (1003) | 11 1/2" (292) | 41" (1041) | 42 1/4" (1073) |
| 10 | 51 1/2" (1308) | 10 3/8" (264) | 23" (584) | 52" (1321) |
| 12 | 59 1/2" (1511) | 10 3/8" (264) | 27" (686) | 60" (1524) |

NOTES: All dimensions are inches (millimeters). All dimensions $\pm 1/4"$ (6mm). Metric values are soft conversions. Left-hand unit shown, right-hand unit opposite. Provide sufficient clearance to access electrical controls and comply with applicable codes and ordinances. Drain piping should be routed through casing opening indicated to provide proper slope. Bottom panel removable for access to filter and fan assembly. Corner panels are removable to access electrical enclosure, coil and valve pack. Internal insulation of field piping may be required. Field piping casing penetrations must be cut in the field to match individual job requirements. All dimensions also apply to units with Electric Heat Only.

KHF - SERIES A






Horizontal Fan Coil Units | Low Profile



DIMENSIONAL DATA | KHFE | BOTTOM RETURN

FAN COIL UNITS | HORIZONTAL, LOW PROFILE


KHF - SERIES A

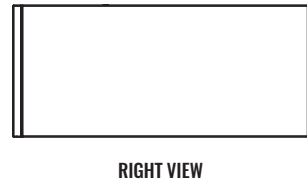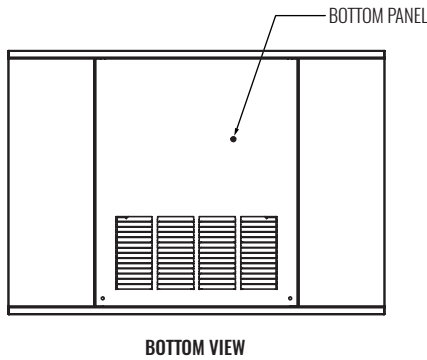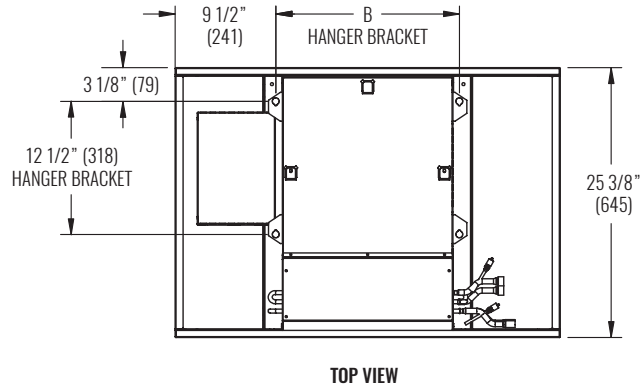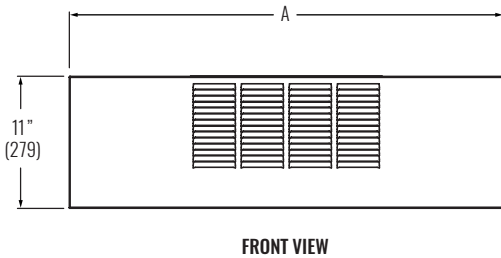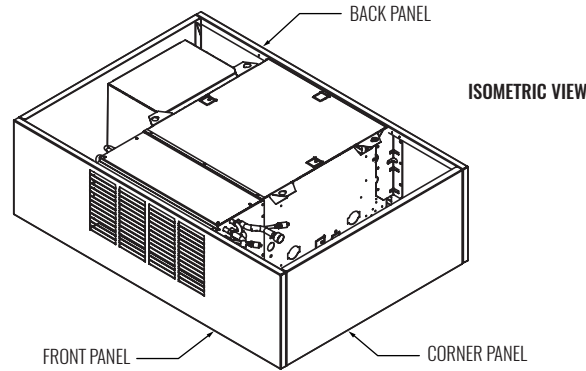


| UNIT SIZE | A | B |
|-----------|----------------|----------------|
| 02 | 36 1/4" (921) | 17 1/4" (438) |
| 03 | 39 1/2" (1003) | 20 1/2" (521) |
| 04 | 44 1/2" (1130) | 25 1/2" (648) |
| 06 | 51 1/4" (1302) | 32 1/4" (819) |
| 08 | 58 1/4" (1480) | 39 1/4" (997) |
| 09 | 62 1/2" (1588) | 43 1/2" (1105) |
| 10 | 72 1/4" (1835) | 53 1/4" (1353) |
| 12 | 80 1/4" (2038) | 61 1/4" (1556) |

NOTES: All dimensions are inches (millimeters). All dimensions $\pm 1/4"$ (6mm). Metric values are soft conversions. Left-hand unit shown, right-hand unit opposite. Provide sufficient clearance to access electrical controls and comply with applicable codes and ordinances. Drain piping should be routed through casing opening indicated to provide proper slope. Bottom panel removable for access to filter and fan assembly. Corner panels are removable to access electrical enclosure, coil and valve pack. Internal insulation of field piping may be required. Field piping casing penetrations must be cut in the field to match individual job requirements. All dimensions also apply to units with Electric Heat Only.


DIMENSIONAL DATA | KHFE | BOTTOM RETURN (CONTINUED)

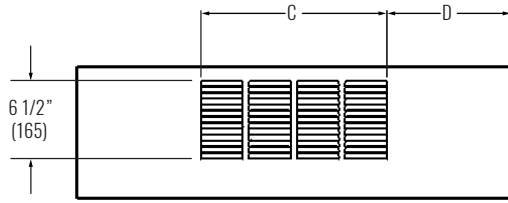


**FRONT PANEL
LOUVERED SUPPLY**

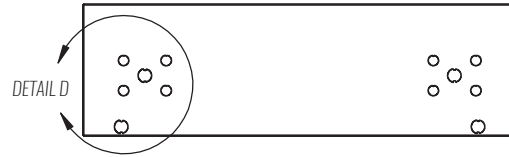


**BACK PANEL
BOTTOM RETURN**

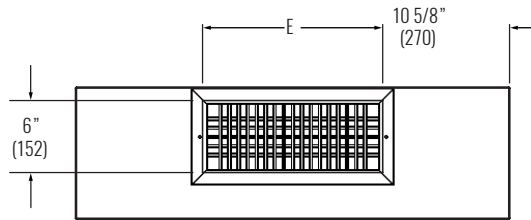


**FRONT PANEL
DOUBLE DEFLECTION SUPPLY GRILLE**

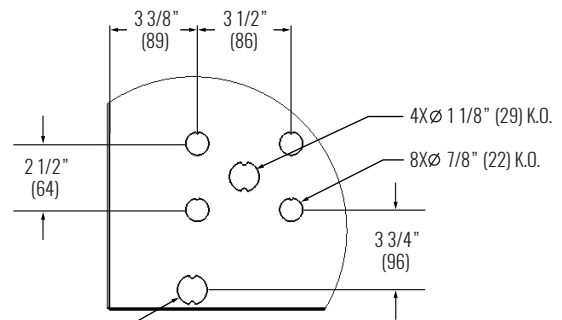

SEE NOTE 4
DETAIL D

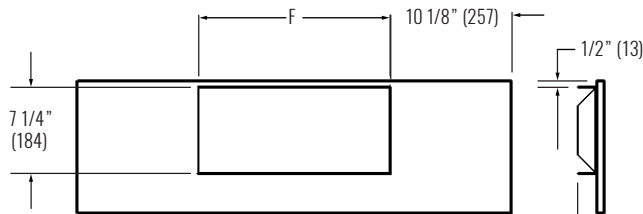

**FRONT PANEL
DUCTED SUPPLY**

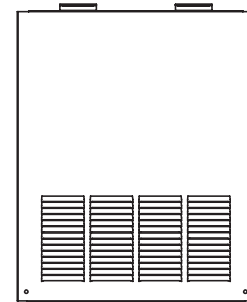

**BOTTOM PANEL
BOTTOM RETURN**

| UNIT SIZE | C | D | E | F |
|-----------|----------------|---------------|------------|----------------|
| 02 | 15 1/2" (394) | 10 3/8" (264) | 15" (381) | 16" (406) |
| 03 | 15 1/2" (394) | 12" (305) | 18" (457) | 19 1/4" (489) |
| 04 | 23 1/2" (597) | 10 1/2" (267) | 23" (584) | 24 1/4" (616) |
| 06 | 27 1/2" (699) | 11 7/8" (302) | 30" (762) | 31" (787) |
| 08 | 35 1/2" (902) | 11 3/8" (289) | 37" (940) | 38" (965) |
| 09 | 39 1/2" (1003) | 11 1/2" (292) | 41" (1041) | 42 1/4" (1073) |
| 10 | 51 1/2" (1308) | 10 3/8" (264) | 23" (584) | 52" (1321) |
| 12 | 59 1/2" (1511) | 10 3/8" (264) | 27" (686) | 60" (1524) |


NOTES: All dimensions are inches (millimeters). All dimensions $\pm 1/4"$ (6mm). Metric values are soft conversions. Left-hand unit shown, right-hand unit opposite. Provide sufficient clearance to access electrical controls and comply with applicable codes and ordinances. Drain piping should be routed through casing opening indicated to provide proper slope. Bottom panel removable for access to filter and fan assembly. Corner panels are removable to access electrical enclosure, coil and valve pack. Internal insulation of field piping may be required. Field piping casing penetrations must be cut in the field to match individual job requirements. All dimensions also apply to units with Electric Heat Only.

KHF - SERIES A


Horizontal Fan Coil Units | Low Profile




DIMENSIONAL DATA | KHFE | BOTTOM RETURN (CONTINUED)

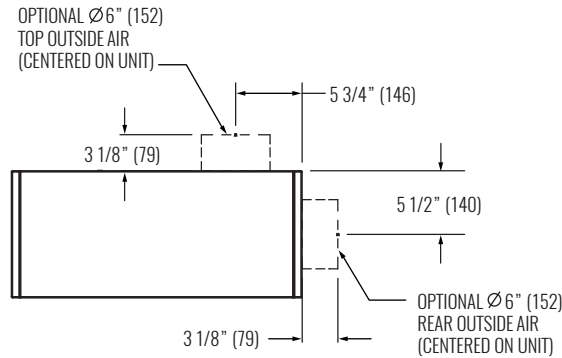

OPTIONAL OUTSIDE AIR FLANGE ONLY DETAIL

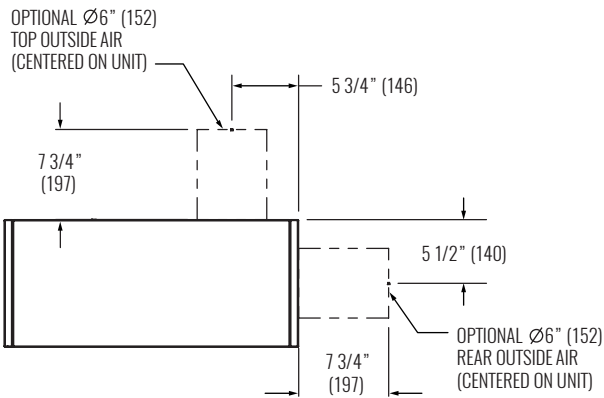

OPTIONAL OUTSIDE AIR WITH MANUAL DAMPER DETAIL

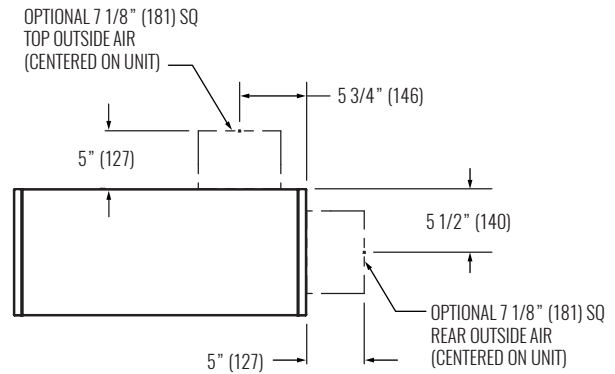

OPTIONAL OUTSIDE AIR WITH MOTORIZED DAMPER DETAIL

NOTES: All dimensions are inches (millimeters). All dimensions $\pm 1/4''$ (6mm). Metric values are soft conversions. Left-hand unit shown, right-hand unit opposite. Provide sufficient clearance to access electrical controls and comply with applicable codes and ordinances. Drain piping should be routed through casing opening indicated to provide proper slope. Bottom panel removable for access to filter and fan assembly. Corner panels are removable to access electrical enclosure, coil and valve pack. Internal insulation of field piping may be required. Field piping casing penetrations must be cut in the field to match individual job requirements. All dimensions also apply to units with Electric Heat Only.