


SUBMITTALSHEET

Form Number SS0006 Effective Date 11/97
replaces FORM SS-S-0006

JOB NAME _____
ARCHITECT _____
ENGINEER _____
CONTRACTOR _____
LOCATION _____



STERILFLO SYSTEM MODEL 812 OPERATING ROOM PARTICULATE CONTROL SYSTEM

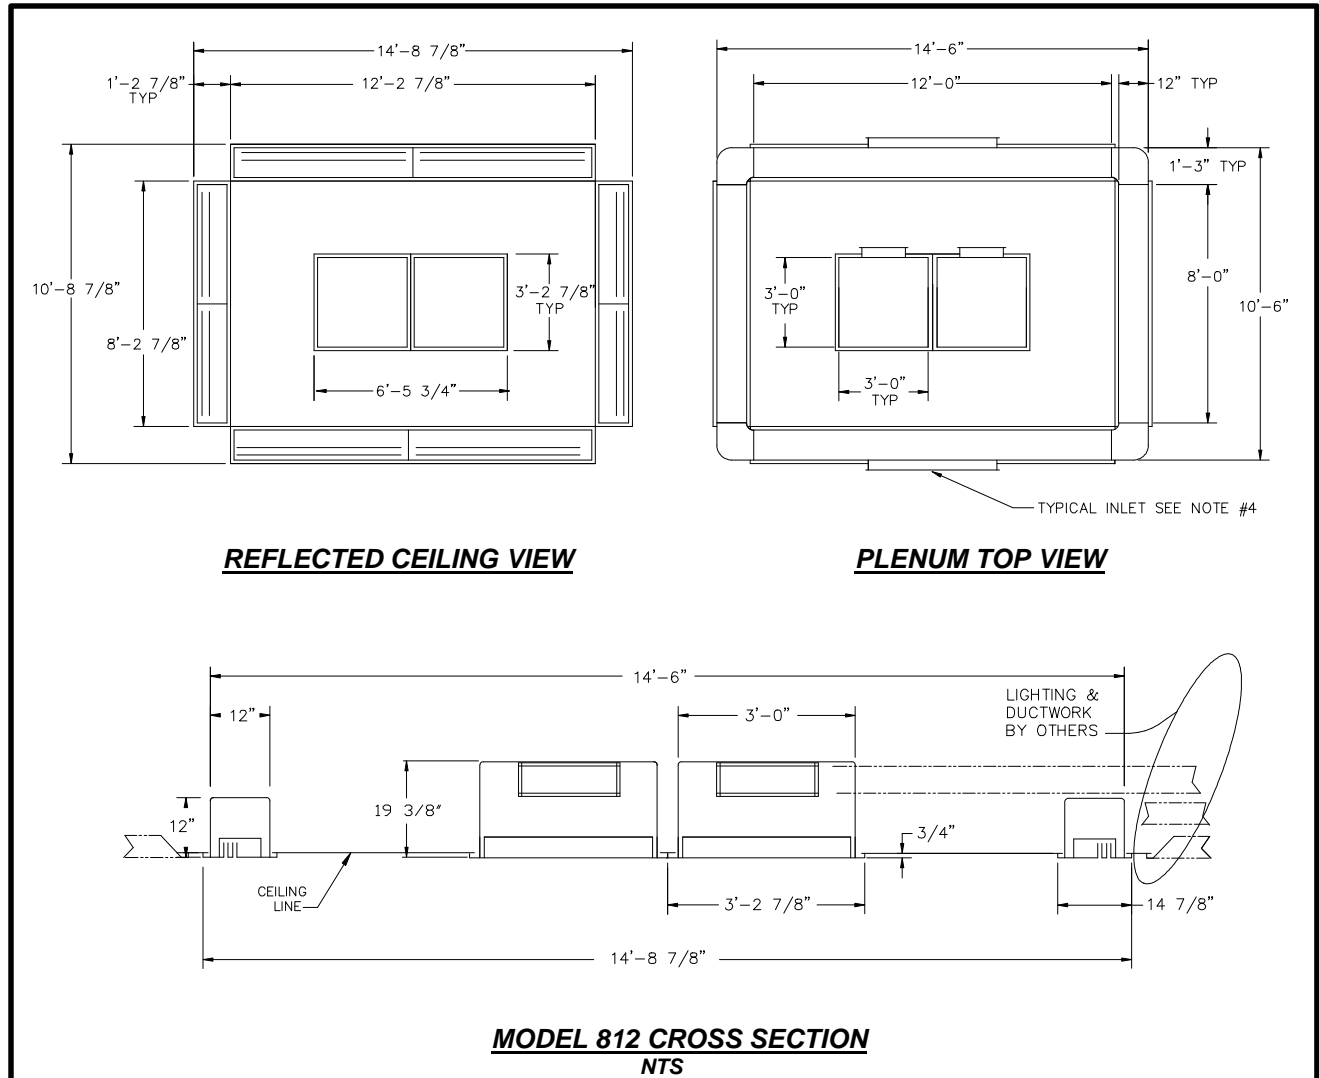

NOTES :

- MATERIAL SPECIFICATIONS:** PLENUMS : 304 STAINLESS STEEL MINIMUM 22 GA.
PERFORATED CENTER PANEL FACES : 304 STAINLESS STEEL MINIMUM 22 GA.
SLOTTED PERIMETER FACES : 304 STAINLESS STEEL MINIMUM 20 GA.
- FINISH OF SLOTTED PERIMETER FACE PANELS AND ALL EXPOSED FRAMES IS NO. 4 SCRATCH OR EQUAL.
- ALL FACE PANELS ARE RETAINED WITH QUARTER TURN FASTENERS FOR EASE OF INSTALLATION & REMOVAL.
- FLANGED INLETS (4" DEEP) ARE SIZED ACCORDING TO THE NUMBER OF AIR CHANGES REQUIRED AND THE VOLUME OF THE ROOM SPECIFIED.
- MODEL 812** IS DESIGNED TO MEET A REQUIREMENT OF **1500 CFM – 2700 CFM**. IT PROVIDES AN UNINTERRUPTED AIR SUPPLY OVER THE OPERATING TABLE. THE SURGICAL TABLE MUST BE ALIGNED WITH THE STERILFLO SYSTEM, LONG SIDE TO LONG SIDE, TO PROVIDE THE DESIRED AIR PATTERN.

Product Information is Subject to Change Without Notice