


KVFH - VERTICAL FAN COIL
 RECESSED WALL PANEL, FRONT SPLY, RTRN

SUBMITTAL SHEET

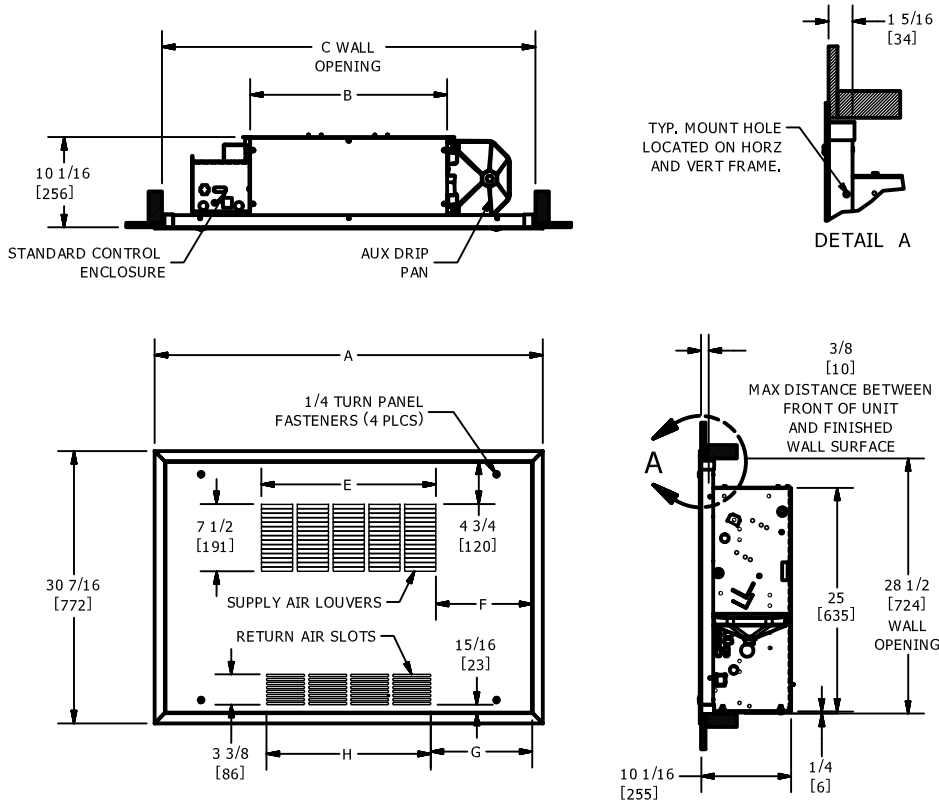

DIMENSIONS							
UNIT SIZE	A	B	C	D	E	F	G
2	43-7/16 [1101]	22 [559]	41-11/16 [1059]	18-3/8 [467]	19-1/2 [495]	10-3/4 [273]	11-5/16 [288]
3	47-7/16 [1203]	26 [660]	45-11/16 [1160]	23-1/16 [586]	23-1/2 [597]	10-3/4 [273]	11 [279]
4	53-7/16 [1355]	32 [813]	55-11/16 [1313]	27-3/4 [705]	27-1/2 [699]	11-3/4 [298]	11-5/8 [295]
6	63-7/16 [1609]	42 [1067]	61-11/16 [1567]	37-1/8 [943]	39-1/2 [1003]	10-3/4 [273]	11-15/16 [303]
8	65-7/16 [1660]	44 [1118]	63-11/16 [1618]	41-7/8 [1064]	39-1/2 [1003]	11-3/4 [298]	10-9/16 [269]
10	79-7/16 [2015]	58 [1473]	77-11/16 [1973]	55-15/16 [1421]	55-1/2 [1410]	10-3/4 [273]	10-9/16 [269]
12	87-7/16 [2219]	66 [1676]	85-11/16 [2176]	60-5/8 [1540]	63-1/2 [1613]	10-3/4 [273]	12-3/16 [309]

- NOTES:
- ALL DIMENSIONS ARE IN INCHES [MM]. ALL DIMENSIONS ARE ±1/4" [6MM]. METRIC VALUES ARE SOFT CONVERSIONS
 - WALL PANEL PROVIDES AIR SEAL AT FRONT OF UNIT. INSTALLED LOCATION IS CRITICAL TO PROPER UNIT OPERATION
 - INSTALL UNIT CENTERED IN WALL OPENING DIMENSIONS SHOWN
 - UNIT MAY REQUIRE RAISED SUPPORT TO ACHIEVE PROPER VERTICAL ALIGNMENT WITH WALL PANEL
 - RIGHT HAND COIL CONNECTION SHOWN. LEFT HAND UNIT SIMILAR BUT OPPOSITE
 - MOUNTING HARDWARE FURNISHED BY OTHERS

Revision Date: 04/15	Form: FCS03-KVFH03	Replaces: NEW
----------------------	--------------------	---------------