

KBHD Dual Blower Arr. 3 w/Mixing Box


DIRECT DRIVE DUAL BLOWER COIL UNIT
DISCHARGE ARGT. 3 W/ MIXING BOX

JOB NAME _____
ENGINEER _____
CONTRACTOR _____
TAG _____


SUBMITTAL SHEET

NOTES:

1. All dimensions are in Inches [millimeters]. All dimensions are $\pm 1/4"$ [6mm]. Metric values are soft conversion.
2. Right hand unit shown, Left hand unit opposite. Motor/drive location may be specified Left or Right Hand. Standard control enclosure location matches motor/drive position.
3. Provide sufficient clearance to permit access to controls and comply with applicable codes and ordinances.
4. See drawing BCS-KBOD-ACFR0 for filter rack details.
5. Base rail is optional on the base unit. See drawing BCS-KBOD-ACEB0. Base rails must be used with mixing box.
6. See coil connection detail drawings for coil connection sizes and locations.

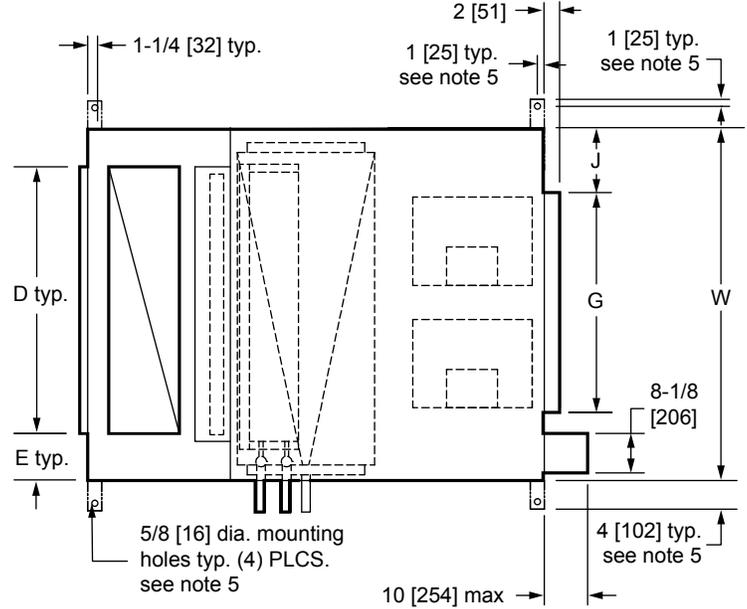


TOP VIEW

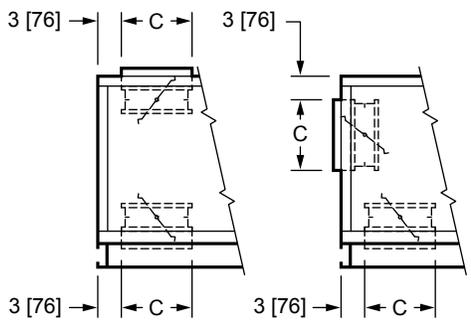

Top/BTM Inlet

Rear/BTM Inlet

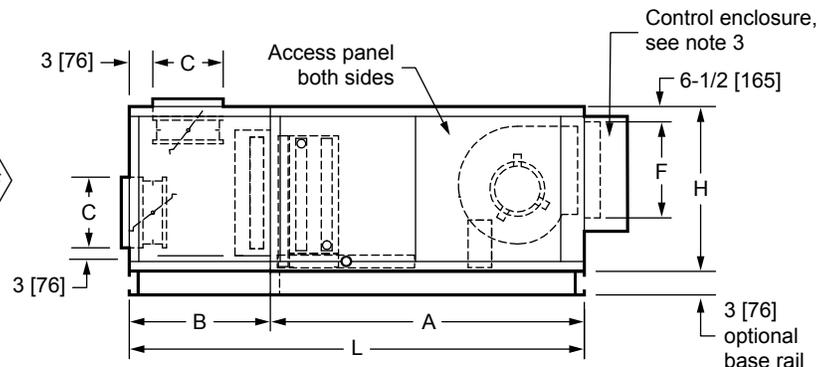

Rear/Top Inlet

SIDE VIEWS

DIMENSIONS												
UNIT SIZE	FAN SIZE	L	W	H	A	B	C	D	E	F	G	J
30	10 x 8 [254 x 203]	67 [1702]	59 [1499]	30 [762]	46 [1168]	21 [533]	12 [305]	45 [1143]	7 [178]	18 [457]	36 1/2 [927]	11 1/4 [286]
40	10 x 8 [254 x 203]	70 [1778]	68 [1727]	30 [762]	46 [1168]	24 [610]	15 [381]	48 [1219]	10 [254]	18 [457]	36 1/2 [927]	15 3/4 [400]