


KBHD & KBVD Standard Flat Filter Rack


DIRECT DRIVE BLOWER COIL UNIT
STANDARD FLAT FILTER RACK

JOB NAME _____
ENGINEER _____
CONTRACTOR _____
TAG _____

SUBMITTAL SHEET

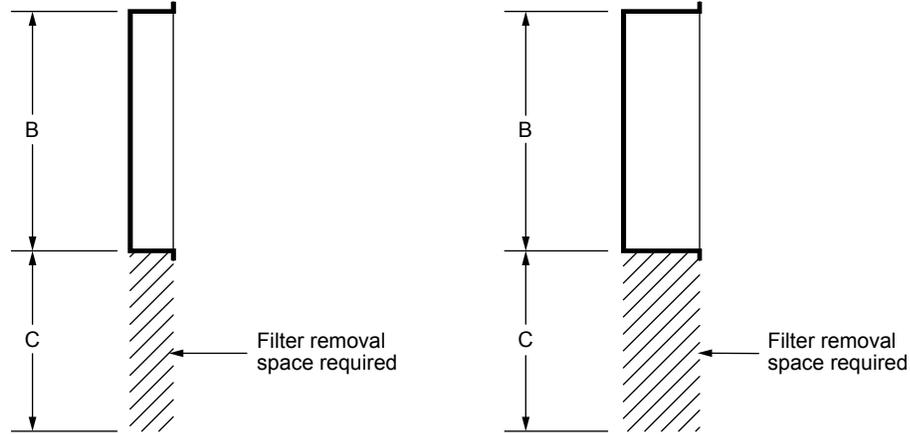

TOP VIEWS

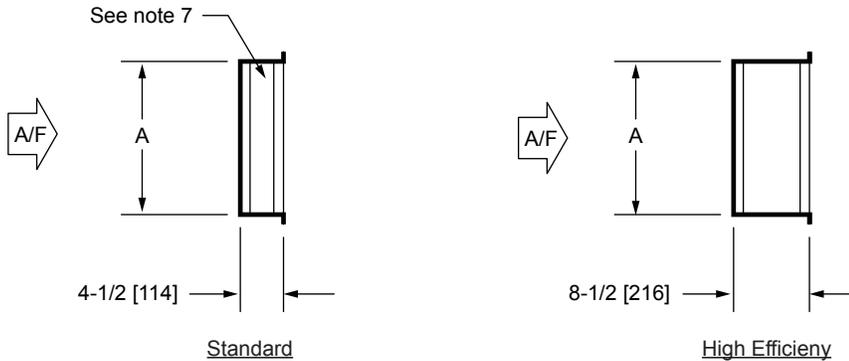

SIDE VIEWS

NOTES:

1. All dimensions are in Inches [millimeters]. All dimensions are $\pm 1/4"$ [6mm]. Metric values are soft conversion.
2. Flat filter rack may be located at unit inlet as required.
3. Standard rack will accept nominal 1" or 2" thick filters.
4. High eff. rack will accept nominal 2" and/or 4" thick filters.
5. High eff. rack not available on "HM" and "VM" units.
6. 1" duct connection space provided on entering side of rack for connection of field ductwork.
7. Hinged cover provided on both sides of externally mounted filter racks. Internal standard filter racks have pivoting bar type filter retainer.
8. See individual unit submittal drawings for location of filter rack on unit.

| UNIT SIZE | A | B | C | QTY & SIZE FILTERS |
|-----------|-------------|------------------|-------------|----------------------------|
| 08 | 16 [406] | 20 [508] | 20 [508] | (1) 16 x 20 |
| 12 | 16 [406] | 25 [635] | 25 [635] | (1) 16 x 25 |
| 16 | 16 [406] | 39-1/2 [1003] | 20 [508] | (2) 16 x 20 |
| 20 | 16 [406] | 44-1/2 [1130] | 25 [635] | (1) 16 x 20 (1) 16 x 25 |
| 30 | 25 [635] | 51 [1295] | 25 [635] | (2) 16 x 25 (1) 20 x 25 |
| 40 | 25 [635] | 59 [1499] | 25 [635] | (3) 20 x 25 |