

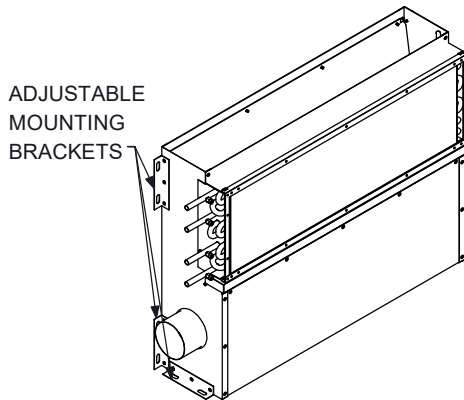


TOP VIEW

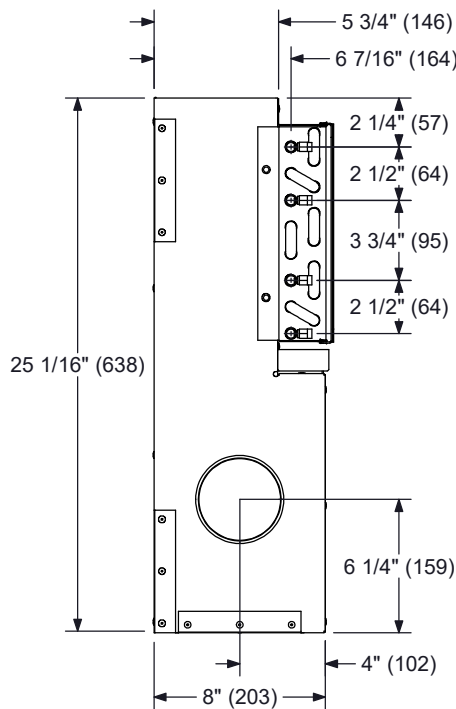

SIDE VIEW

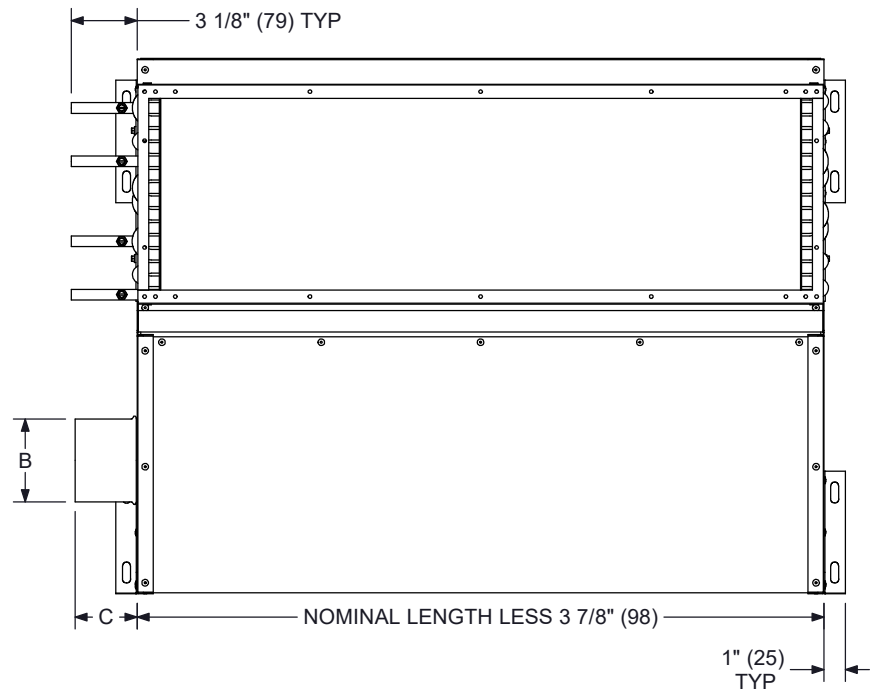

FRONT VIEW

NOMINAL INLET	B	C
4 ROUND	3 7/8 (98)	3 (76)
5 ROUND	4 7/8 (124)	3 (76)
6 OVAL	5 1/4 (133) X 6 1/4 (159)	2 1/4 (57)
8 OVAL	5 1/4 (133) X 9 3/8 (238)	2 1/4 (57)

DESCRIPTION:

- ACTIVE CHILLED BEAM FOR UNDER SILL MOUNTING.
- GALVANNEALED G90, 20 GAUGE SHEET METAL. MECHANICALLY SEALED, LEAK RESISTANT CONSTRUCTION.
- IDEAL FOR INDUCTION UNIT AND UNIT VENTILATOR RETROFIT APPLICATIONS.
- 6 ADJUSTABLE MOUNTING BRACKETS ARE PROVIDED FOR FLEXIBLE MOUNTING OF PRODUCT.
- COIL COMES STANDARD WITH AIR VENT.

DIMENSIONS ARE GIVEN AS INCHES (MM)

Revision Date: 5/15/2026

Form: CB31-BAS-00

Replaces: NEW SUBMITTAL

Product Information is Subject to Change Without Notice





KRUEGER



BAS*CHILLED BEAM - ACTIVE SILL*

JOB NAME _____
ENGINEER _____
CONTRACTOR _____
TAG _____

SUBMITTAL SHEET

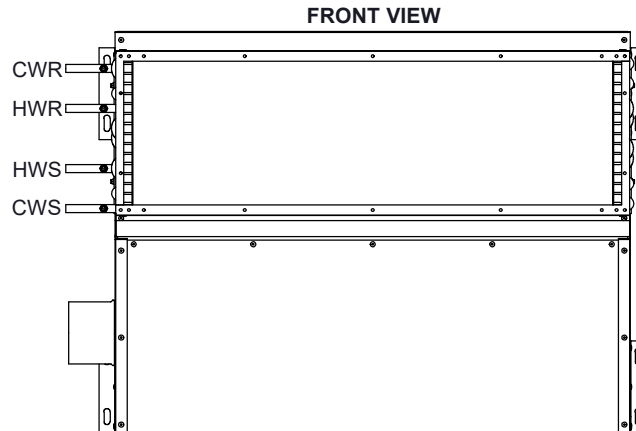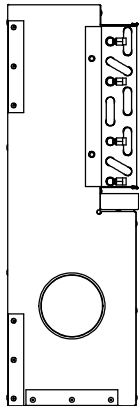

4 PIPE, LEFT HAND, LEFT INLET

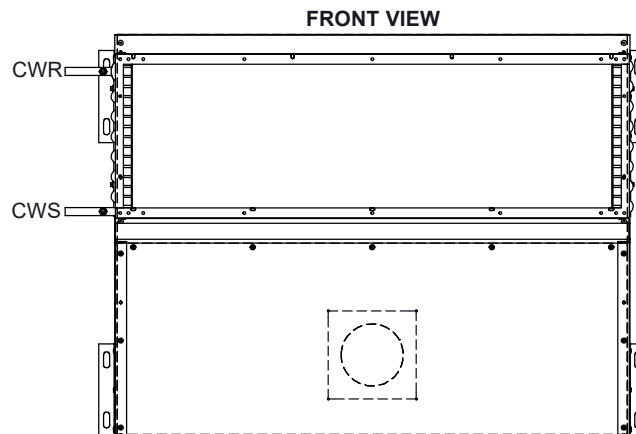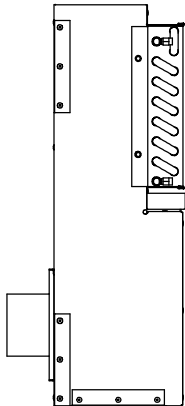

2 PIPE, LEFT HAND, REAR MIDDLE INLET

NOTE: HANDING IS DETERMINED BY COIL CONNECTION WHEN VIEWING UNIT FROM FRONT. RIGHT HAND WATER CONNECTION IS MIRROR OF LEFT HAND CONFIGURATION. UNIT DISCHARGES VERTICALLY UPWARD INTO THE SPACE.

CONFIGURATION OPTIONS:

LENGTH:

- ☐ 3 - 3 FT
- ☐ 4 - 4 FT
- ☐ 5 - 5 FT
- ☐ 6 - 6 FT

NOZZLE CONFIGURATION:

- ☐ M13
- ☐ M17
- ☐ M23
- ☐ M31

COIL TYPE:

- ☐ 2P1C - 2 PIPE COIL - 1 CIRCUIT
- ☐ 2P2C - 2 PIPE COIL - 2 CIRCUIT
- ☐ 4P1C - 4 PIPE COIL - 1 CIRCUIT
- ☐ 4P2C - 4 PIPE COIL - 2 CIRCUIT

COIL ACCESSORY:

- ☐ D - COIL DRAIN

WATER CONNECTION:

- ☐ L - LEFT HANDING
- ☐ R - RIGHT HANDING

PIPING CONNECTION:

- ☐ SWT - 1/2" SWEAT (STANDARD)
- ☐ MPT - 1/2" MALE PIPE THREAD

INLET LOCATION:

- ☐ LH - LEFT HAND
- ☐ RH - RIGHT HAND
- ☐ RM - REAR MIDDLE

INLET SIZE:

- ☐ 4 - 4" ROUND
- ☐ 5 - 5" ROUND
- ☐ 6 - 6" OVAL
- ☐ 8 - 8" OVAL

ACCESSORIES:

- ☐ I - INTERNAL CLOSED CELL INSULATION
- ☐ BHK - BEAM HOSE KIT (REQUIRES MPT)*
- ☐ BFR - BEAM FLOW REGULATOR*

*ORDERED SEPARATELY. SEE CB71-ACC-00.

DIMENSIONS ARE GIVEN AS INCHES (MM)

Revision Date: 5/15/2026

Form: CB31-BAS-00

Replaces: NEW SUBMITTAL

Product Information is Subject to Change Without Notice