




BAR

CHILLED BEAM - ACTIVE RECESSED VERTICAL COIL

JOB NAME _____
ENGINEER _____
CONTRACTOR _____
TAG _____

SUBMITTAL SHEET

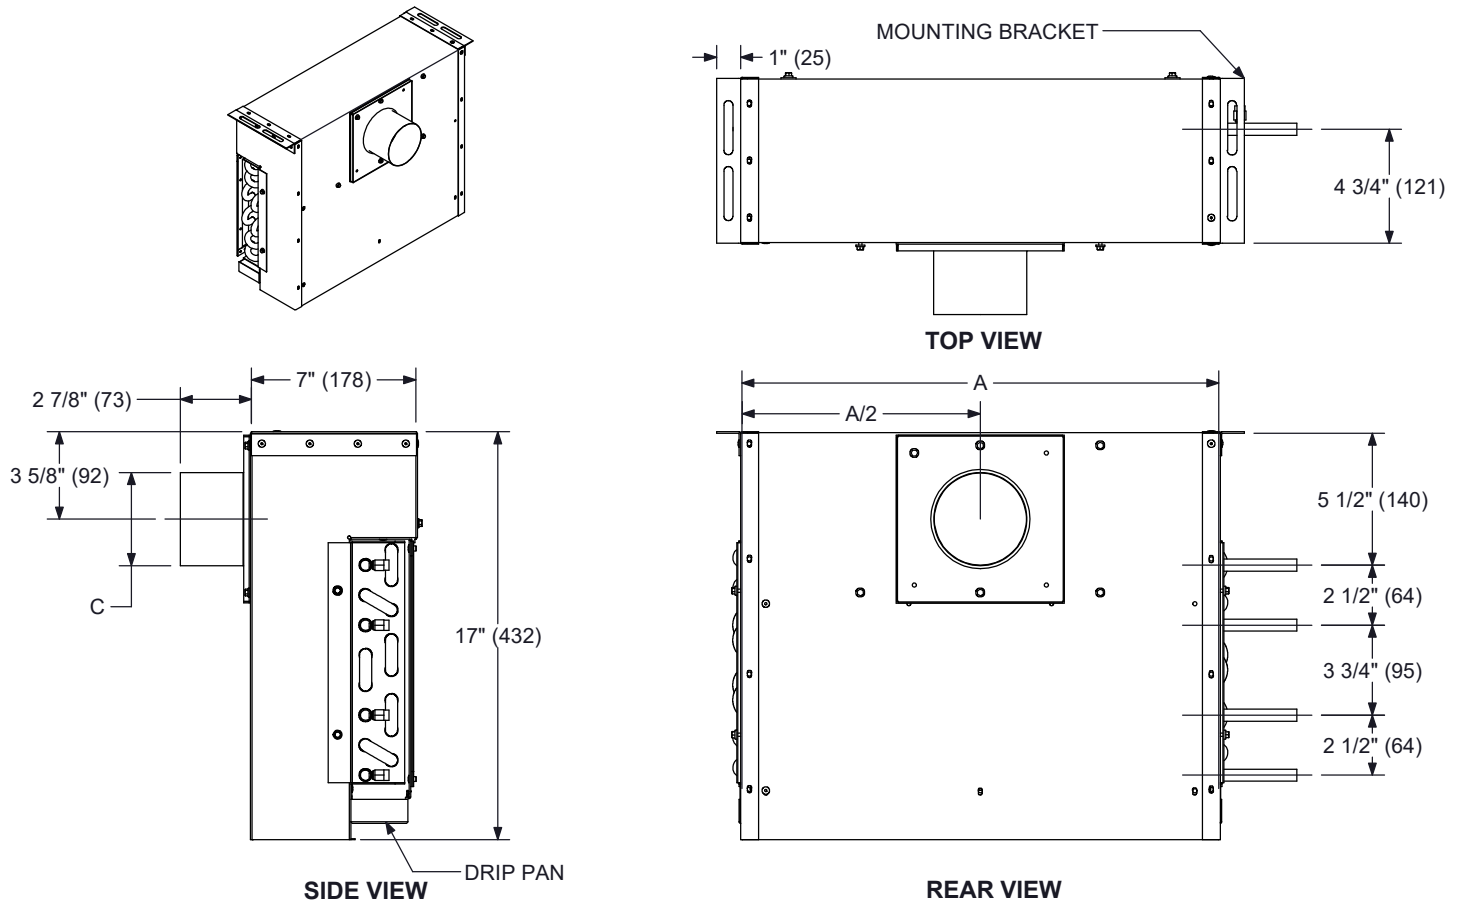

NOMINAL UNIT LENGTH	A
2 FT	20 (508)
3 FT	32 (813)
4 FT	44 (1118)
6 FT	68 (1727)
8 FT	92 (2337)

NOMINAL INLET	C
4 ROUND	3 7/8 (98)
5 ROUND	4 7/8 (124)
6 OVAL	5 1/4 (133) X 6 1/4 (159)
8 OVAL	6 1/4 (159) X 9 3/8 (238)

DESCRIPTION:

- ACTIVE CHILLED BEAM FOR RECESSED INSTALLATIONS ABOVE THE FINISHED CEILING.
- GALVANNEALED G90, 20 GAUGE SHEET METAL. MECHANICALLY SEALED, LEAK RESISTANT CONSTRUCTION.
- CONDENSATE DRIP PAN INCLUDED.
- MOUNTING BRACKETS ARE PROVIDED FOR FLEXIBLE MOUNTING OF PRODUCT.
- INTEGRATED 1/4" PRESSURE PORT FOR BALANCING/COMMISSIONING ACCESSIBLE FROM ROOM SIDE OPPOSITE COIL CONNECTION.
- COIL COMES STANDARD WITH AIR VENT.
- OPTIONAL 11-3/4" (298) WIDE KRUEGER MODEL 1700 GRILLES COME STANDARD WHITE WITH NO SCREW HOLES, NOMINAL LENGTH DETERMINED BY BEAM LENGTH.

DIMENSIONS ARE GIVEN AS INCHES (MM)

Revision Date: 5/15/2026

Form: CB41-BAR-00

Replaces: NEW SUBMITTAL

Product Information is Subject to Change Without Notice




KRUEGER

BAR

CHILLED BEAM - ACTIVE RECESSED VERTICAL COIL

JOB NAME _____
ENGINEER _____
CONTRACTOR _____
TAG _____

SUBMITTAL SHEET

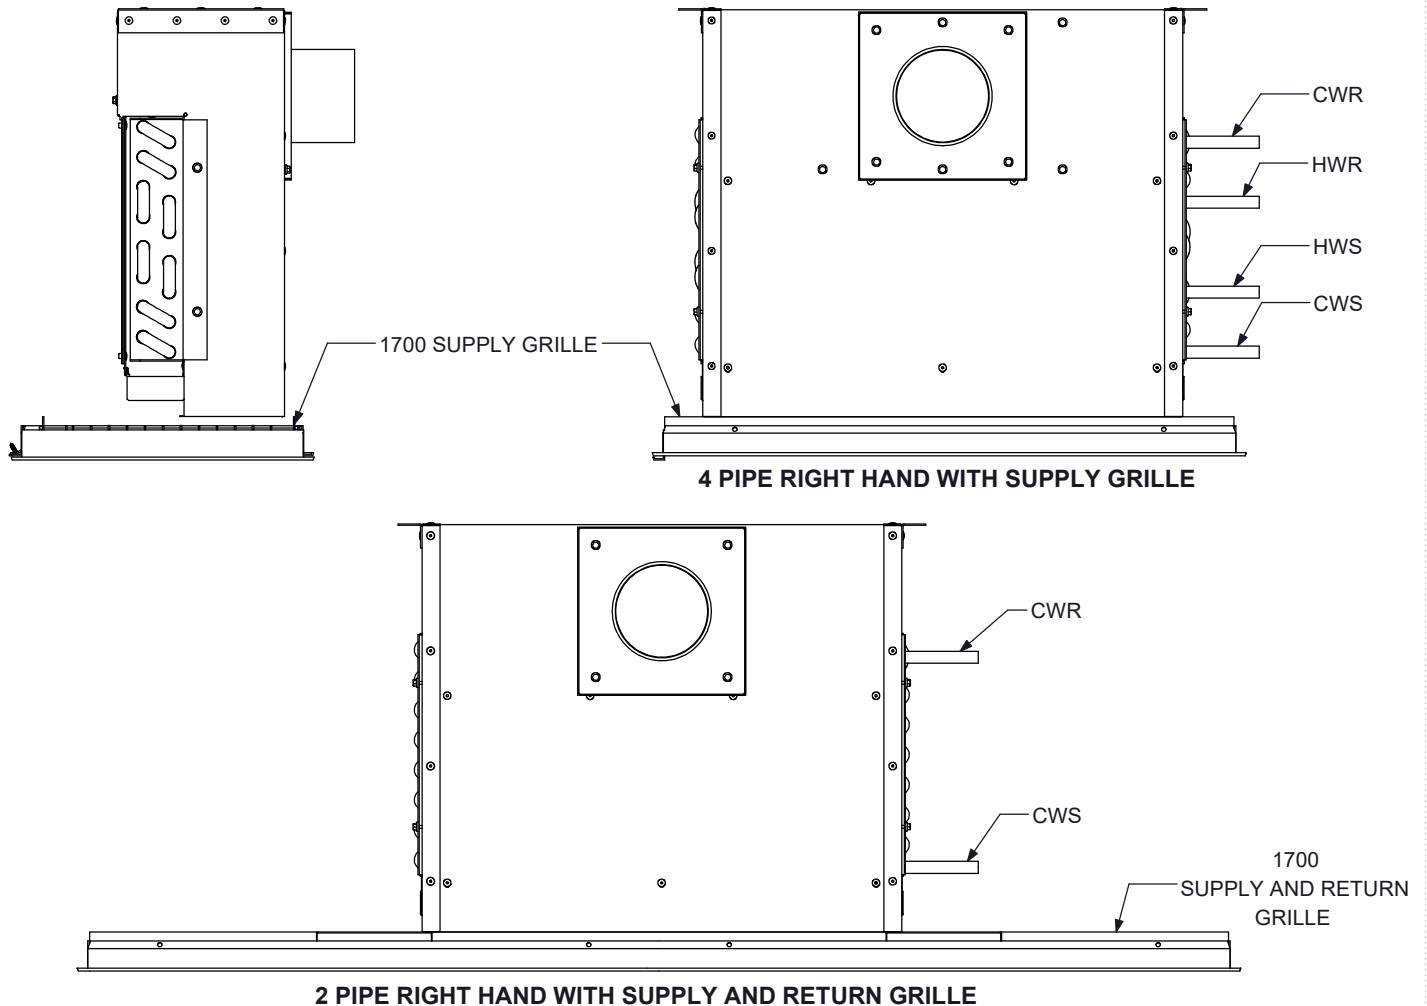

CONFIGURATION OPTIONS:

LENGTH:

- ☐ 2 - 2 FT
- ☐ 3 - 3 FT
- ☐ 4 - 4 FT
- ☐ 6 - 6 FT
- ☐ 8 - 8 FT

NOZZLE CONFIGURATION:

- ☐ M13
- ☐ M17
- ☐ M23
- ☐ M31

OPTIONAL GRILLE TYPE:

- ☐ 0 - NONE
- ☐ S - SUPPLY GRILLE (1700, BEAM LENGTH)
- ☐ R - SUPPLY AND RETURN GRILLE (1700, DOUBLE BEAM LENGTH)

COIL TYPE:

- ☐ 2P1C - 2 PIPE COIL - 1 CIRCUIT
- ☐ 2P2C - 2 PIPE COIL - 2 CIRCUIT
- ☐ 4P1C - 4 PIPE COIL - 1 CIRCUIT
- ☐ 4P2C - 4 PIPE COIL - 2 CIRCUIT

COIL ACCESSORY:

- ☐ D - COIL DRAIN

WATER CONNECTION:

- ☐ L - LEFT HAND
- ☐ R - RIGHT HAND

PIPING CONNECTION:

- ☐ SWT - 1/2" SWEAT (STANDARD)
- ☐ MPT - 1/2" MALE PIPE THREAD

INLET SIZE:

- ☐ 4 - 4" ROUND
- ☐ 5 - 5" ROUND
- ☐ 6 - 6" OVAL
- ☐ 8 - 8" OVAL

ACCESSORIES:

- ☐ I - INTERNAL CLOSED CELL INSULATION
- ☐ BHK - BEAM HOSE KIT (REQUIRES MPT)*
- ☐ BFR - BEAM FLOW REGULATOR*

*ORDERED SEPARATELY. SEE CB71-ACC-00.

DIMENSIONS ARE GIVEN AS INCHES (MM)

Revision Date: 5/15/2026

Form: CB41-BAR-00

Replaces: NEW SUBMITTAL

Product Information is Subject to Change Without Notice