


JOB NAME _____
 ARCHITECT _____
 ENGINEER _____
 CONTRACTOR _____
 LOCATION _____

SUBMITTAL SHEET
 Form Number TS0000.10 Effective Date 6/08
 Replaces Form TS0000.9



LMHS
BASIC UNIT – NO CONTROLS

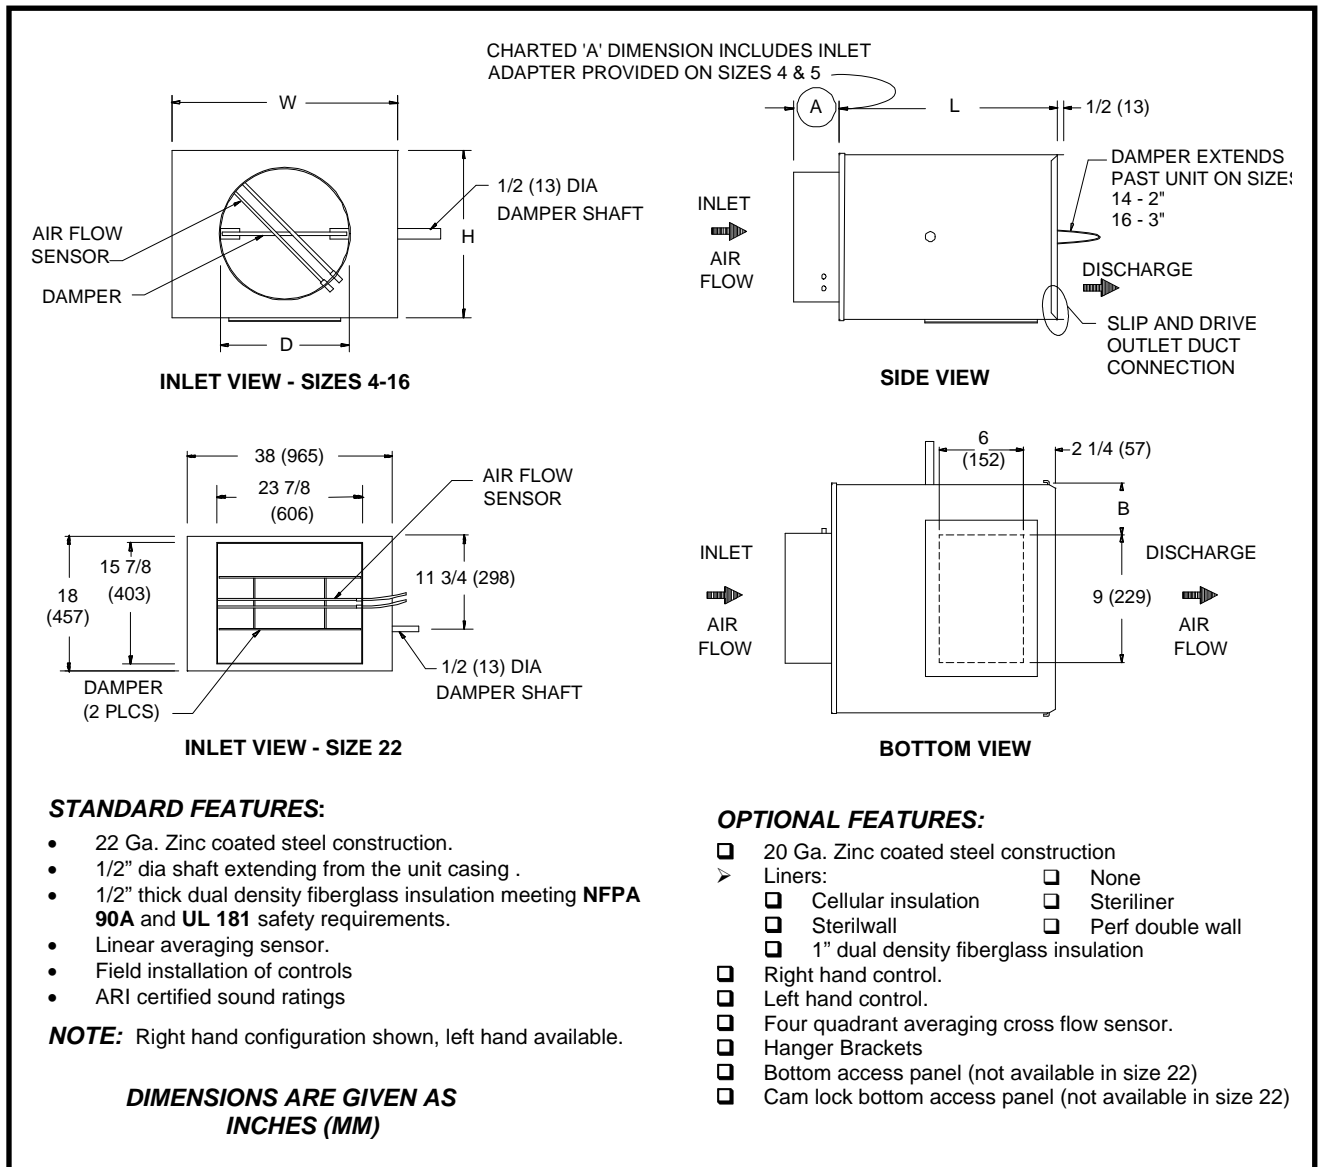

| INLET SIZE | NOM MAX CFM (L/s) | L | W | H | A | B | D |
|------------|-------------------|--------------|----------|--------------|-------------|-------------|--------------|
| 4 | 230 (109) | 15 1/2 (394) | 12 (305) | 8 (203) | 5 3/8 (136) | 1 1/2 (38) | 3 7/8 (98) |
| 5 | 360 (170) | 15 1/2 (394) | 12 (305) | 8 (203) | 5 3/8 (136) | 1 1/2 (38) | 4 7/8 (124) |
| 6 | 520 (245) | 15 1/2 (394) | 12 (305) | 8 (203) | 3 3/8 (86) | 1 1/2 (38) | 5 7/8 (149) |
| 7 | 710 (335) | 15 1/2 (394) | 12 (305) | 10 (254) | 3 3/8 (86) | 1 1/2 (38) | 6 7/8 (175) |
| 8 | 925 (437) | 15 1/2 (394) | 12 (305) | 10 (254) | 3 3/8 (86) | 1 1/2 (38) | 7 7/8 (200) |
| 9 | 1200 (566) | 15 1/2 (394) | 14 (356) | 12 1/2 (318) | 3 3/8 (86) | 2 1/2 (64) | 8 7/8 (225) |
| 10 | 1450 (685) | 15 1/2 (394) | 14 (356) | 12 1/2 (318) | 3 3/8 (86) | 2 1/2 (64) | 9 7/8 (251) |
| 12 | 2100 (991) | 15 1/2 (394) | 16 (406) | 15 (381) | 3 3/8 (86) | 3 1/2 (89) | 11 7/8 (302) |
| 14 | 2900 (1369) | 15 1/2 (394) | 20 (508) | 17 1/2 (445) | 3 3/8 (86) | 5 1/2 (140) | 13 7/8 (352) |
| 16 | 3700 (1746) | 15 1/2 (394) | 24 (610) | 18 (457) | 3 3/8 (86) | 7 1/2 (191) | 15 7/8 (403) |
| 22 | 7100 (3351) | 15 (381) | 38 (965) | 18 (457) | 4 1/4 (108) | NA | SEE ABOVE |