


SUBMITTAL SHEET

Form Number TS0021.2 Effective Date 7/04
Replaces FORM TS0021.1

JOB NAME _____
ARCHITECT _____
ENGINEER _____
CONTRACTOR _____
LOCATION _____



LMHS ATTENUATOR UNIT WITH HOT WATER HEAT – NO CONTROLS

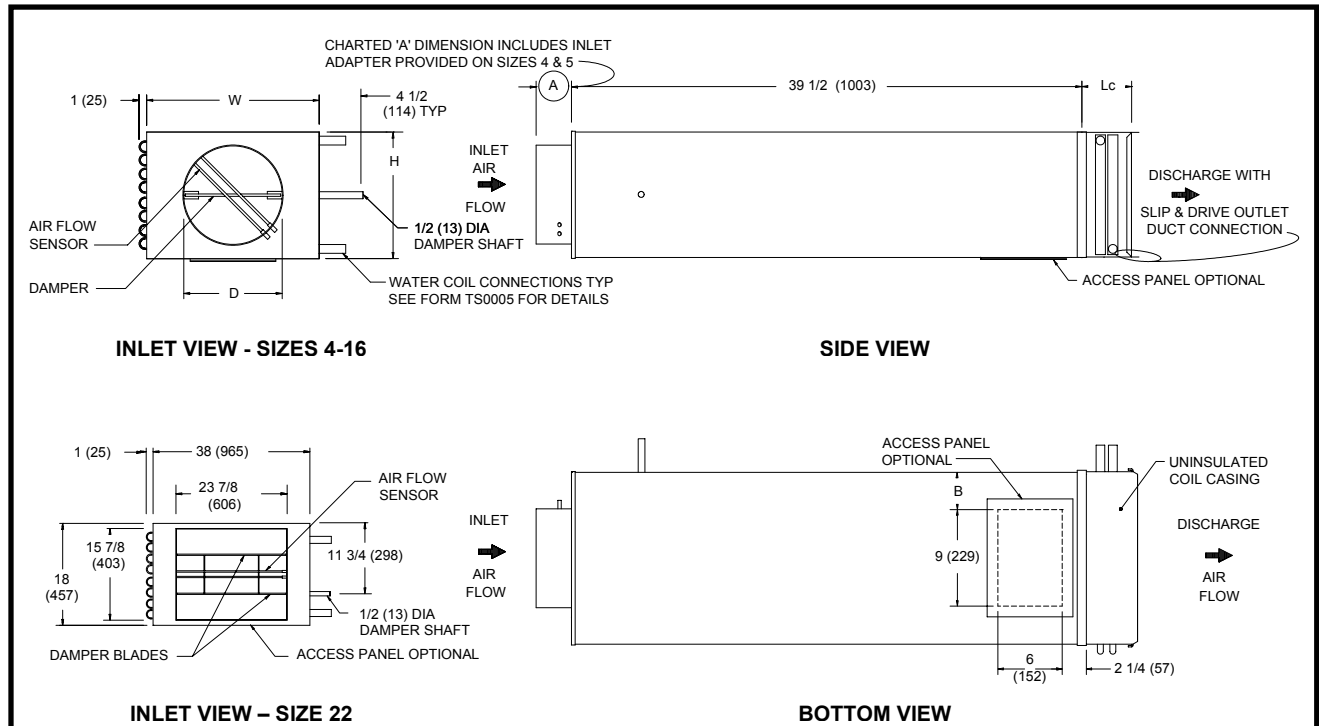

STANDARD FEATURES:

- 22 Ga. Zinc coated steel construction.
- 1/2" dia shaft extending from the unit casing .
- 1/2" thick dual density fiberglass insulation meeting **NFPA 90A** and **UL 181** safety requirements.
- Linear averaging sensor.
- Hot water coils. See form TS0005 for dimensions and specifications
- Field installation of controls

NOTE: Right hand configuration shown, left hand available.

OPTIONAL FEATURES:

- 20 Ga. Zinc coated steel construction
- Liners:
 - Cellular insulation
 - Steriliner
 - Sterilwall
 - Perf double wall
 - 1" dual density fiberglass insulation
- Four quadrant averaging cross flow sensor
- Left hand control.
- Right hand control.
- Left hand water coil connection
- Right hand water coil connection.
- Bottom access panel
- Hanger brackets.
- Cam lock bottom access panel

DIMENSIONS ARE GIVEN AS INCHES (MM)

LMHS ATTENUATOR UNIT WITH HOT WATER REHEAT

INLET SIZE	NOM MAX CFM (L/S)	W	H	A	B	D	Lc
4	230 (109)	12 (305)	8 (203)	5 3/8 (136)	1 1/2 (38)	3 7/8 (98)	SEE FORM TS0005
5	360 (170)	12 (305)	8 (203)	5 3/8 (136)	1 1/2 (38)	4 7/8 (124)	
6	520 (245)	12 (305)	8 (203)	3 3/8 (86)	1 1/2 (38)	5 7/8 (149)	
7	710 (335)	12 (305)	10 (254)	3 3/8 (86)	1 1/2 (38)	6 7/8 (175)	
8	925 (437)	12 (305)	10 (254)	3 3/8 (86)	1 1/2 (38)	7 7/8 (200)	
9	1200 (566)	14 (356)	12 1/2 (318)	3 3/8 (86)	2 1/2 (64)	8 7/8 (225)	
10	1450 (685)	14 (356)	12 1/2 (318)	3 3/8 (86)	2 1/2 (64)	9 7/8 (251)	
12	2100 (991)	16 (406)	15 (381)	3 3/8 (86)	3 1/2 (89)	11 7/8 (302)	
14	2900 (1369)	20 (508)	17 1/2 (445)	3 3/8 (86)	5 1/2 (140)	13 7/8 (352)	
16	3700 (1746)	24 (610)	18 (457)	3 3/8 (86)	7 1/2 (191)	15 7/8 (403)	
22	7100 (3351)	38 (965)	18 (457)	4 1/4 (108)	14 1/2 (368)	SEE ABOVE	