


JOB NAME \_\_\_\_\_  
 ARCHITECT \_\_\_\_\_  
 ENGINEER \_\_\_\_\_  
 CONTRACTOR \_\_\_\_\_  
 LOCATION \_\_\_\_\_

**SUBMITTALSHEET**  
 Form Number DS0300.5 Effective Date 7/14  
 Replaces Form DS0300.4



**5000 SERIES**  
**LAMINAR FLOW AIR SUPPLY DEVICE**

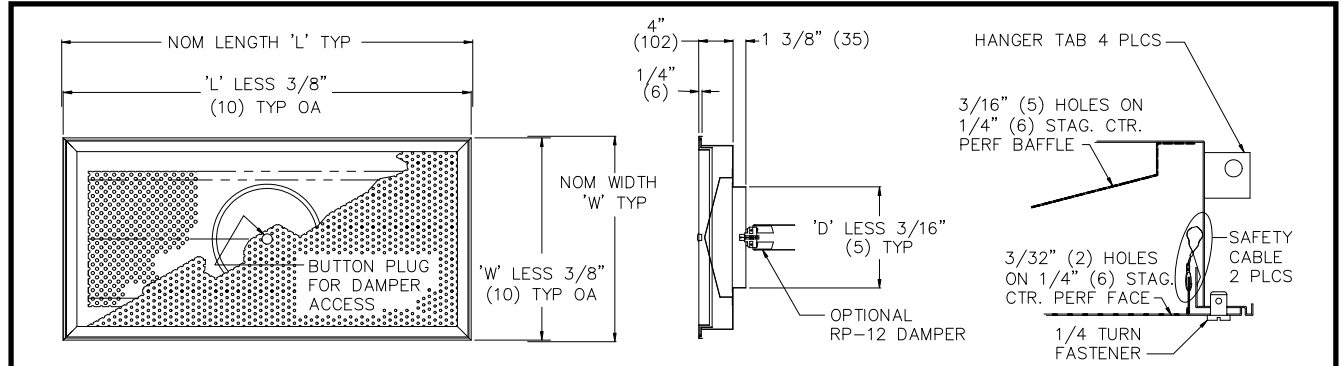

**FACE VIEW**

**SIDE VIEW**


**CONSTRUCTION DETAILS**

	NOMINAL UNIT SIZE		NOMINAL INLET SIZE	
	'W'	'L'	'D'	Q'TY
12" (305)	48" (1220) 60" (1525) 72" (1830)	6" (152) or 8" (203)	1	
			1	
			2	
24" (610)	24" (610) 36" (915) 48" (1220) 60" (1525) 72" (1830)	6" (152), 8" (203), 10" (254), or 12" (305)	1	
			1	
			2	
			2	
			1	
36" (915)	48" (1220) 60" (1525) 72" (1830)	8" (203), 10" (254), or 12" (305)	1	
			2	
			2	

**BACK PAN AND INLET DETAILS**

**NOTE :**

1. MAXIMUM RECOMMENDED INLET VELOCITY IS 650 FPM
2. STANDARD FINISH IS 44 WHITE.

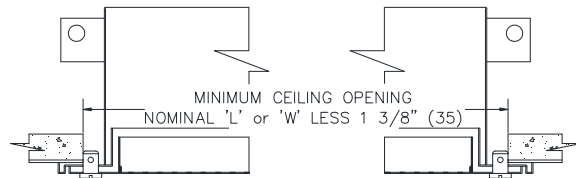

**INSTALLATION DETAIL**

CODE	CONSTRUCTION MATERIALS			
	EXPOSED FACE		BACKPAN	
	FACE	FRAME	PAN	FRAME
00	C.R.S	C.R.S.	C.R.S.	C.R.S.
01	AL	EXT. AL	C.R.S.	C.R.S.
02	STAINLESS	STAINLESS	C.R.S.	C.R.S.
03	AL	EXT. AL	AL	EXT. AL
04	STAINLESS	STAINLESS	AL	EXT. AL
05	STAINLESS	STAINLESS	STAINLESS	STAINLESS

*DIMENSIONS ARE GIVEN AS INCHES (MM)*