


JOB NAME _____
 ARCHITECT _____
 ENGINEER _____
 CONTRACTOR _____
 LOCATION _____

SUBMITTAL SHEET
 Form Number DS0350.2 Effective Date 1/14
 Replaces Form DS0350.1



5000 HF SERIES
LAMINAR FLOW AIR SUPPLY DEVICE FOR HEPA APPLICATIONS

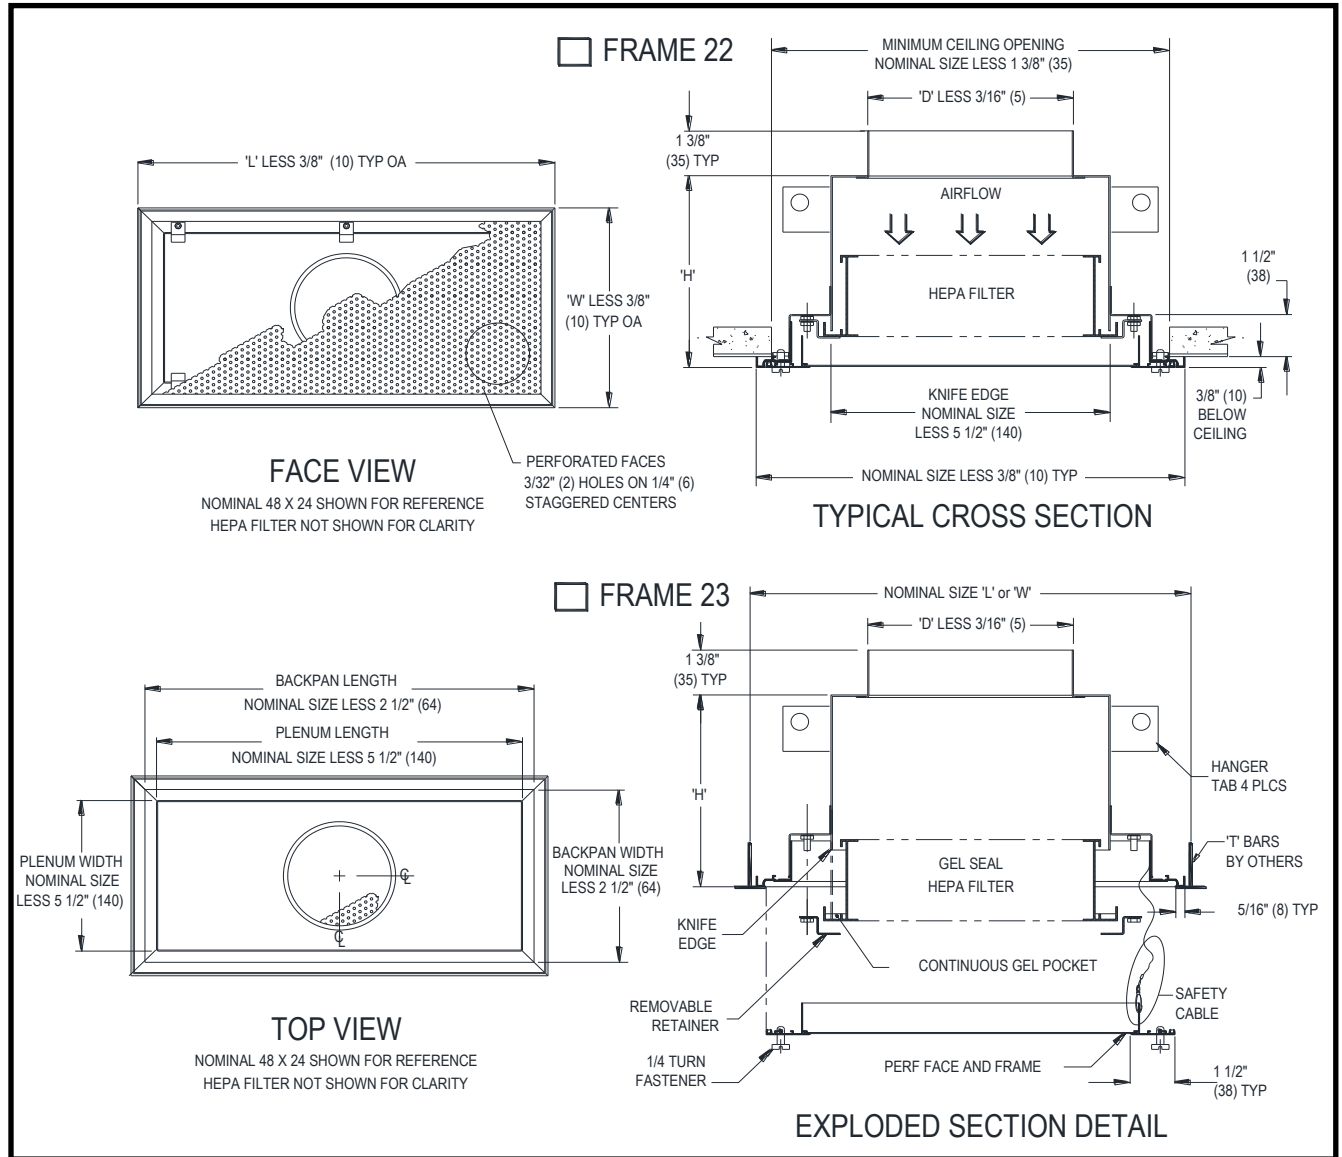

NOTE :

CONSTRUCTION MATERIAL:

- ALUMINUM
- STAINLESS STEEL

SEAMS SEALED WITH CLEAR SILICONE CAULK.
 DIMENSIONS ARE GIVEN AS INCHES (MM)

NOMINAL UNIT SIZES		NOMINAL INLET SIZES	
'L'	'W'	'D'	'H'
24" (610)	24" (610)	8" (205)	7 3/8" (187)
36" (915)	24" (610)	10" (254)	8 1/8" (206)
48" (1220)	24" (610)	12" (305)	8 7/8" (225)