


JOB NAME _____
 ARCHITECT _____
 ENGINEER _____
 CONTRACTOR _____
 LOCATION _____

SUBMITTAL SHEET
 Form Number GSS006.2 Effective Date 5/13
 REPLACES FORM: GSS006.1



9S80P
STAINLESS STEEL PERFORATED RETURN

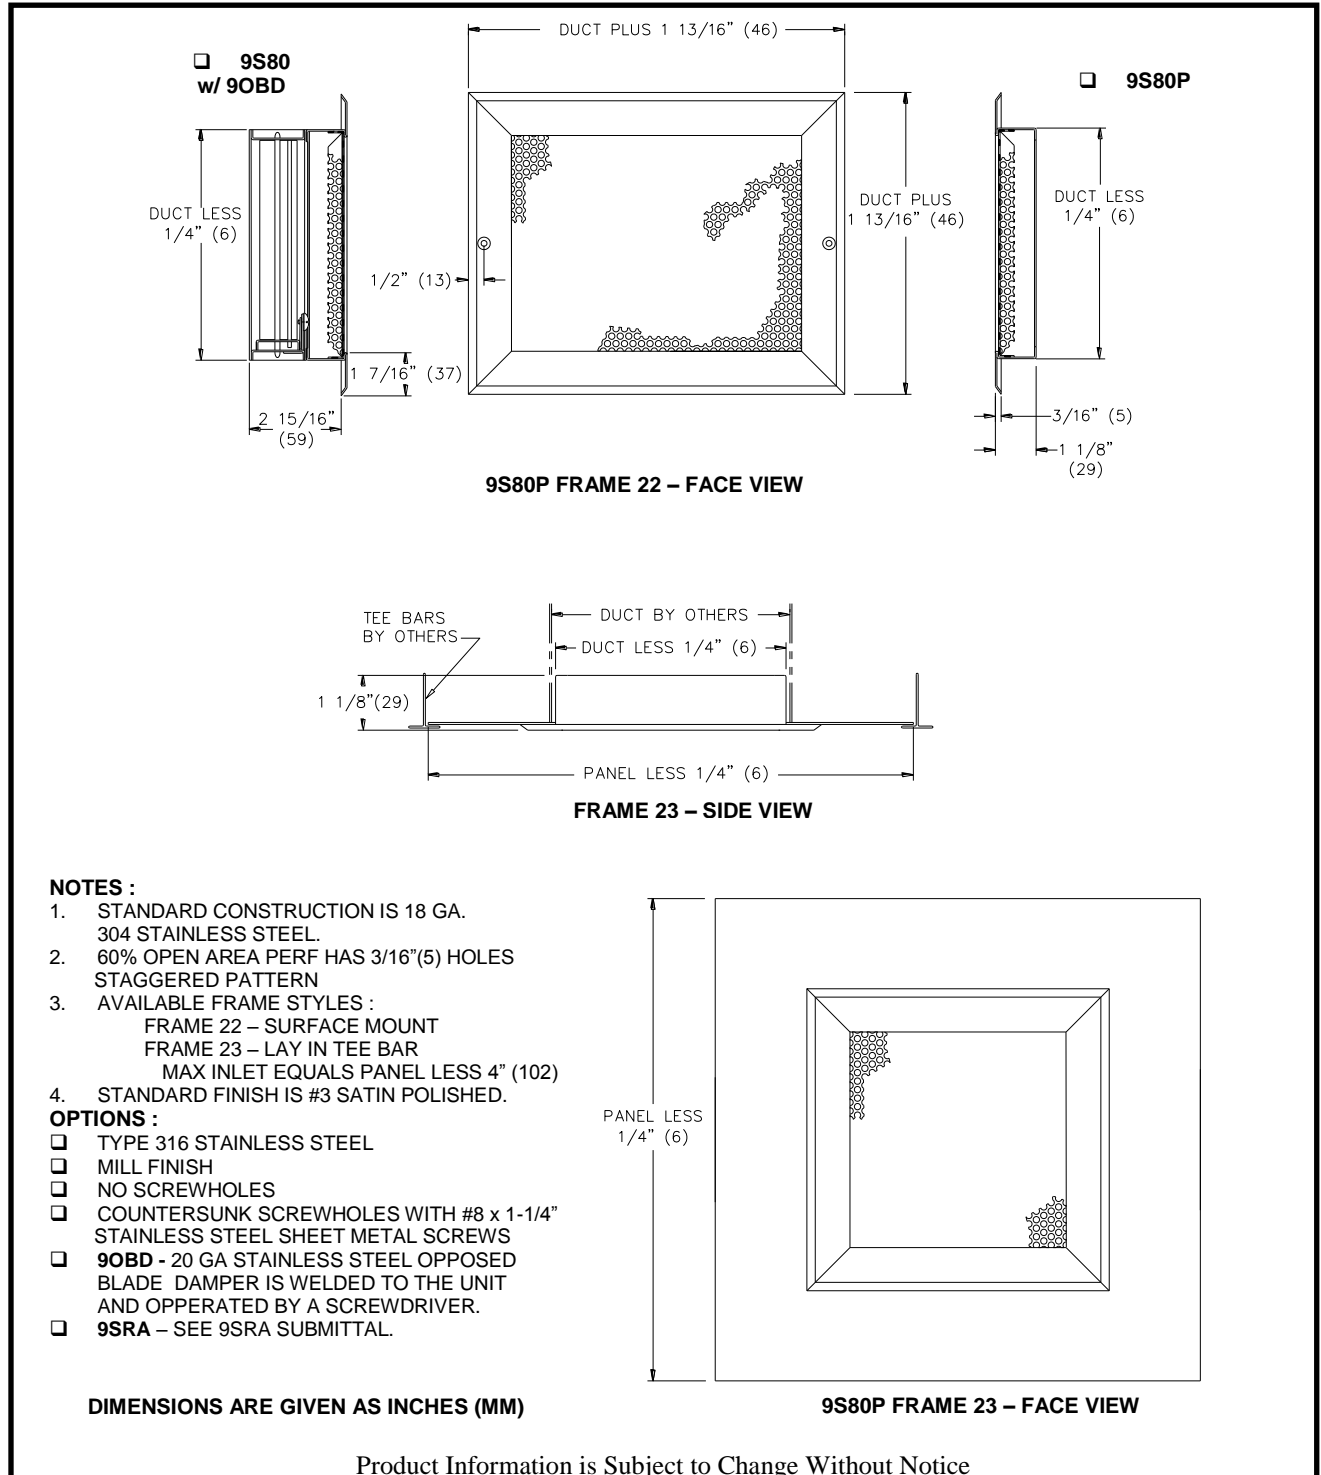

NOTES :

1. STANDARD CONSTRUCTION IS 18 GA. 304 STAINLESS STEEL.
2. 60% OPEN AREA PERF HAS 3/16"(5) HOLES STAGGERED PATTERN
3. AVAILABLE FRAME STYLES :
 FRAME 22 – SURFACE MOUNT
 FRAME 23 – LAY IN TEE BAR
 MAX INLET EQUALS PANEL LESS 4" (102)
4. STANDARD FINISH IS #3 SATIN POLISHED.

OPTIONS :

- TYPE 316 STAINLESS STEEL
- MILL FINISH
- NO SCREWHOLES
- COUNTERSUNK SCREWHOLES WITH #8 x 1-1/4" STAINLESS STEEL SHEET METAL SCREWS
- 9OBD** - 20 GA STAINLESS STEEL OPPOSED BLADE DAMPER IS WELDED TO THE UNIT AND OPERATED BY A SCREWDRIVER.
- 9SRA** – SEE 9SRA SUBMITTAL.

DIMENSIONS ARE GIVEN AS INCHES (MM)