


JOB NAME \_\_\_\_\_  
 ARCHITECT \_\_\_\_\_  
 ENGINEER \_\_\_\_\_  
 CONTRACTOR \_\_\_\_\_  
 LOCATION \_\_\_\_\_

**SUBMITTAL SHEET**  
 Form Number GSS010 Effective Date 11/99  
 NEW



**90BD**  
**STAINLESS STEEL OPPOSED BLADE DAMPER**

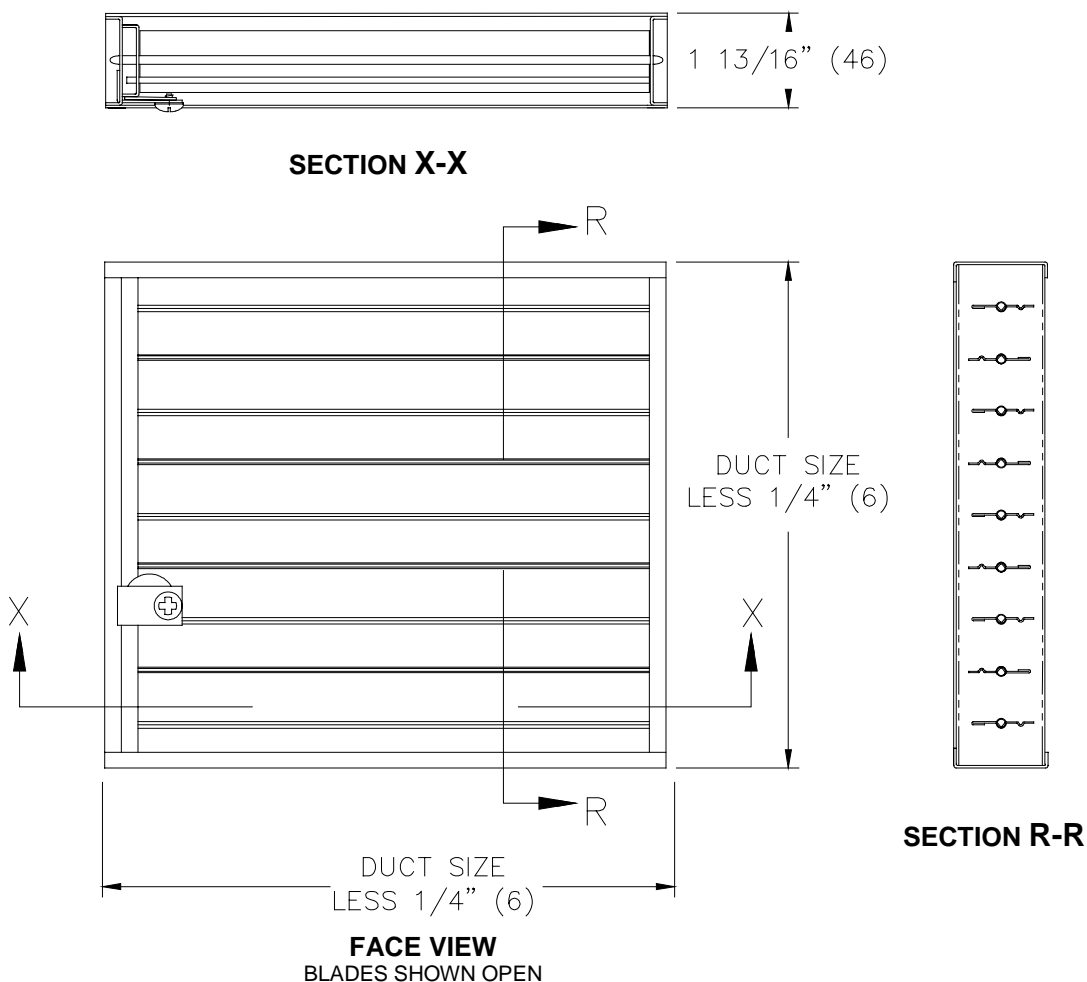

**NOTES :**


1. STANDARD CONSTRUCTION IS 20 GA. 304 STAINLESS STEEL.
2. DAMPER BLADES ARE FULLY ADJUSTABLE WITH A SCREWDRIVER.
3. FASTENING METHOD TO BE BY OTHERS.
4. MILL FINISH IS STANDARD.

**OPTIONS :**

- ☐ TYPE 316 STAINLESS STEEL, MILL FINISH

**MAXIMUMS :**

BLADE LENGTH 24" (610)  
 SINGLE UNIT 36" (914) x 24" (610)



**CLOSED BLADE DETAIL**

**DIMENSIONS ARE GIVEN AS INCHES (MM)**