


JOB NAME _____
 ARCHITECT _____
 ENGINEER _____
 CONTRACTOR _____
 LOCATION _____

SUBMITTAL SHEET
 Form Number GRS1200.3 Effective Date 09/12
 Replaces GRS1200.2



DMD – DRUM LOUVER
Curved Frame for Mounting on Spiral Duct

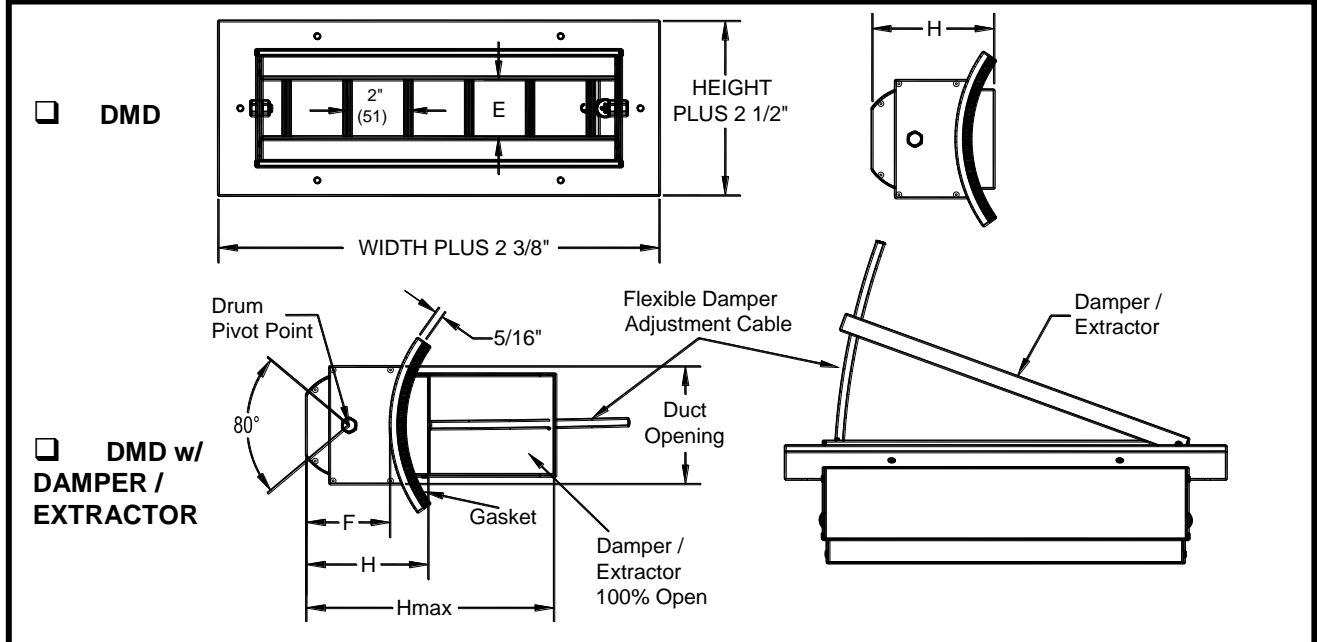

Nominal Drum Louver Size	E	F	H	Hmax	Min. Duct Diameter	Blade Qty	Screw Holes
12 x 4	2" (51)	3 1/8" (79)	4" (102)	17 1/4" (438)	8" (203)	6	6
18 x 4						9	8
24 x 4						12	10
30 x 4						15	10
36 x 4						18	12
48 x 4						24	14
60 x 4	30	16					
12 x 6	3 1/2" (89)	3 7/8" (98)	4 3/4" (121)	18" (457)	10" (254)	6	6
18 x 6						9	8
24 x 6						12	10
30 x 6						15	10
36 x 6						18	12
48 x 6						24	14
60 x 6	30	16					
12 x 8	5" (127)	4 1/2" (114)	5 1/2" (140)	18 3/4" (476)	12" (305)	6	6
18 x 8						9	8
24 x 8						12	10
30 x 8						15	10
36 x 8						18	12
48 x 8						24	14
60 x 8	30	16					
12 x 10	6 5/8" (168)	5 1/4" (133)	6 1/4" (159)	19 1/2" (495)	14" (356)	6	6
18 x 10						9	8
24 x 10						12	10
30 x 10						15	10
36 x 10						18	12
48 x 10						24	14
60 x 10	30	16					

- STANDARD FEATURES:**
1. Easy Finger Tip Adjustment.
 2. Directional Air Pattern Control
± 40° Blade Deflection
± 40° Vertical Rotation
 3. Heavy Gage Aluminum Construction.
 4. Duct diameters available in 2" increments beginning from the minimum diameter listed in table.
 5. Foam Gasket to seal unit to duct.
 6. All units include Mounting Screws.
 7. Extractor/Damper must be ordered with the unit, it cannot be field installed.
 8. Standard Finish is 70 Silver Metallic.
 9. Other finishes are available.

DIMENSIONS ARE GIVEN AS INCHES (MM)