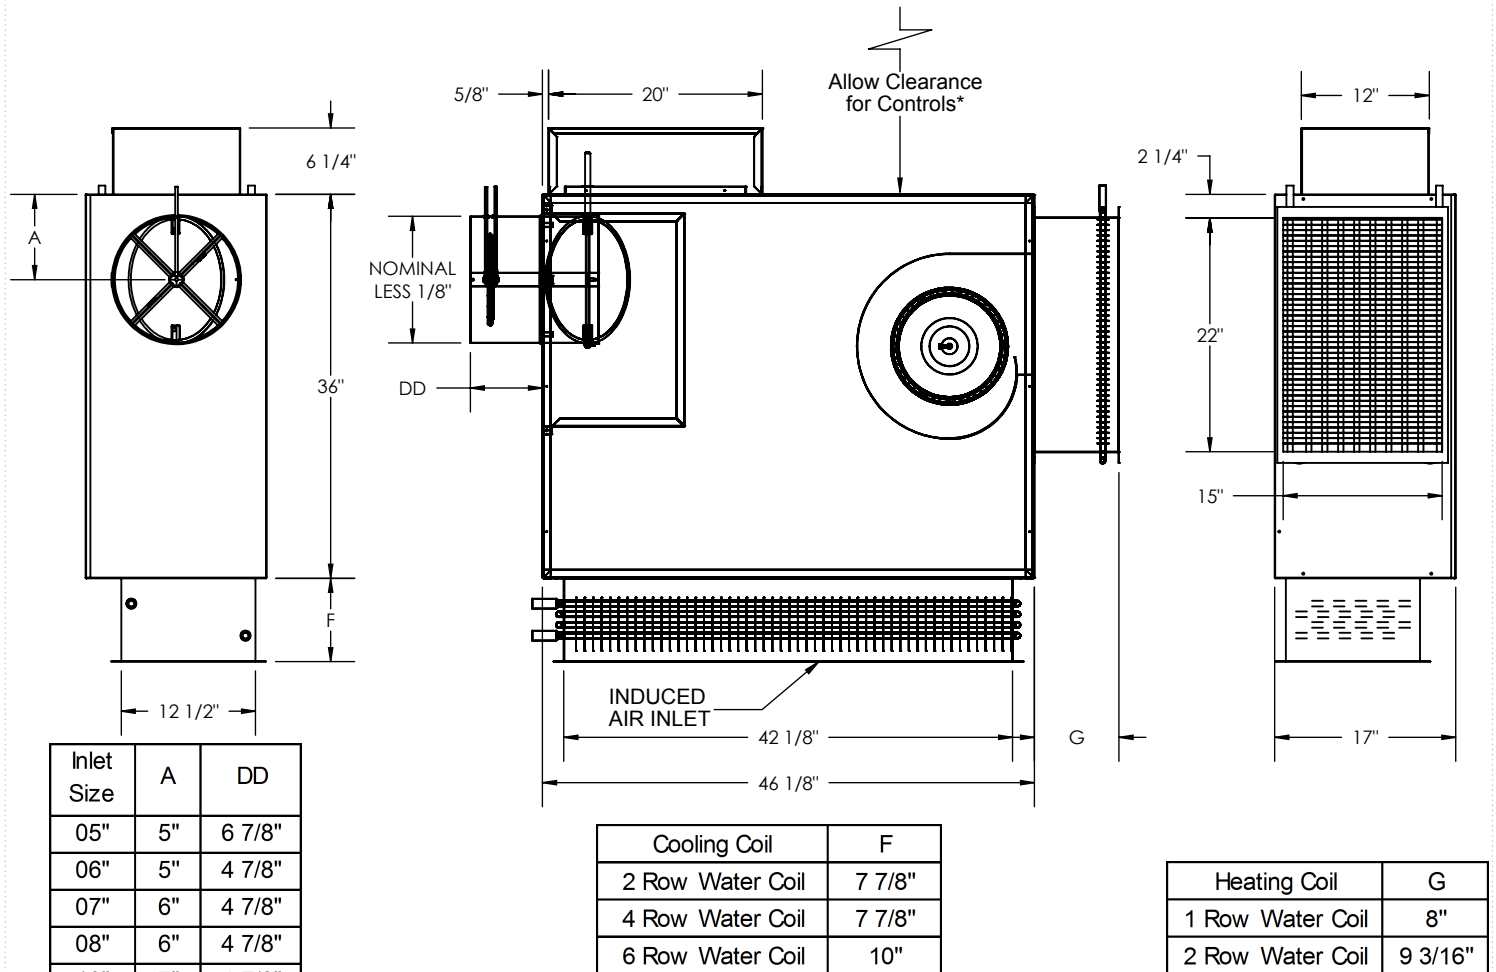


KLPS-D Unit Size 5
Hot Water Heat with Electronic Controls
SUBMITTAL SHEET

INLET VIEW
**PLAN VIEW - LEFT HAND UNIT
(Upstream Coil Connection Shown)**
DISCHARGE VIEW
STANDARD FEATURES:

- 20GA. Galvanized Steel Construction
- Steel Control Enclosure for Electronic Components
- 1/2" Thick Dual Density Fiberglass Insulation Meeting NFPA 90A and UL181 Safety Requirements
- 1/2 HP ECM Motor with Permanently Lubricated Ball Bearings and Constant Airflow Program.
 - Manual Control
 - 2-10Vdc Remote Control
 - 120V
 - 208/240V
 - 0-10Vdc Remote Control
 - 277V
- Bottom Access Panel for Service
- Sensible Cooling Coil Factory Installed on Induced Air Inlet Supplied with Drip Tray **
- 4 Quadrant, Center Averaging Inlet Flow Sensor
- Factory Supplied 24 Volt Control Transformer for Electronic Controls
- ETL Listed
- Performance Data per AHRI Standard 880
- Construction Type Air Filters – 22" x 14 1/2" x 1" x 2

OPTIONAL FEATURES:

- Liners
 - 1/2" Cellular Insulation
 - 1" Cellular Insulation
 - 1" Dual Density Fiberglass Insulation
 - 13/16" Steriliner Duct Board Insulation
 - 1/2" Foil Encapsulated Fiberglass Insulation
 - 1" Foil Encapsulated Fiberglass Insulation
 - Solid Metal Liner with 1/2" Dual Density Fiberglass
 - Perforated Metal Liner with 1/2" Dual Density Fiberglass
- Heating coil connections
 - Left Hand
 - Right Hand
- Cooling coil connections
 - Upstream Side
 - Downstream Side
- Left Hand Controls
- Right Hand Controls
- Motor Toggle Disconnect Switch
- Motor Fusing
- Dust Tight Control Enclosure
- Hanger Brackets
- Linear Averaging Inlet Flow Sensor
- MERV 8 Air Filters – 22" x 14 1/2" x 1" x 2
- Dual Access Panels for Service
 - Cam-Locks (Dual Access Panel Only)

*Check NEC for Unit Clearance Requirements

** See Submittal Form TUS03-135-000CP

Revision Date: 09/20
Form: TUS03-500-WHDNA-5
Replaces: TUS03-500-WHDNA-4
Product Information is Subject to Change Without Notice