

**AHRI CERTIFIED PERFORMANCE DATA | SERIES UNITS**

KFSS*																								
UNIT SIZE	INLET SIZE	PRIMARY CFM	MIN INLET Ps	FAN		DISCHARGE DATA							RADIATED DATA											
						FAN ONLY SOUND POWER, Lw							FAN ONLY SOUND POWER, Lw							FAN + PRIMARY @ 1.5" INLET Ps				
				CFM	Watts	2	3	4	5	6	7	2	3	4	5	6	7	2	3	4	5	6	7	
3	8"	700	0.28	700	240	68	64	63	64	60	56	64	60	56	52	46	42	68	64	58	53	50	47	
4	10"	1100	0.19	1100	300	65	65	61	61	58	53	65	61	55	51	46	40	69	66	57	52	50	48	
5	10"	1100	0.31	1100	250	63	60	57	57	54	49	61	57	53	49	43	37	70	66	59	53	51	51	
6	12"	1600	0.35	1600	480	67	66	62	64	61	57	69	66	58	55	51	48	70	67	59	54	52	52	
7	16"	2800	0.25	2800	660	80	75	72	72	70	69	74	69	62	59	53	49	75	71	66	60	56	54	

QFC																								
UNIT SIZE	INLET SIZE	PRIMARY CFM	MIN. Ps	FAN		DISCHARGE DATA							RADIATED DATA											
						FAN ONLY SOUND POWER, Lw							FAN ONLY SOUND POWER, Lw							FAN + PRIMARY @ 1.5" INLET Ps				
				CFM	Watts	2	3	4	5	6	7	2	3	4	5	6	7	2	3	4	5	6	7	
2	6	400	0.100	450	200	65	65	66	62	58	57	65	64	57	54	46	42	70	71	65	57	52	49	
3	8	700	0.100	850	380	67	68	68	67	65	66	69	67	61	57	50	48	74	75	67	61	55	52	
4	10	1100	0.100	1350	555	67	67	70	68	65	61	69	67	61	57	53	49	75	73	67	61	56	53	
5	12	1600	0.100	2050	950	74	74	73	75	73	73	75	70	66	62	57	57	79	76	69	64	60	57	
6	14	2100	0.100	2400	1150	76	74	76	76	74	73	72	69	66	65	63	61	78	77	70	67	65	61	
7	16	2800	0.100	3600	2750	79	78	76	76	72	72	78	75	70	67	63	62	83	79	74	70	66	64	

KLPS																								
UNIT SIZE	INLET SIZE	PRIMARY CFM	MIN. Ps	FAN		DISCHARGE DATA							RADIATED DATA											
						FAN ONLY SOUND POWER, Lw							FAN ONLY SOUND POWER, Lw							FAN + PRIMARY @ 1.5" INLET Ps				
				CFM	Watts	2	3	4	5	6	7	2	3	4	5	6	7	2	3	4	5	6	7	
1	6	400	0.100	400	70	71	67	67	64	61	58	62	56	53	49	43	39	66	63	62	56	51	47	
2	8	700	0.100	700	150	79	76	76	75	74	73	70	64	60	57	51	48	75	73	70	64	59	55	
3	8	700	0.100	1000	460	78	69	67	67	65	63	69	60	58	56	51	44	69	62	60	56	51	46	
4	8x14	1400	0.100	1500	665	81	64	63	61	62	60	73	65	62	60	53	44	77	74	69	66	58	52	
5	12	1600	0.100	1700	680	78	73	72	73	70	69	68	60	57	53	48	42	68	65	61	56	55	58	

NOTES: All sound data is based on tests conducted in accordance with AHRI 880-11. Sound power levels are in dB, re 10<sup>-12</sup> Watts. Discharge sound power is the sound emitted from the unit discharge. Discharge sound power has been corrected for end reflection. Radiated sound power is the sound transmitted through the casing walls. 1/2" dual density liner shown\*. See Krueger's selection program for specific sound data for optional liners. See Krueger's Terminal Unit Engineering section for reductions and definitions.



\* KFSS data is shown using an EC motor and 1" dual density insulation.

## INTRODUCTION

The QF fan-powered induction terminal units are designed to maintain optimum temperatures in the conditioned zone through economical recirculation of plenum return air and accurate control of primary air (cooling) to the zone. The QF fan terminal units offer excellent performance characteristics and affordability in a compact unit with optimum physical dimensions.

The Model QFC series fan powered terminal unit is designed to sustain optimum occupant comfort levels by maintaining a constant supply of air to the conditioned zone.

The QFC recirculation fan draws cold air from the primary air duct and warm air from the return plenum in varying amounts to satisfy zone temperature requirements. Warm air and cold air blend in the unit fan before entering the discharge plenum. Optional heating coils may be used for additional terminal heating requirements.


Primary air is modulated with direct digital, analog, or pneumatic pressure independent type controls.

## MODEL

QFC - Series Fan Powered Terminal Unit

## FEATURES

- Compact unit casing dimensions accommodate installation in reduced ceiling plenum spaces
- Airflow capacities range up to 3660 CFM for the QFC products to allow flow control for commercial applications
- 22 Gage galvanized steel case construction with an optional 20 gage galvanized steel case for unit strength and product durability
- Several types of casing liner options provide quiet and clean operation
- Round inlet sizes ranging from 6" through 16" diameter are slightly undersized to fit standard spiral and flex duct for quick installation
- Each unit size offers multiple primary inlet sizes to allow for flexible system design
- Fully removable bottom access panel is included with each unit for easy access to all internal components for maintenance
- Optional induced air attenuator for reduced radiated sound
- Control enclosure located on left-hand or right-hand side for easier installation
- Single point electrical connection minimizes number of ceiling plenum electrical connections
- Recirculation multi-voltage fan motors are quiet, reliable, and permanently lubricated; ECM motors are available on model QFC
- Electronic speed control (SCR) allows field adjustable fan airflow
- Isolated motor/blower assembly limits casing acoustical transmission
- ETL listings are under UL 60335 electrical safety
- AHRI listings are certified in accordance with AHRI standard 880 testing standard
- External filter option allows quick and easy access for routine replacement
- Auxiliary heat offers wide range of options, including electric and hot water heat
- Pneumatic, analog, and digital controls may be customized for many building systems; BACnet/BMS compatible digital controls can be provided by Krueger
- LineaHeat solid state electronic proportional control of electric heat is available with or without leaving air temperature control
- AC solid state relays offer silent operation for staged electric heat
- Revit models are available at [www.krueger-hvac.com/revit](http://www.krueger-hvac.com/revit)

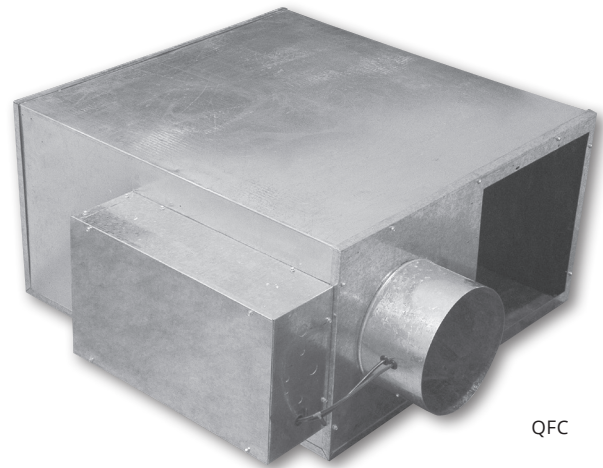

QFC

## PRODUCT DESCRIPTION

### CASING

- All QFC casing panels are constructed of 22 gage galvanized steel with a 20 gage option.
- Removable bottom panel allows easy access to all internal components.

### INLET COLLARS

- All round 20 gage inlet collars accommodate standard spiral and flex duct sizes.
- The primary air inlet is located on the left hand side of the unit inlet panel of QFC unit sizes 2 - 6. The primary air inlet is located in the center of the QFC, unit size 7. (Hand is determined by looking at the unit in the direction of airflow with the unit in the installed position.)

### OUTLET CONNECTIONS

- All outlet connections are rectangular and require a flanged duct connection.

### DAMPER ASSEMBLY

- All units utilize a round volume control damper with a solid shaft that rotates in self lubricating Delrin® bearings.
- Damper blade incorporates a flexible gasket for tight airflow shutoff and operates over a full 90 degree rotation.
- The damper position is marked by an arrow embossment on the end of the damper shaft.

### INDUCED AIR INLET ATTENUATOR

- A lined sound attenuator, which reduces radiated sound, is available.
- See Krueger's selection software for adjusted radiated sound data.

### INDUCED AIR INLET FILTER

- Induced air inlet filters (construction type or MERV 8) are available. These filters are typically used for job start-up and are provided with clip frames for easy filter replacement.

### CASING LINERS

All liners are attached to the unit casing with both adhesive and weld pins to ensure long term durability. The standard liner option is 1/2" thick, 1 1/2 lb. dual density fiberglass insulation that meets UL 181 and NFPA 90A.

- **(Optional)** 1" Thick Insulation: 1" thick, 1 1/2 lb. dual density fiberglass insulation that meets UL 181 and NFPA 90A.
- **(Optional)** Cellular Insulation: 1/2" or 1" thick, 1 1/2 lb. density, smooth surface, polyolefin, closed-cell foam insulation for fiber free applications. Cellular insulation meets UL 181 and NFPA 90A and does not support mold or bacteria growth.
- **(Optional)** Foil Encapsulated Insulation: Foil reinforced, wrapped edges, 1/2" or 1" thick, 1 1/2 lb. density fiberglass insulation that meets UL 181 and NFPA 90A.

### AIRFLOW SENSOR

- All units are equipped with a factory installed inlet airflow sensor device.
- K4 LineaCross: A four-quadrant, multi-point, center averaging airflow sensor.
- **(Optional)** A linear, multi-point, velocity averaging airflow sensor with an amplified signal.
- Balancing taps are provided for easy airflow verification.

### FAN MOTORS

- Fan motors are multi-voltage [120,208/240 or 277V, Single- Phase] permanent split capacitor (PSC) type.
- **(Optional)** [120, 208/240 or 277 volt, 1-phase] ECM (electronically commutated motor) fan motor is available.
- Units equipped with [120, 208/240 or 277 volt, 1-phase] electric heat have fan motors wired with the same line voltage. Units with [208 volt, 3-phase, 3-wire] electric heat utilize 208/240 volt fan motors. Units with [480 volt, 3-phase, 4-wire] heat are equipped with 277 volt fan motors.
- Quick electrical disconnects are provided on the motor wiring.
- A motor disconnect switch is available (not available if the unit is equipped with electric heat including the door locking disconnect option).
- Motor fusing is available.

### FAN SPEED CONTROL

- All units with PSC motors are equipped with an SCR fan speed controller capable of reducing fan output by as much as 50-55%.
- All units with optional ECM motors include either a manual or remote adjustable speed controller. The manual adjustable speed controller features a digital display that alternates between the RPM of the motor and percentage of flow and can be set and adjusted in the field. The remote adjustable speed controller communicates with a DDC controller to remotely set and/or adjust the fan speed using either a 0-10 VDC or 2-10 VDC signal and provides a manual override capability to set and/or adjust the fan speed in the field.

### CONTROLS

- Pneumatic, analog or direct digital control types are available. Digital controls can be provided by others or Krueger for factory mounting. A "no control" unit with control enclosure is also available for field mounting of direct digital controls.

### HOT WATER HEAT

- One or two row coils are constructed of ten aluminum fins per inch with 5/8" O.D. sweat type connection. Left-hand or right hand, tubing connection is available. The coil tubing is water leakage tested to 400 psig.
- Access panel in the hot water unit casing is available for upstream cleaning of the coil fins.
- Vent and drain option is available.

## PRODUCT DESCRIPTION (CONTINUED)

### ELECTRIC HEAT

- Heaters are UL listed and are constructed of 20 gage galvanized steel.
- Available combinations are:
  - [120, 208/240, or 277 volt, 1-phase],
  - [208 volt, 3-phase, 3-wire],
  - [480 volt, 3-phase, 4-wire]
- See fan motor description for electric heat/fan motor combinations.
- Heaters are equipped with standard automatic reset thermal cutout, magnetic contactors, airflow proving switch, and 80/20 Ni-Cr heating elements.
- Electric heater options include fused or non-fused door interlocking disconnect switch, fuse-block, manual reset cutout, and dust tight enclosure construction.
- LineaHeat solid state electronic proportional control of electric heat is available with or without leaving air temperature control. Contact your Krueger representative or the Krueger website for additional information. See Krueger's Terminal Unit Engineering section for additional information.
- AC solid state relays offer silent operation for staged electric heat.

### CONTROL TRANSFORMERS

- Units with and without electric heat include a factory supplied, mounted and wired, control transformer mounted inside the electric heat enclosure for electronic control applications.


### LABELS

- Label information adhered to each unit includes model name, unit size, configuration code, airflow (CFM), balancing chart, tagging data, electrical ratings, removal of fan protection packing material information, and all required agency listings.

### PACKAGING

- Units are palletized. Each pallet of units is banded and stretch wrapped with cellophane.

## EXPLODED VIEW

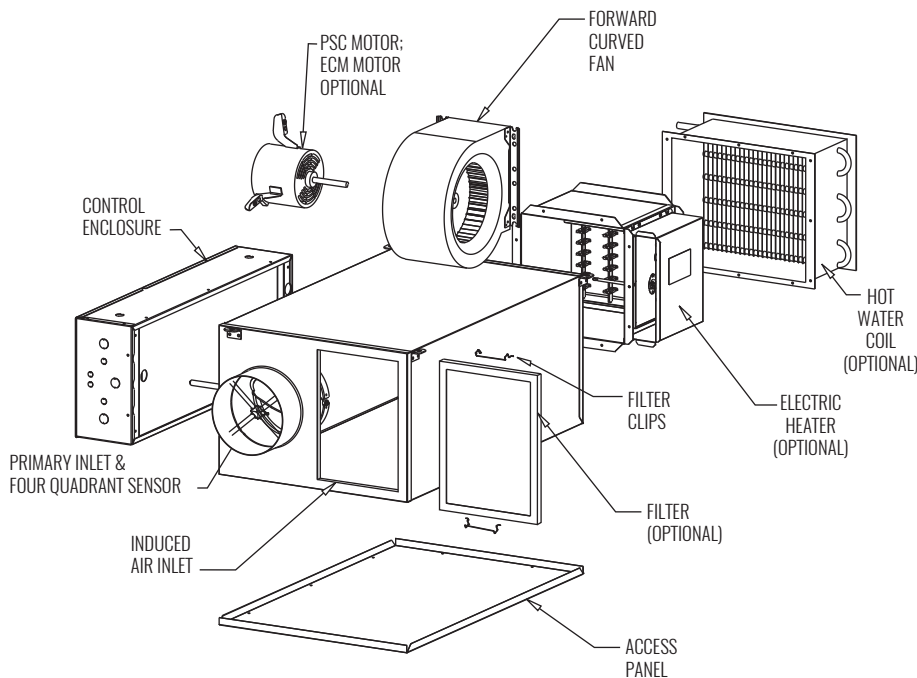

## UNIT CAPACITIES

UNIT SIZE	INLET SIZE	QFC UNIT						QFC WITH ATTENUATOR						
		PRIMARY AIRFLOW		FAN AIRFLOW		MOTOR HP	MOTOR TYPE	MOTOR FLA			PRIMARY AIRFLOW		FAN AIRFLOW	
		MAX	MIN	MAX	MIN			120V	208/240V	277V	MAX	MIN	MAX	MIN
2	6	515	90 or 0	560	100	1/10	PSC	1.5	0.75	0.65	480	90 or 0	480	100
3	6	515	90 or 0	990	300	1/4		3.3	1.5	1.27	515	90 or 0	890	300
	8	920	160 or 0					890	160 or 0					
4	8	920	160 or 0	1440	550	1/4		3.3	1.5	1.27	920	160 or 0	1400	580
	10	1430	250 or 0								1400	250 or 0		
	12	1440	360 or 0								1400	360 or 0		
5	10	1430	250 or 0	2140	1100	1/2		6.4	3.2	2.6	1430	250 or 0	2050	1100
	12	2060	360 or 0								2050	360 or 0		
6	12	2060	360 or 0	2530	1200	3/4		10.5	5.1	4.2	2060	360 or 0	2500	1200
	14	2530	480 or 0								2500	480 or 0		
7	16	3660	630 or 0	3900	2100	(2) 3/4	-	10.2	8.4	3660	630 or 0	3900	2100	

UNIT SIZE	INLET SIZE	QFC UNIT						MOTOR TYPE	MOTOR FLA		
		PRIMARY AIRFLOW		FAN AIRFLOW		MOTOR HP	120V		208/240V	277V	
		MAX	MIN	MAX	MIN		120V		208/240V	277V	
3	6	515	90 or 0	1100	165	1/2	EC	7.7	4.3	4.1	
	8	920	160 or 0								
6	10	1430	250 or 0	2550	385	1		12.8	9.1	6.9	
	12	2060	360 or 0								
	14	2550	480 or 0								
7	16	3660	630 or 0	4550	685	(2) 1		-	18.2	13.8	


NOTES: QFC maximum primary airflow (CFM) is based on 1.00" WG differential pressure signal from inlet airflow sensor until the value reaches maximum fan CFM for that unit size. A properly balanced QFC unit will be set so the maximum primary CFM is never greater than the fan CFM. Minimum recommended airflow (CFM) is based on 0.03" WG differential pressure of the inlet airflow sensor, or 0 CFM. 0.03" WG is equal to 15%-20% of the nominal flow rating of the terminal. Less than 15%-20% may result in greater than +/-5% control of box flow. Maximum/minimum fan airflow (CFM) is based on 0.10"/0.60" WG external downstream static pressure. See page B2-69 and B2-70 for complete fan curves. Unit size 7 motor amps includes amperage for two motors.

## DAMPER LEAKAGE

INLET SIZE	DAMPER LEAKAGE		
	1.5" WG	3.0" WG	6.0" WG
	CFM	CFM	CFM
6	4	5	7
8	4	5	7
10	4	5	7
12	4	5	7
14	4	6	8
16	5	7	9

NOTES: Damper leakage is measured with the damper fully closed using an actuator. A precision low flow orifice is used upstream of the unit to measure the leakage rate as a function of the measured upstream static pressure. Leakage testing conducted in accordance with ASHRAE 130-2008.

## DIMENSIONAL DATA | BASE UNIT | SIZES 2 - 6

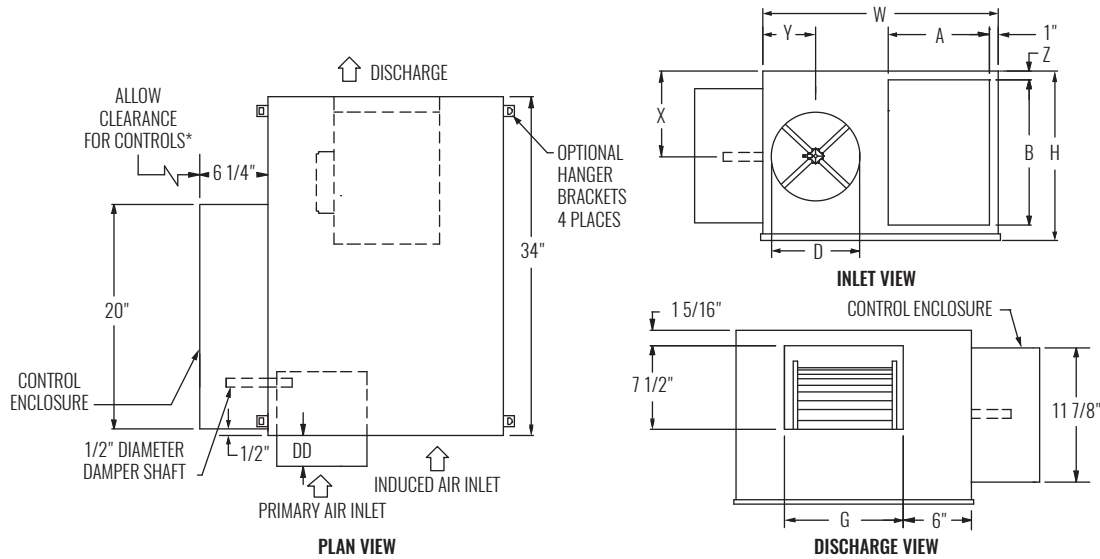

\* Check NEC for unit clearance requirements.

UNIT SIZE	INLET SIZE	MAX PRIMARY CFM	MAX FAN CFM	PSC HP	W	H	INDUCED AIR		D	G	X	Y	Z
							A	B					
2	06	515	560	1/10	21"	15"	9"	13"	5 7/8"	6 3/4"	7 1/2"	5 3/8"	1"
3	06	515	990	1/4	21"	15"	9"	13"	5 7/8"	9 1/4"	7 1/2"	5 3/8"	1"
3	08	920	990	1/4	21"	15"	9"	13"	7 7/8"	9 1/4"	7 1/2"	5 3/8"	1"
4	08	920	1440	1/4	32 1/4"	17 3/4"	14 3/8"	15"	7 7/8"	11 7/8"	8 7/8"	5 3/8"	13/8"
4	10	1430	1440	1/4	32 1/4"	17 3/4"	14 3/8"	15"	9 7/8"	11 7/8"	8 7/8"	7 3/8"	13/8"
4	12	1440	1440	1/4	32 1/4"	17 3/4"	14 3/8"	15"	11 7/8"	11 7/8"	8 7/8"	8 3/8"	13/8"
5	10	1430	2140	1/2	32 1/4"	17 3/4"	14 3/8"	15"	9 7/8"	13 1/8"	8 7/8"	7 3/8"	13/8"
5	12	2060	2140	1/2	32 1/4"	17 3/4"	14 3/8"	15"	11 7/8"	13 1/8"	8 7/8"	8 3/8"	13/8"
6	12	2060	2530	3/4	32 1/4"	17 3/4"	14 3/8"	15"	11 7/8"	13 1/8"	8 7/8"	8 3/8"	13/8"
6	14	2530	2530	3/4	32 1/4"	17 3/4"	14 3/8"	15"	13 7/8"	13 1/8"	8 7/8"	8 3/8"	13/8"

NOTES: Left-hand base unit with electronic control enclosure shown; right hand is available.

### STANDARD FEATURES (UNIT SIZES 2 - 6)


- 22 Gage galvanized steel casing construction
- Control enclosure for electronic components
- 1/2" Thick, Dual density fiberglass insulation that meets NFPA 90A and UL 181 safety requirements
- [120, 208/240, or 277 volt, multi-voltage, 1-phase, single-speed] permanently lubricated PSC motors
- Field adjustable fan speed control
- Removable bottom panel allows easy access to all internal components for maintenance
- Four quadrant, center averaging airflow sensor; inlet sizes 6 - 10 (DD = 4 7/8"); sizes 12 - 16 (DD = 6 7/8")
- Discharge requires flanged duct; connection by others
- Includes 24 volt control transformer
- ETL listed; adherence to UL 60335-2-40 and CSA C22.2 No. 60335-2-40
- AHRI certified sound ratings

### OPTIONAL FEATURES (UNIT SIZES 2 - 6)

- 20 Gage galvanized steel casing construction
- Liners: 1/2" or 1" Cellular insulation, 1" Dual density fiberglass insulation, or 1/2" or 1" Foil encapsulated fiberglass insulation
- Linear averaging airflow sensor; inlet sizes 6 - 10 (DD = 4 7/8"), sizes 12 - 16 (DD = 6 7/8")
- [120, 208/240, or 277 volt, single-voltage] ECM motor with manual or remote adjustable speed controller (on unit sizes 3 and 6)
- Left-hand or right-hand hand control enclosure
- Motor disconnect
- Motor fusing
- Induced air filter, construction type; unit sizes 2 - 3 (11"x15"x1"); unit sizes 4 - 6 (17"x17"x1")
- Induced air inlet attenuator
- Dust tight control enclosure
- Hanger brackets

**DIMENSIONAL DATA | BASE UNIT | SIZE 7**

TERMINAL UNITS | FAN POWERED

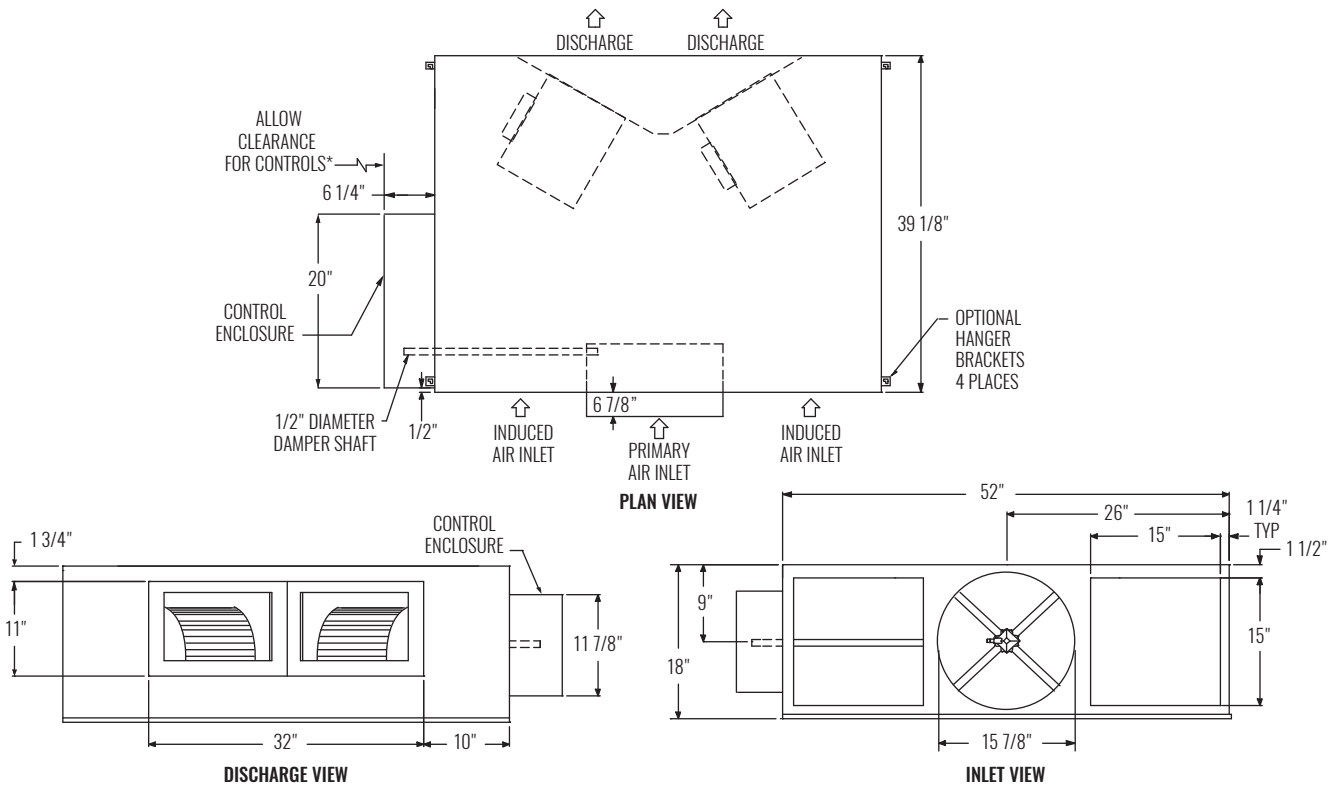

\* Check NEC for unit clearance requirements.

UNIT SIZE	INLET SIZE	MAX PRIMARY CFM	MAX FAN CFM	PSC HP
7	16	3660	3900	(2) 3/4

NOTES: Left-hand base unit with electronic control enclosure shown; right hand is available. Recommended duct connection is 32"x11".


**STANDARD FEATURES (UNIT SIZE 7)**

- 22 Gage galvanized steel casing construction
- Control enclosure for electronic components
- 1/2" Thick, Dual density fiberglass insulation that meets NFPA 90A and UL 181 safety requirements
- [208/240 or 277 volt, multi-voltage, 1-phase, single-speed] permanently lubricated PSC motors
- Field adjustable fan speed control
- Removable bottom panel allows easy access to all internal components for maintenance
- Four quadrant, center averaging airflow sensor
- Discharge requires flanged duct; connection by others
- Includes 24 volt control transformer
- ETL listed; adherence to UL 60335-2-40 and CSA C22.2 No. 60335-2-40
- AHRI certified sound ratings


**OPTIONAL FEATURES (UNIT SIZE 7)**

- 20 Gage galvanized steel casing construction
- Liners: 1/2" or 1" Cellular insulation, 1" Dual density fiberglass insulation, or 1/2" or 1" Foil encapsulated fiberglass insulation
- Linear averaging airflow sensor
- [120, 208/240, or 277 volt, single-voltage] ECM motor with manual or remote adjustable speed controller
- Left-hand or right-hand control enclosure
- Motor disconnect
- Motor fusing
- Induced air filter, construction type; size 17"x17"x1" (qty 2)
- Induced air inlet attenuator
- Dust tight control enclosure
- Hanger brackets


## DIMENSIONAL DATA | ATTENUATOR | SIZES 2 - 6

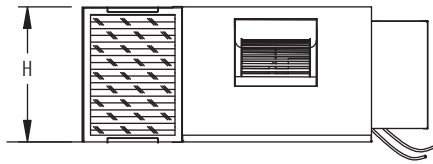

DISCHARGE VIEW

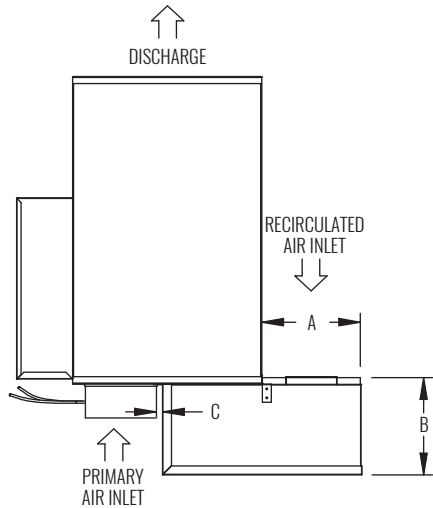

PLAN VIEW

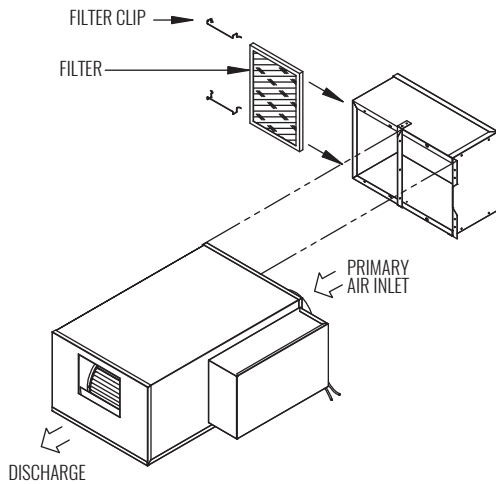


EXPLODED VIEW


UNIT SIZE	INLET SIZE	H	A	B	C
2	6	15"	12"	11"	4 1/2"
3	6	15"	12"	11"	4 1/2"
3	8	15"	12"	11"	3 1/2"
4	8	17 1/2"	17"	16 1/2"	7 1/4"
4	10	17 1/2"	17"	16 1/2"	4 1/4"
4	12	17 1/2"	17"	16 1/2"	2 1/4"
5	10	17 1/2"	17"	16 1/2"	4 1/4"
5	12	17 1/2"	17"	16 1/2"	2 1/4"
6	12	17 1/2"	17"	16 1/2"	2 1/4"
6	14	17 1/2"	17"	16 1/2"	1 1/4"

NOTE: Unit size 7 includes two attenuator kits.


## DIMENSIONAL DATA | ATTENUATOR | SIZE 7

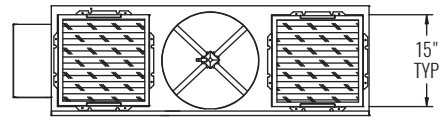

INLET VIEW

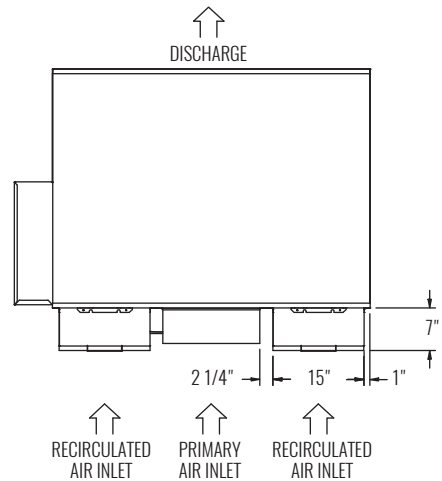



PLAN VIEW

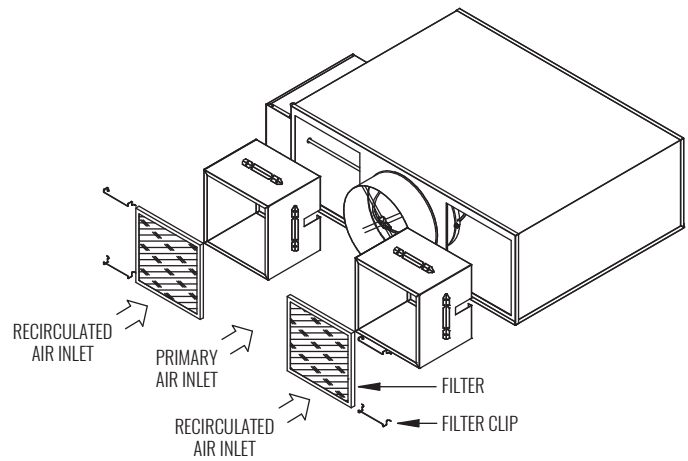

EXPLODED VIEW



**DIMENSIONAL DATA | BASE UNIT WITH HOT WATER HEAT | SIZES 2 - 6**

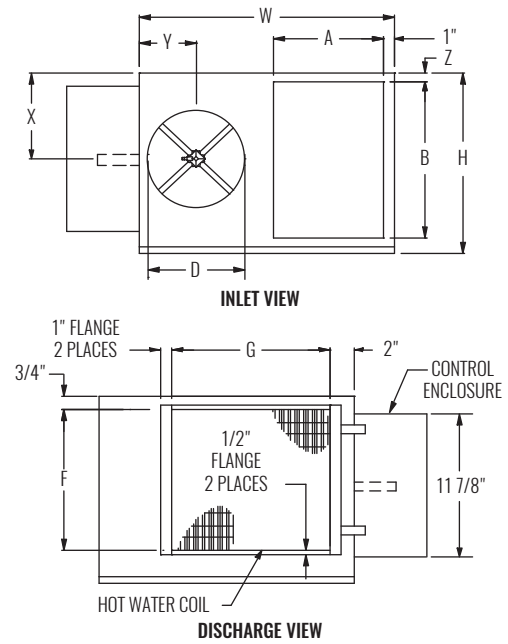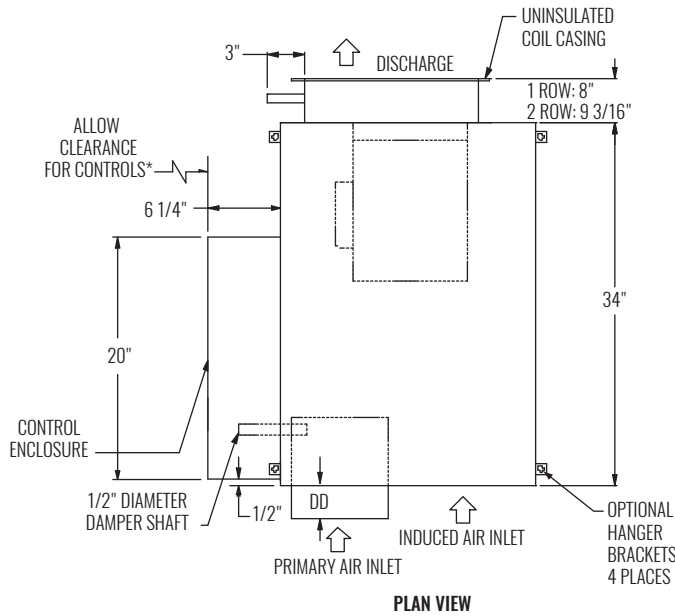

\* Check NEC for unit clearance requirements.

UNIT SIZE	INLET SIZE	MAX PRIMARY CFM	MAX FAN CFM		PSC HP	W	H	INDUCED AIR		D	DISCHARGE		X	Y	Z
			1-ROW	2-ROW				A	B		F	G			
2	06	515	545	535	1/10	21"	15"	9"	13"	5 7/8"	12 1/2"	15"	7 1/2"	5 3/8"	1"
3	06	515	925	910	1/4	21"	15"	9"	13"	5 7/8"	12 1/2"	15"	7 1/2"	5 3/8"	1"
3	08	910	925	910	1/4	21"	15"	9"	13"	7 7/8"	12 1/2"	15"	7 1/2"	5 3/8"	1"
4	08	920	1430	1415	1/4	32 1/4"	17 3/4"	14 3/8"	15"	7 7/8"	12 1/2"	22"	8 7/8"	5 3/8"	1 3/8"
4	10	1415	1430	1415	1/4	32 1/4"	17 3/4"	14 3/8"	15"	9 7/8"	12 1/2"	22"	8 7/8"	7 3/8"	1 3/8"
4	12	1415	1430	1415	1/4	32 1/4"	17 3/4"	14 3/8"	15"	11 7/8"	12 1/2"	22"	8 7/8"	8 3/8"	1 3/8"
5	10	1430	2125	2105	1/2	32 1/4"	17 3/4"	14 3/8"	15"	9 7/8"	15"	22"	8 7/8"	7 3/8"	1 3/8"
5	12	2060	2125	2105	1/2	32 1/4"	17 3/4"	14 3/8"	15"	11 7/8"	15"	22"	8 7/8"	8 3/8"	1 3/8"
6	12	2060	2430	2345	3/4	32 1/4"	17 3/4"	14 3/8"	15"	11 7/8"	15"	24 1/2"	8 7/8"	8 3/8"	1 3/8"
6	14	2345	2430	2345	3/4	32 1/4"	17 3/4"	14 3/8"	15"	13 7/8"	15"	24 1/2"	8 7/8"	8 3/8"	1 3/8"

NOTES: Left-hand base unit with electronic control enclosure shown; right hand is available.

**STANDARD FEATURES (UNIT SIZES 2 - 6)**




- 22 Gage galvanized steel casing construction
- Control enclosure for electronic components
- 1/2" Thick, Dual density fiberglass insulation that meets NFPA 90A and UL 181 safety requirements
- [120, 208/240, or 277 volt, multi-voltage, 1-phase, single-speed] permanently lubricated PSC motors
- Field adjustable fan speed control
- Removable bottom panel allows easy access to all internal components for maintenance
- Four quadrant center averaging airflow sensor; inlet sizes 6 - 10 (DD = 4 7/8"); sizes 12 - 16 (DD = 6 7/8")
- Flanged discharge connection on hot water coils
- Includes 24 volt control transformer
- ETL listed; adherence to UL 60335-2-40 and CSA C22.2 No. 60335-2-40
- AHRI certified sound ratings

**OPTIONAL FEATURES (UNIT SIZES 2 - 6)**

- 20 Gage galvanized steel casing construction
- Liners: 1/2" or 1" Cellular insulation, 1" Dual density fiberglass insulation, or 1/2" or 1" Foil encapsulated fiberglass insulation
- Linear averaging airflow sensor; inlet sizes 6 - 10 (DD = 4 7/8"), sizes 12 - 16 (DD = 6 7/8")
- [120, 208/240, or 277 volt, single-voltage] ECM motor with manual or remote adjustable speed controller (on unit sizes 3 and 6)
- Left-hand or right-hand control enclosure
- Hot water coil vent and drain
- Coil access panel
- Induced air filter, construction type; unit sizes 2 - 3 (11"x15"x1"); unit sizes 4 - 6 (17"x17"x1")
- Induced air inlet attenuator
- Motor disconnect
- Motor fusing
- Dust tight control enclosure
- Hanger brackets

TERMINAL UNITS | FAN POWERED

**DIMENSIONAL DATA | BASE UNIT WITH HOT WATER HEAT | SIZE 7**

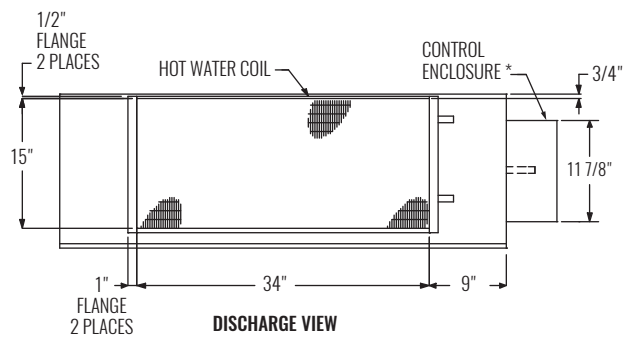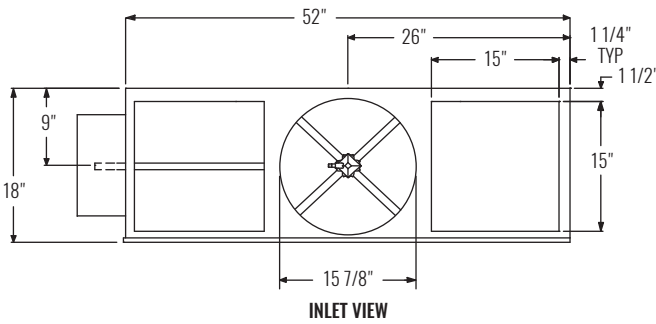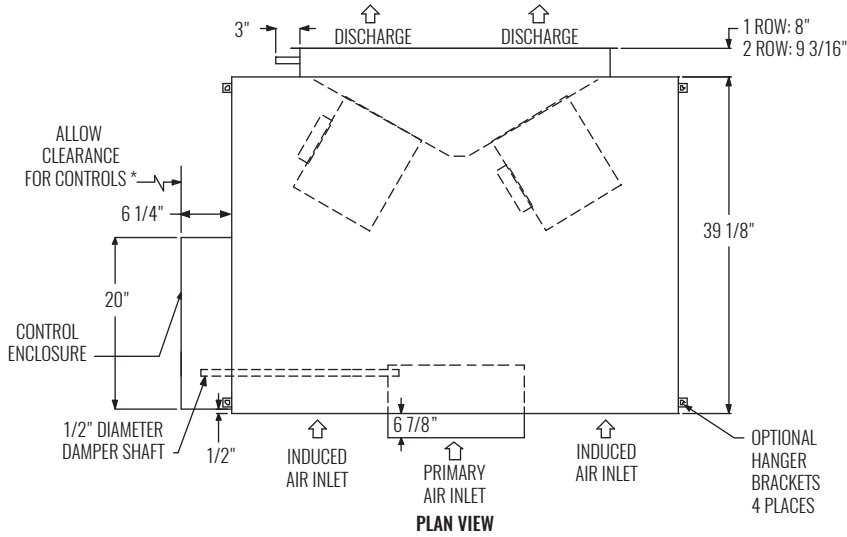

\* Check NEC for unit clearance requirements.

UNIT SIZE	INLET SIZE	MAX PRIMARY CFM	MAX FAN CFM		PSC HP
			1-ROW	2-ROW	
7	16	3530	3695	3530	(2) 3/4

NOTES: Left-hand base unit with electronic control enclosure shown; right hand is available. Recommended duct connection is 32"x11".


**STANDARD FEATURES (UNIT SIZE 7)**

- 22 Gage galvanized steel casing construction
- Control enclosure for electronic components
- 1/2" Thick, Dual density fiberglass insulation that meets NFPA 90A and UL 181 safety requirements
- [208/240 or 277 volt, multi-voltage, 1-phase, single-speed] permanently lubricated PSC motors
- Field adjustable fan speed control
- Removable bottom panel allows easy access to all internal components for maintenance
- Four quadrant center averaging airflow sensor
- Flanged discharge connection on hot water coils
- Includes 24 volt control transformer
- ETL listed; adherence to UL 60335-2-40 and CSA C22.2 No. 60335-2-40
- AHRI certified sound ratings


**OPTIONAL FEATURES (UNIT SIZE 7)**

- 20 Gage galvanized steel casing construction
- Liners: 1/2" or 1" Cellular insulation, 1" Dual density fiberglass insulation, or 1/2" or 1" Foil encapsulated fiberglass insulation
- Linear averaging airflow sensor
- [120, 208/240, or 277 volt, single-voltage] ECM motor with manual or remote adjustable speed controller
- Left-hand or right-hand control enclosure
- Hot water coil vent and drain
- Coil access panel
- Motor disconnect
- Motor fusing
- Induced air filter, construction type; size 17"x17"x1" (qty 2)
- Induced air inlet attenuator
- Dust tight control enclosure
- Hanger brackets


**DIMENSIONAL DATA | HOT WATER COILS**

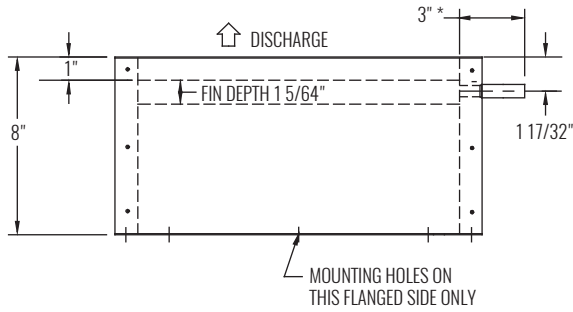


TOP VIEW, 1 ROW

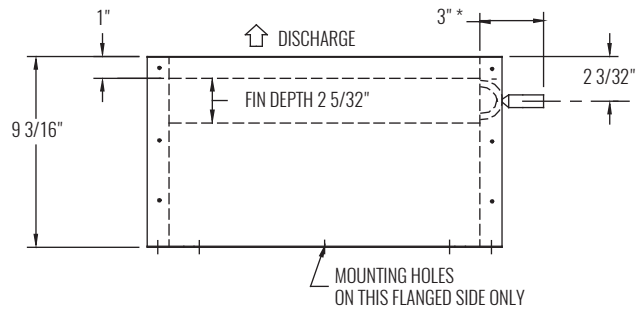

TOP VIEW, 2 ROW

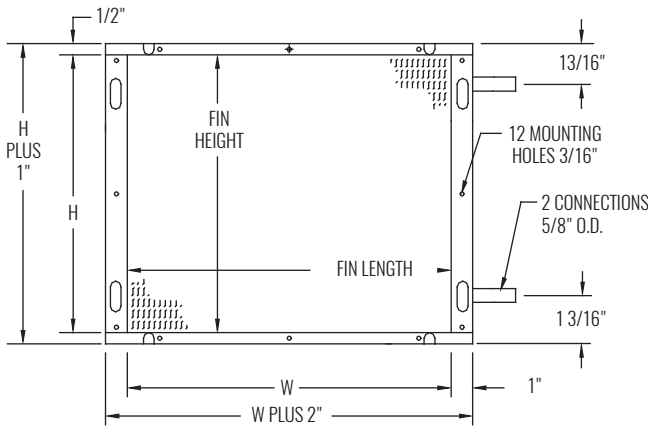

FRONT VIEW, 1 ROW

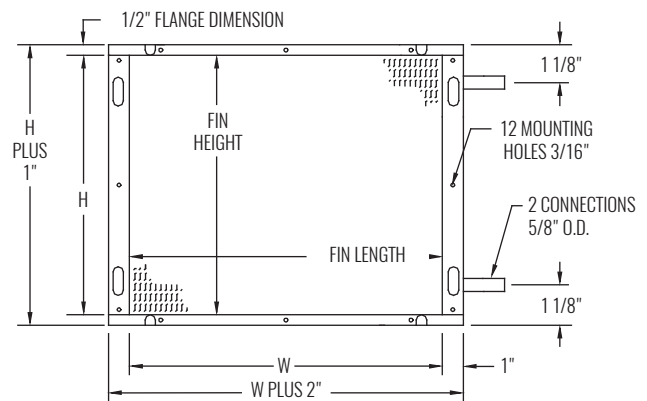

FRONT VIEW, 2 ROW

UNIT SIZE	W	H
2	15"	12 1/2"
3	15"	12 1/2"
4	22"	12 1/2"
5	22"	15"
6	24 1/2"	15"
7	34"	15"


NOTE: For hot water performance data tables, visit the Krueger website at [www.krueger-hvac.com](http://www.krueger-hvac.com) or download the Krueger selection software to run customized selections. The selection program can provide performance data with different entering air and water conditions as well as show effects of altitude and glycol on the heating performance of the water coil. The selection software also allows selections to be saved in a schedule format that can be imported onto a set of project drawings.

NOTES: 12" Depth for all 1 and 2 row hot water coils with accessories. 6 1/16" Length connection with vent and drain.

**STANDARD FEATURES**

- QFC coils are shipped from the factory attached to the unit discharge
- Hot water coils are configured for a flanged ductwork connection; coil section is uninsulated
- Coils are not for steam applications
- Contact your Krueger Representative for high capacity or steam coil information
- Connection Tubing - 5/8" O. D. male solder
- Coil Casing - 20 gage galvanized steel
- Coil Tubing - 1/2" O. D. x 0.016" thick copper
- Coil Fins - 0.0045" thick aluminum, 10 per inch; mechanically bonded to tubing
- Optional vent and drain
- Optional access panel

## DIMENSIONAL DATA | BASE UNIT WITH ELECTRIC HEAT | SIZES 2 - 6

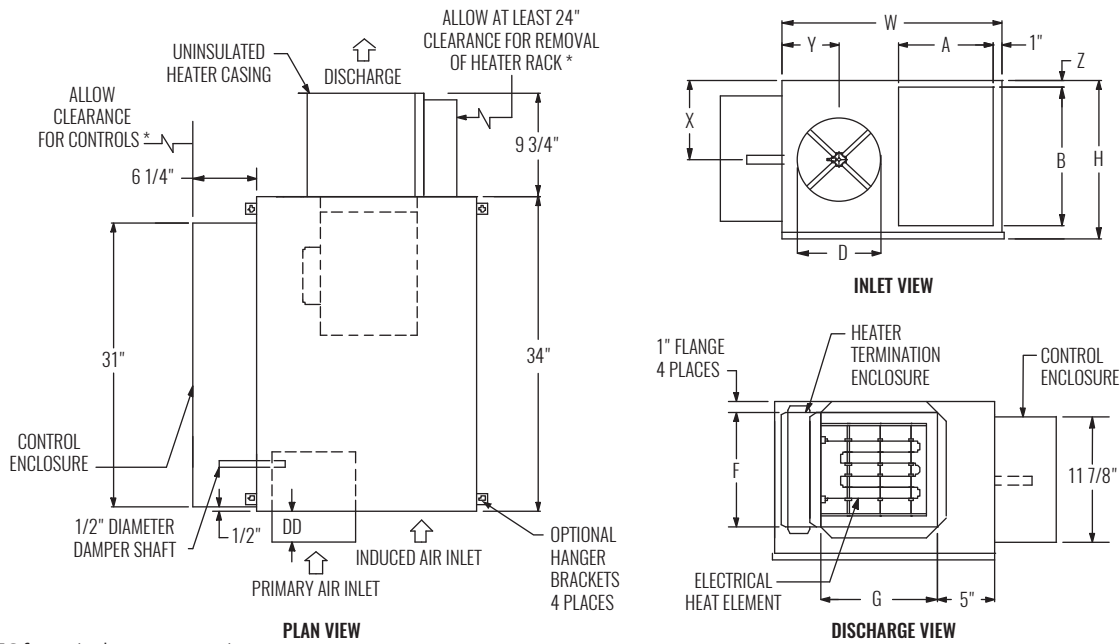

\* Check NEC for unit clearance requirements.

UNIT SIZE	INLET SIZE	MAX PRIMARY CFM	MAX FAN CFM	PSC HP	W	H	INDUCED AIR		D	DISCHARGE		X	Y	Z
							A	B		F	G			
2	06	515	560	1/10	21"	15"	9"	13"	5 7/8"	11"	11"	7 1/2"	5 3/8"	1"
3	06	515	990	1/4	21"	15"	9"	13"	5 7/8"	11"	11"	7 1/2"	5 3/8"	1"
3	08	920	990	1/4	21"	15"	9"	13"	7 7/8"	11"	11"	7 1/2"	5 3/8"	1"
4	08	920	1440	1/4	32 1/4"	17 3/4"	14 3/8"	15"	7 7/8"	13"	14 1/2"	8 7/8"	5 3/8"	1 3/8"
4	10	1430	1440	1/4	32 1/4"	17 3/4"	14 3/8"	15"	9 7/8"	13"	14 1/2"	8 7/8"	7 3/8"	1 3/8"
4	12	1440	1440	1/4	32 1/4"	17 3/4"	14 3/8"	15"	11 7/8"	13"	14 1/2"	8 7/8"	8 3/8"	1 3/8"
5	10	1430	2100	1/2	32 1/4"	17 3/4"	14 3/8"	15"	9 7/8"	13"	14 1/2"	8 7/8"	7 3/8"	1 3/8"
5	12	2060	2100	1/2	32 1/4"	17 3/4"	14 3/8"	15"	11 7/8"	13"	14 1/2"	8 7/8"	8 3/8"	1 3/8"
6	12	2060	2530	3/4	32 1/4"	17 3/4"	14 3/8"	15"	11 7/8"	13"	14 1/2"	8 7/8"	8 3/8"	1 3/8"
6	14	2530	2530	3/4	32 1/4"	17 3/4"	14 3/8"	15"	13 7/8"	13"	14 1/2"	8 7/8"	8 3/8"	1 3/8"

NOTES: Left-hand base unit with electronic control enclosure shown; right hand is available. See page B2-68 for electric heat standard features.


### STANDARD FEATURES (UNIT SIZES 2 - 6)

- 22 Gage galvanized steel casing construction
- Control enclosure for electronic components
- 1/2" Thick, Dual density fiberglass insulation that meets NFPA 90A and UL 181 safety requirements
- [120, 208/240, or 277 volt, multi-voltage, 1-phase, single-speed] permanently lubricated PSC motors
- Field adjustable fan speed control
- Removable bottom panel allows easy access to all internal components for maintenance
- Four quadrant center averaging airflow sensor; inlet sizes 6 - 10 (DD = 4 7/8"); sizes 12 - 16 (DD = 6 7/8")
- Flanged discharge connection on electric heat coil
- Single point electrical connection
- Includes 24 volt control transformer
- AHRI certified sound ratings
- ETL listed; adherence to UL 60335-2-40 and CSA C22.2 No. 60335-2-40
- AHRI certified sound ratings

### OPTIONAL FEATURES (UNIT SIZES 2 - 6)

- 20 Gage galvanized steel casing construction
- LineaHeat solid state electronic proportional control of electric heat
- Liners: 1/2" or 1" Cellular insulation, 1" Dual density fiberglass insulation, or 1/2" or 1" Foil encapsulated fiberglass insulation
- Linear averaging airflow sensor; inlet sizes 6 - 10 (DD = 4 7/8"), sizes 12 - 16 (DD = 6 7/8")
- [120, 208/240, or 277 volt, single-voltage] ECM motor with manual or remote adjustable speed controller (on sizes 3 and 6)
- Left-hand or right-hand control enclosure
- Fused or non-fused door interlocking disconnect
- Induced air filter, construction type; unit sizes 2 - 3 (11"x15"x1"); unit sizes 4 - 6 (17"x17"x1")
- Induced air inlet attenuator
- AC solid state relay
- Dust tight control enclosure
- Manual reset cutout
- Hanger brackets
- Motor fusing
- Fuse-block

**DIMENSIONAL DATA | BASE UNIT WITH ELECTRIC HEAT | SIZE 7**

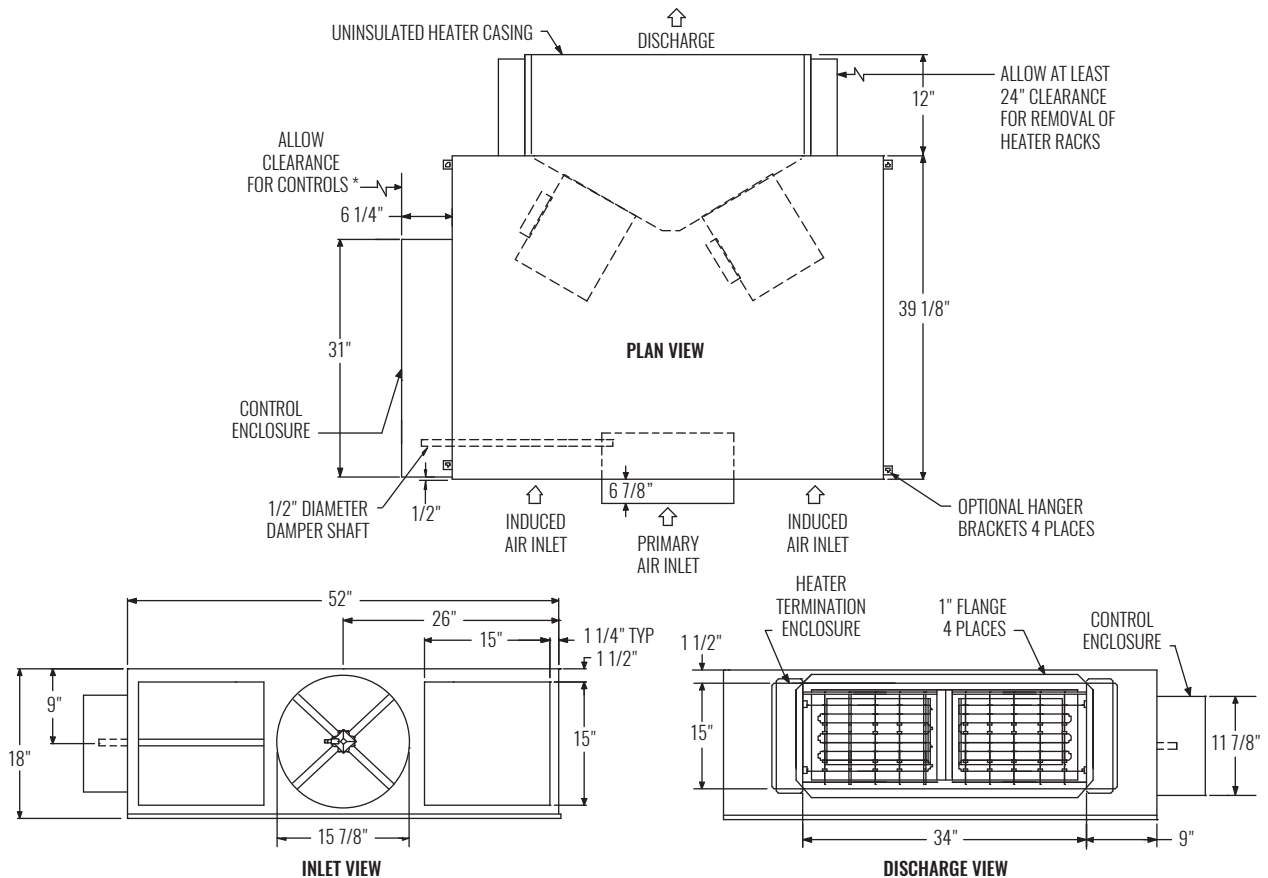

\* Check NEC for unit clearance requirements.

UNIT SIZE	INLET SIZE	MAX PRIMARY CFM	MAX FAN CFM	PSC HP
7	16	3660	3900	(2) 3/4

NOTES: Left-hand base unit with electronic control enclosure shown; right hand is available. See next page for electric heat standard features.

**STANDARD FEATURES (UNIT SIZE 7)**

- 22 Gage galvanized steel casing construction
- Control enclosure for electronic components
- 1/2" Thick, Dual density fiberglass insulation that meets NFPA 90A and UL 181 safety requirements
- [208/240 or 277 volt, multi-voltage, 1-phase, single-speed] permanently lubricated PSC motors
- Field adjustable fan speed control
- Removable bottom panel allows easy access to all internal components for maintenance
- Four quadrant center averaging airflow sensor
- Flanged discharge connection on electric heat coil
- Single point electrical connection
- Includes 24 volt control transformer
- AHRI certified sound ratings
- ETL listed; adherence to UL 60335-2-40 and CSA C22.2 No. 60335-2-40
- AHRI certified sound ratings

**OPTIONAL FEATURES (UNIT SIZE 7)**

- 20 Gage galvanized steel casing construction
- Liners: 1/2" or 1" Cellular insulation, 1" Dual density fiberglass insulation, or 1/2" or 1" Foil encapsulated fiberglass insulation
- Linear averaging airflow sensor
- [120, 208/240, or 277 volt, single-voltage] ECM motor with manual or remote adjustable speed controller
- Left-hand or right-hand control enclosure.
- LineaHeat solid state electronic controlled heater with or without leaving air temperature control
- Hanger brackets
- Motor fusing
- Fused or non-fused door interlocking disconnect
- Dust tight control enclosure
- AC solid state relay
- Manual reset cutout
- Induced air filter, construction type; size 17"x17"x1" (qty 2)
- Induced air inlet attenuator (extends 6")
- Fuse-block

## ELECTRIC HEAT FEATURES & CAPACITIES

The kW charts below indicates the maximum and minimum safe limit capacities for each of the QFC units and has been specifically designed for Krueger fan powered terminals. For safe operation, the electric heater controls are interlocked with the airflow proving switch to allow the heater to energize only after the fan is running. Each terminal unit has been tested by ETL in accordance with UL standards.

### ELECTRIC HEAT STANDARD FEATURES

- 20 Gage galvanized steel casing construction.
- Line voltage combinations:  
[120, 208/240, or 277 volt, 1-phase]  
[208 volt, 3-phase, 3-wire]  
[480 volt, 3-phase, 4-wire]
- NEMA 2 electric heat control enclosure.
- Flanged discharge for field duct connection.
- Single point connection between the heater and the fan motor (see combinations below).
- 80/20 Ni-Cr heating elements.
- Automatic reset thermal cutout.
- Magnetic contactors.
- Units with electronic/pneumatic feature a PE switch per step and a fan PE switch.
- Units with controls include a fan relay and a 24 volt control transformer.
- Positive pressure airflow switch.

NOTE: A minimum of 0.1" w.g. downstream static pressure is required in the duct to ensure proper heater operation.

NOTES: When selecting electric heaters, do not exceed 120°F discharge air temperature, per NEC. The ASHRAE Handbook of Fundamentals states that discharge temperatures in excess of 90°F are likely to result in objectionable air temperature stratification in the space. Also, ventilation short circuiting may occur. ASHRAE Standard 62 now limits discharge temperatures to 90°F or increasing the ventilation rate when heating from the ceiling.

### MAXIMUM kW

VOLTAGE / PHASE	PSC MOTOR						EC MOTOR		
	UNIT SIZE 2	UNIT SIZE 3	UNIT SIZE 4	UNIT SIZE 5	UNIT SIZE 6	UNIT SIZE 7	UNIT SIZE 3	UNIT SIZE 6	UNIT SIZE 7
	MAX	MAX	MAX	MAX	MAX	MAX	MAX	MAX	MAX
120v / 1Ph	4.0	5.0	5.0	4.5	4.5	N/A	4.5	4.0	N/A
208v / 1Ph	4.0	8.0	9.5	9.0	8.5	7.5	9.0	8.0	6.0
240v / 1Ph	4.0	8.0	11.0	10.5	10.0	9.0	10.0	9.0	7.0
277v / 1Ph	4.0	8.0	12.5	12.5	12.0	10.5	12.0	11.0	9.0
208v / 3Ph	4.0	8.0	14.0	16.0	15.0	13.5	12.5	14.0	10.5
480v / 3Ph	4.0	8.0	14.0	25.0	24.0	32.0	12.5	30.0	28.0

NOTES: Dash indicates not applicable. Maximum values apply to staged heaters only. Contact your local Krueger representative for LineaHeat limits.

### OPTIONAL HEATER CONTROL

- LineaHeat solid state electronic proportional control of electric heat is available with or without leaving air temperature control. See Krueger's Terminal Unit Engineering section for additional information.
- AC solid state relays offer silent operation for staged electric heat.

### SINGLE POINT CONNECTION COMBINATIONS ELECTRIC HEATER/FAN MOTOR

- [120, 208/240 or 277 volt, 1-phase] electric heat includes fan motor wired with same line voltage.
- [208 volt, 3-phase, 3-wire] electric heat utilizes a 208/240 volt, 1-phase fan motor.
- [480 volt, 3-phase, 4-wire] electric heat is equipped with 277 volt, 1-phase fan motor.

$$\text{Unit} = \frac{\text{CFM} \times \Delta T \text{ (}^\circ\text{F)}}{3160}$$


### CALCULATING ELECTRIC HEATER AMPERES

$$\text{Single Phase Amperes} = \frac{\text{Watts}}{\text{Line Voltage}}$$


$$\text{Three Phase Amperes} = \frac{\text{Watts}}{\text{Line Voltage} \times 1.73}$$

**FAN CURVES | PSC**


**QFC PSC FAN CURVE, UNIT SIZE 2**

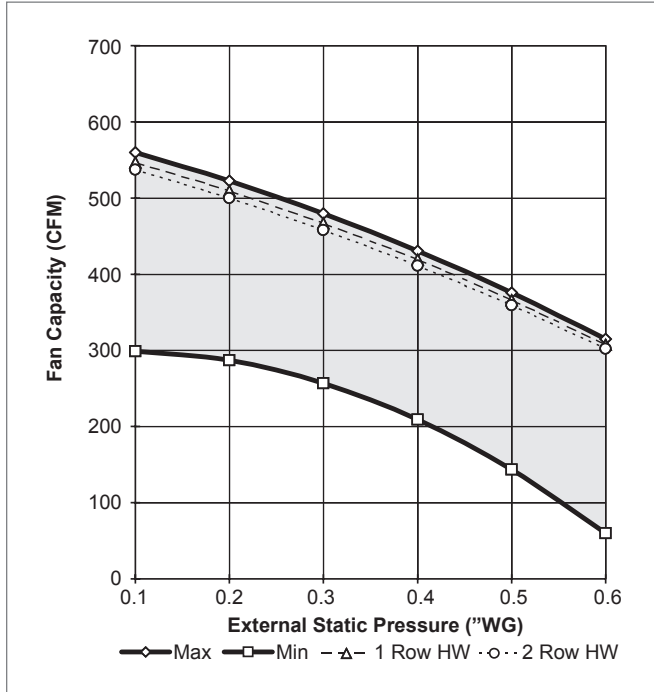


**QFC PSC FAN CURVE, UNIT SIZE 3**

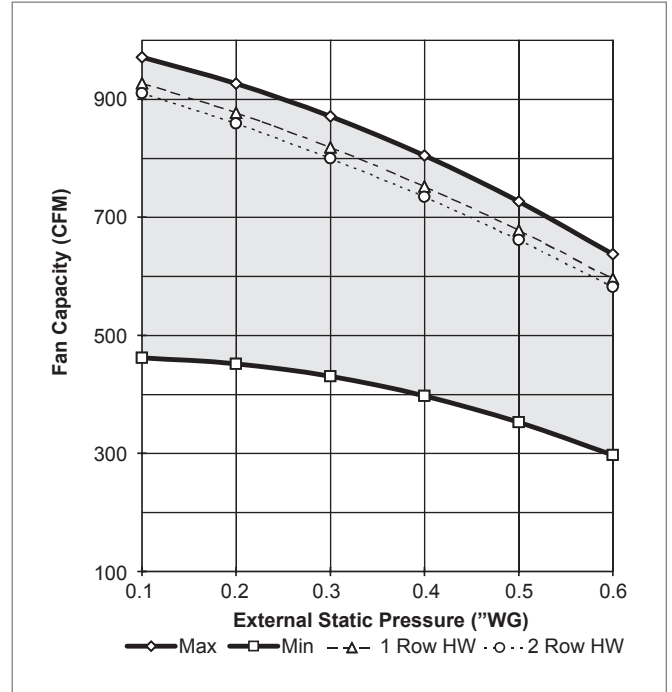

**QFC PSC FAN CURVE, UNIT SIZE 4**

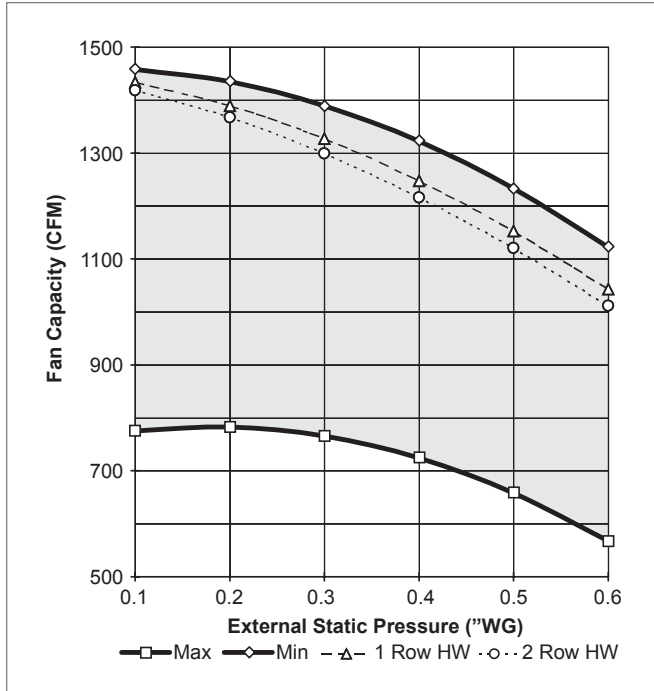

**QFC PSC FAN CURVE, UNIT SIZE 5**

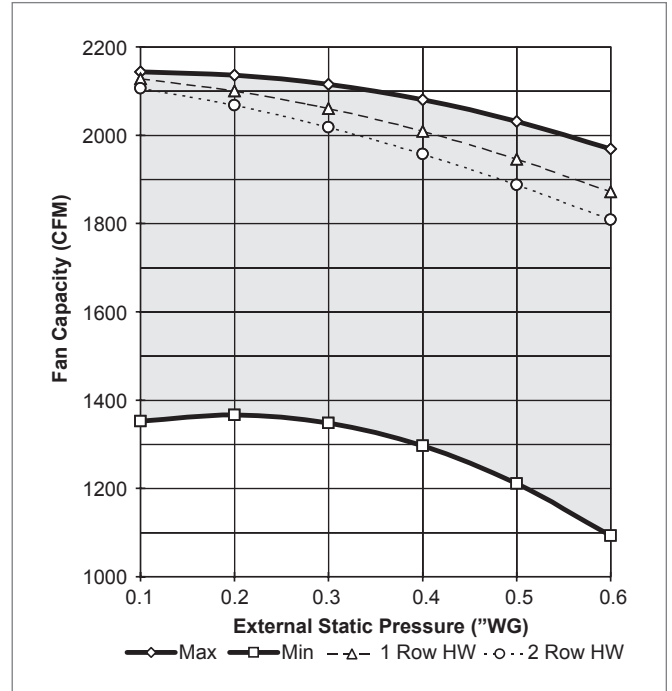


NOTES: Fan speed controller (SCR) is standard with each unit. Fan curves indicate maximum and minimum achievable flow reductions using SCR speed control. Units must be selected to operate within the flow and external static pressure ranges as shown. Fan discharge air volume will be reduced approximately 5% when unit is equipped with optional factory supplied electric heat coils.


TERMINAL UNITS | FAN POWERED

## FAN CURVES | PSC

QFC PSC FAN CURVE, UNIT SIZE 6

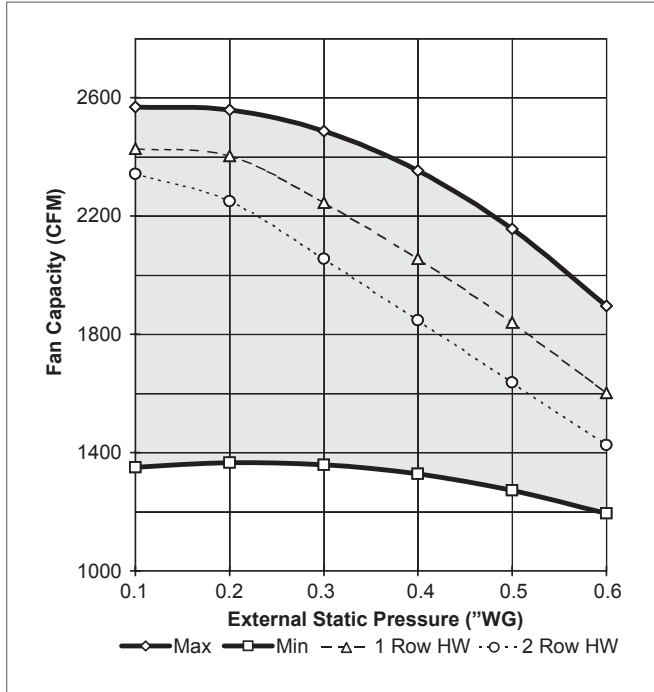


QFC PSC FAN CURVE, UNIT SIZE 7

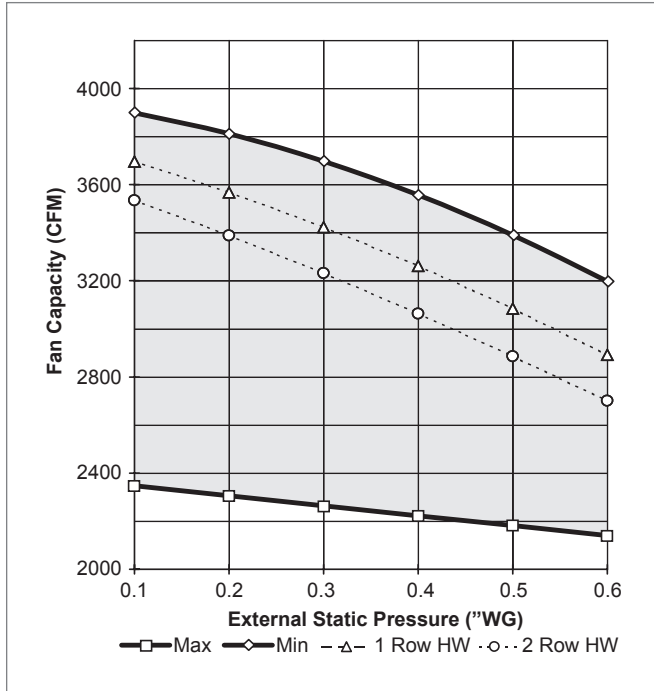


NOTES: Fan speed controller (SCR) is standard with each unit. Fan curves indicate maximum and minimum achievable flow reductions using SCR speed control. Units must be selected to operate within the flow and external static pressure ranges as shown. Fan discharge air volume will be reduced approximately 5% when unit is equipped with optional factory supplied electric heat coils.

## FAN CURVES | ECM


QFC ECM FAN CURVE, UNIT SIZE 3

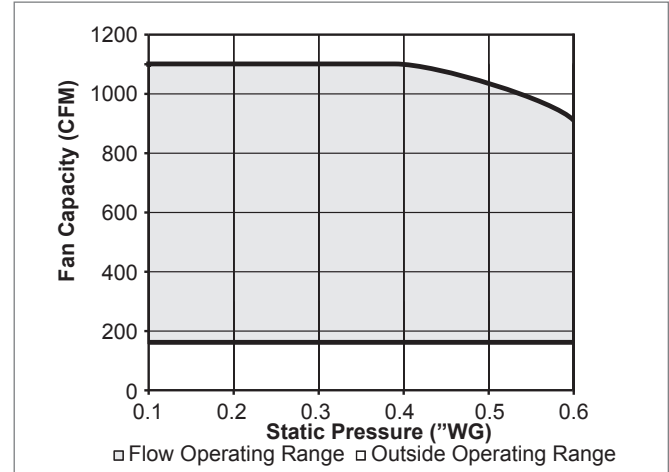

QFC ECM FAN CURVE, UNIT SIZE 6

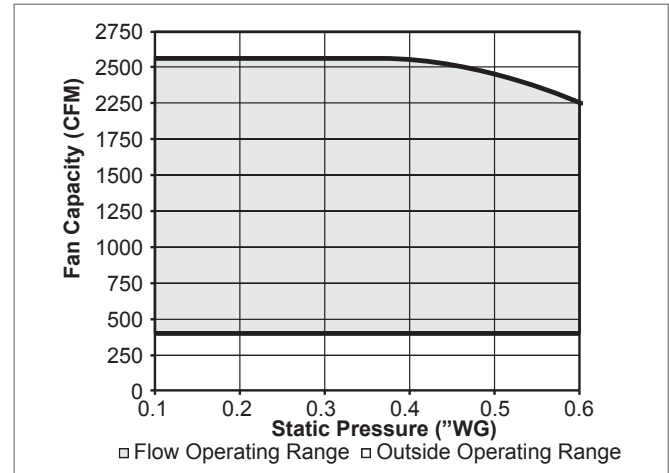

QFC ECM FAN CURVE, UNIT SIZE 7

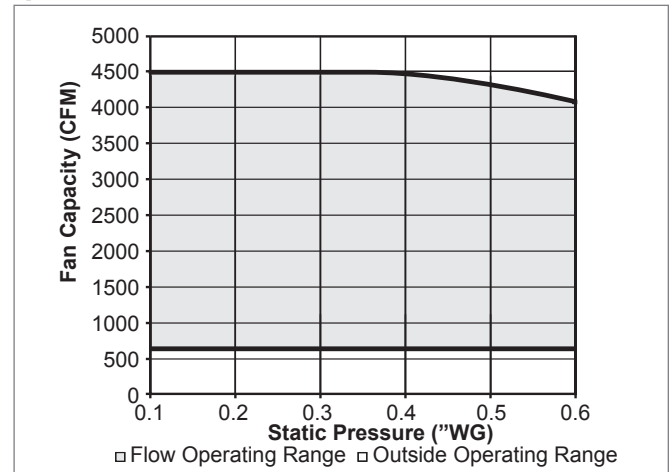

NOTES: Manual or remote adjustable speed controller is standard with each unit. Fan curves indicate the maximum and minimum achievable airflows. See Product Description section, page B2-57 for definitions of manual and remote adjustable speed controllers. Units must be selected to operate within the airflow and external static pressure ranges shown.



**PERFORMANCE DATA | DISCHARGE SOUND**

UNIT SIZE	INLET SIZE	PRIMARY FLOW RATE		FAN FLOW RATE		MIN ΔPs		FAN ONLY							FAN + PRIMARY @ 0.75" ΔPs							FAN + PRIMARY @ 1.5" ΔPs												
								OCTAVE BAND SOUND POWER, Lw							Lp		OCTAVE BAND SOUND POWER, Lw							Lp		OCTAVE BAND SOUND POWER, Lw							Lp	
		CFM	(L/s)	CFM	(L/s)	"WG	(pa)	2	3	4	5	6	7	NC	2	3	4	5	6	7	NC	2	3	4	5	6	7	NC						
2	6	200	(94)	250	(118)	0.025	(6.22)	53	54	57	52	47	43	-	53	54	57	52	47	43	-	53	57	57	52	47	43	-						
		250	(118)	300	(142)	0.039	(9.72)	57	58	60	55	51	47	-	57	58	60	55	51	47	-	57	60	60	55	51	47	-						
		300	(142)	350	(165)	0.056	(14.00)	60	60	62	57	53	51	-	60	60	62	57	53	51	-	60	63	62	57	53	51	<b>21</b>						
		350	(165)	400	(189)	0.077	(19.05)	63	63	64	60	56	54	<b>20</b>	63	63	64	60	56	54	<b>20</b>	63	65	64	60	56	54	<b>23</b>						
		400	(189)	<b>450</b>	(212)	0.100	(24.88)	<b>65</b>	<b>65</b>	<b>66</b>	<b>62</b>	<b>58</b>	<b>57</b>	<b>23</b>	65	65	66	62	58	57	<b>23</b>	65	67	67	62	58	57	<b>26</b>						
3	8	375	(177)	450	(212)	0.029	(7.14)	60	56	57	53	53	52	-	60	56	57	53	53	52	-	60	56	57	53	53	52	-						
		425	(201)	550	(260)	0.037	(9.17)	62	60	61	57	57	56	<b>21</b>	62	60	61	57	57	56	<b>21</b>	62	60	61	57	57	56	<b>21</b>						
		550	(260)	625	(295)	0.062	(15.36)	63	62	63	60	59	59	<b>23</b>	63	62	63	60	59	59	<b>23</b>	63	62	63	60	59	59	<b>23</b>						
		625	(295)	775	(366)	0.080	(19.84)	66	66	66	65	63	64	<b>28</b>	66	66	66	65	63	64	<b>28</b>	66	66	66	65	63	64	<b>28</b>						
		700	(330)	<b>850</b>	(401)	0.100	(24.88)	<b>67</b>	<b>68</b>	<b>68</b>	<b>67</b>	<b>65</b>	<b>66</b>	<b>30</b>	67	68	68	67	65	66	<b>30</b>	67	68	68	67	65	66	<b>30</b>						
4	10	700	(330)	800	(378)	0.040	(10.08)	61	63	64	66	63	55	-	61	63	66	68	65	55	-	65	65	66	68	65	57	<b>22</b>						
		800	(378)	950	(448)	0.053	(13.16)	63	64	66	67	64	57	<b>21</b>	63	64	66	69	66	57	<b>21</b>	66	67	66	69	66	59	<b>24</b>						
		900	(425)	1075	(507)	0.067	(16.66)	64	65	68	67	64	59	<b>23</b>	64	65	68	69	66	59	<b>23</b>	68	68	68	69	66	60	<b>25</b>						
		1000	(472)	1225	(578)	0.083	(20.57)	66	67	69	68	65	60	<b>24</b>	66	67	69	70	67	60	<b>24</b>	69	69	69	70	67	60	<b>27</b>						
		1100	(519)	<b>1350</b>	(637)	0.100	(24.88)	<b>67</b>	<b>67</b>	<b>70</b>	<b>68</b>	<b>65</b>	<b>61</b>	<b>25</b>	67	67	70	70	67	61	<b>25</b>	70	70	70	70	67	61	<b>28</b>						
5	12	1200	(566)	1350	(637)	0.056	(14.00)	67	65	66	64	62	62	<b>26</b>	68	65	66	64	62	62	<b>26</b>	70	68	68	64	62	62	<b>26</b>						
		1300	(614)	1475	(696)	0.066	(16.43)	68	67	67	66	64	65	<b>28</b>	70	67	67	66	64	65	<b>28</b>	72	70	69	66	64	65	<b>28</b>						
		1400	(661)	1600	(755)	0.077	(19.05)	70	69	69	69	67	67	<b>30</b>	70	69	69	69	67	67	<b>30</b>	73	72	71	69	67	67	<b>30</b>						
		1500	(708)	1750	(826)	0.088	(21.87)	71	70	70	71	69	69	<b>33</b>	71	70	70	71	69	69	<b>33</b>	74	73	72	71	69	69	<b>33</b>						
		1600	(755)	<b>2050</b>	(967)	0.100	(24.88)	<b>74</b>	<b>74</b>	<b>73</b>	<b>75</b>	<b>73</b>	<b>73</b>	<b>36</b>	74	74	73	75	73	73	<b>36</b>	76	76	73	75	73	73	<b>36</b>						
6	14	1275	(602)	1400	(661)	0.037	(9.17)	67	67	63	61	58	58	<b>24</b>	69	69	63	61	58	58	<b>27</b>	69	69	63	61	58	58	<b>27</b>						
		1450	(684)	1600	(755)	0.048	(11.86)	69	69	66	65	62	62	<b>26</b>	71	71	66	65	62	62	<b>29</b>	71	71	66	65	62	62	<b>29</b>						
		1775	(838)	1850	(873)	0.071	(17.78)	72	71	70	69	66	66	<b>30</b>	74	73	70	69	66	66	<b>31</b>	74	73	70	69	66	66	<b>31</b>						
		1950	(920)	2100	(991)	0.086	(21.46)	74	72	73	73	70	70	<b>33</b>	76	74	73	73	70	70	<b>33</b>	76	74	73	73	70	70	<b>33</b>						
		2100	(991)	<b>2400</b>	(1133)	0.100	(24.88)	<b>76</b>	<b>74</b>	<b>76</b>	<b>76</b>	<b>74</b>	<b>73</b>	<b>37</b>	78	76	76	76	74	73	<b>37</b>	78	76	76	76	74	73	<b>37</b>						
7	16	2000	(944)	2100	(991)	0.051	(12.70)	73	71	69	67	65	65	<b>29</b>	73	71	69	67	65	65	<b>29</b>	73	71	69	67	65	65	<b>29</b>						
		2200	(1,038)	2450	(1156)	0.062	(15.36)	75	73	71	69	67	67	<b>31</b>	75	73	71	69	67	67	<b>31</b>	75	73	71	69	67	67	<b>31</b>						
		2400	(1,133)	2800	(1321)	0.073	(18.28)	77	75	73	72	69	69	<b>33</b>	77	75	73	72	69	69	<b>33</b>	77	75	73	72	69	69	<b>33</b>						
		2600	(1,227)	3150	(1487)	0.086	(21.46)	78	76	74	74	70	70	<b>35</b>	78	76	74	74	70	70	<b>35</b>	78	76	74	74	70	70	<b>35</b>						
		2800	(1,321)	<b>3600</b>	(1699)	0.100	(24.88)	<b>79</b>	<b>78</b>	<b>76</b>	<b>76</b>	<b>72</b>	<b>72</b>	<b>37</b>	79	78	76	76	72	72	<b>37</b>	79	78	76	76	72	72	<b>37</b>						

NOTES: Discharge sound power is the sound emitted from the unit discharge. All sound data is based on tests conducted in accordance with AHRI 880-11 and corrected for end reflection. Sound power levels are in dB, re 10<sup>-12</sup> Watts. ΔPs is the difference in static pressure from inlet to discharge. NC application data is from AHRI Standard 885-08 Appendix E, as a function of flow rate shown. AHRI certification points are shown in bold, white font. For a complete list of AHRI certified data, see pages B2-3 and B2-4. All other data points listed are application ratings outside the scope of the Certification Program. See Krueger's selection program for specific sound data for optional liners; 1/2", dual density liner shown. Dash indicates a NC is less than 20. See Krueger's Terminal Unit Engineering section for reductions and definitions.

TERMINAL UNITS | FAN POWERED

## PERFORMANCE DATA | RADIATED SOUND

UNIT SIZE	INLET SIZE	PRIMARY FLOW RATE		FAN FLOW RATE		MIN Δ Ps		FAN ONLY							FAN + PRIMARY @ 0.75" Δ Ps							FAN + PRIMARY @ 1.5" Δ Ps									
		CFM	(L/s)	CFM	(L/s)	"WG	(Pa)	OCTAVE BAND SOUND POWER, Lw							Lp	OCTAVE BAND SOUND POWER, Lw							Lp	OCTAVE BAND SOUND POWER, Lw							Lp
								2	3	4	5	6	7	NC		2	3	4	5	6	7	NC		2	3	4	5	6	7	NC	
2	6	200	(94)	250	(118)	0.025	(6.22)	59	58	54	45	41	37	<b>29</b>	59	61	56	47	43	39	<b>31</b>	62	63	58	49	45	42	<b>33</b>			
		250	(118)	300	(142)	0.039	(9.72)	61	60	55	47	42	38	<b>30</b>	63	63	58	50	45	41	<b>33</b>	65	66	60	52	47	44	<b>36</b>			
		300	(142)	350	(165)	0.056	(14.00)	63	61	56	50	44	40	<b>31</b>	65	65	59	52	47	43	<b>35</b>	67	68	62	54	49	46	<b>39</b>			
		350	(165)	400	(189)	0.077	(19.05)	64	63	57	52	45	41	<b>33</b>	67	66	60	54	48	45	<b>37</b>	69	70	64	56	51	48	<b>41</b>			
		<b>400</b>	(189)	<b>450</b>	(212)	<b>0.100</b>	(24.88)	<b>65</b>	<b>64</b>	<b>57</b>	<b>54</b>	<b>46</b>	<b>42</b>	<b>34</b>	68	68	62	55	50	46	<b>39</b>	<b>70</b>	<b>71</b>	<b>65</b>	<b>57</b>	<b>52</b>	<b>49</b>	<b>43</b>			
3	8	375	(177)	450	(212)	0.029	(7.14)	54	53	51	48	36	32	<b>25</b>	61	59	55	50	42	39	<b>30</b>	67	67	60	51	46	41	<b>38</b>			
		425	(201)	550	(260)	0.037	(9.17)	58	58	54	50	41	37	<b>29</b>	63	61	57	50	45	41	<b>32</b>	68	69	61	54	48	43	<b>40</b>			
		550	(260)	625	(295)	0.062	(15.36)	61	60	56	52	43	40	<b>31</b>	66	64	59	55	48	45	<b>34</b>	71	72	64	57	51	47	<b>43</b>			
		625	(295)	775	(366)	0.080	(19.84)	66	65	60	55	48	45	<b>36</b>	69	67	62	58	51	49	<b>38</b>	73	74	66	60	54	50	<b>46</b>			
		<b>700</b>	(330)	<b>850</b>	(401)	<b>0.100</b>	(24.88)	<b>69</b>	<b>67</b>	<b>61</b>	<b>57</b>	<b>50</b>	<b>48</b>	<b>38</b>	70	69	63	59	53	51	<b>40</b>	<b>74</b>	<b>75</b>	<b>67</b>	<b>61</b>	<b>55</b>	<b>52</b>	<b>47</b>			
4	10	700	(330)	800	(378)	0.040	(10.08)	63	60	59	54	44	42	<b>34</b>	65	63	60	54	46	42	<b>36</b>	68	65	62	57	49	46	<b>38</b>			
		800	(378)	950	(448)	0.053	(13.16)	65	62	59	55	47	44	<b>35</b>	68	65	62	55	49	44	<b>37</b>	70	68	64	58	51	48	<b>39</b>			
		900	(425)	1075	(507)	0.067	(16.66)	67	64	60	55	49	46	<b>35</b>	69	67	62	57	49	46	<b>38</b>	72	70	65	59	53	50	<b>41</b>			
		1000	(472)	1225	(578)	0.083	(20.57)	68	65	61	56	51	48	<b>36</b>	71	69	63	58	51	48	<b>40</b>	74	72	66	60	54	51	<b>43</b>			
		<b>1100</b>	(519)	<b>1350</b>	(637)	<b>0.100</b>	(24.88)	<b>69</b>	<b>67</b>	<b>61</b>	<b>57</b>	<b>53</b>	<b>49</b>	<b>37</b>	72	70	64	59	53	49	<b>41</b>	<b>75</b>	<b>73</b>	<b>67</b>	<b>61</b>	<b>56</b>	<b>53</b>	<b>45</b>			
5	12	1200	(566)	1350	(637)	0.056	(14.00)	70	67	61	55	48	47	<b>38</b>	74	71	63	58	53	50	<b>43</b>	76	73	65	60	55	51	<b>45</b>			
		1300	(614)	1475	(696)	0.066	(16.43)	71	68	62	57	50	49	<b>38</b>	75	72	64	59	54	51	<b>44</b>	77	74	66	61	56	52	<b>46</b>			
		1400	(661)	1600	(755)	0.077	(19.05)	72	68	63	58	52	51	<b>39</b>	76	73	65	60	55	51	<b>44</b>	77	75	67	61	57	54	<b>47</b>			
		1500	(708)	1750	(826)	0.088	(21.87)	73	69	64	60	54	53	<b>40</b>	77	73	66	60	56	53	<b>45</b>	78	75	68	62	58	55	<b>48</b>			
		<b>1600</b>	(755)	<b>2050</b>	(967)	<b>0.100</b>	(24.88)	<b>75</b>	<b>70</b>	<b>66</b>	<b>62</b>	<b>57</b>	<b>57</b>	<b>42</b>	78	74	66	62	57	57	<b>47</b>	<b>79</b>	<b>76</b>	<b>69</b>	<b>64</b>	<b>60</b>	<b>57</b>	<b>49</b>			
6	14	1275	(602)	1400	(661)	0.037	(9.17)	64	64	58	56	52	48	<b>35</b>	68	67	61	58	55	51	<b>38</b>	69	68	63	59	57	53	<b>39</b>			
		1450	(684)	1600	(755)	0.048	(11.86)	66	66	60	58	55	51	<b>36</b>	70	69	63	58	57	54	<b>40</b>	71	70	65	61	59	55	<b>42</b>			
		1775	(838)	1850	(873)	0.071	(17.78)	68	67	62	61	58	55	<b>37</b>	73	72	65	61	60	57	<b>43</b>	74	74	68	64	61	58	<b>46</b>			
		1950	(920)	2100	(991)	0.086	(21.46)	70	68	64	63	60	58	<b>39</b>	74	73	67	63	60	58	<b>45</b>	76	75	69	65	63	60	<b>48</b>			
		<b>2100</b>	(991)	<b>2400</b>	(1133)	<b>0.100</b>	(24.88)	<b>72</b>	<b>69</b>	<b>66</b>	<b>65</b>	<b>63</b>	<b>61</b>	<b>41</b>	76	75	68	65	63	61	<b>47</b>	<b>78</b>	<b>77</b>	<b>70</b>	<b>67</b>	<b>65</b>	<b>61</b>	<b>49</b>			
7	16	2000	(944)	2100	(991)	0.051	(12.70)	69	68	62	58	53	51	<b>38</b>	75	71	66	62	57	54	<b>42</b>	78	74	69	66	60	57	<b>46</b>			
		2200	(1,038)	2450	(1156)	0.062	(15.36)	72	70	64	61	56	54	<b>41</b>	76	73	67	64	59	56	<b>44</b>	79	76	71	67	62	59	<b>48</b>			
		2400	(1,133)	2800	(1321)	0.073	(18.28)	74	72	66	63	58	57	<b>43</b>	78	74	69	65	61	58	<b>46</b>	80	77	72	68	63	60	<b>49</b>			
		2600	(1,227)	3150	(1487)	0.086	(21.46)	76	73	68	65	60	59	<b>45</b>	79	75	70	65	62	59	<b>48</b>	82	78	73	69	65	62	<b>51</b>			
		<b>2800</b>	(1,321)	<b>3600</b>	(1699)	<b>0.100</b>	(24.88)	<b>78</b>	<b>75</b>	<b>70</b>	<b>67</b>	<b>63</b>	<b>62</b>	<b>48</b>	81	75	70	67	63	62	<b>49</b>	<b>83</b>	<b>79</b>	<b>74</b>	<b>70</b>	<b>66</b>	<b>64</b>	<b>52</b>			

NOTES: Radiated sound power is the sound transmitted through the casing walls. All sound data is based on tests conducted in accordance with AHRI 880-11. Sound power levels are in dB, re 10<sup>-12</sup> Watts. ΔPs is the difference in static pressure from inlet to discharge. NC application data is from AHRI Standard 885-08 Appendix E. AHRI certification points are shown in bold, white font. For a complete list of AHRI certified data, see pages B2-3 and B2-4. All other data points listed are application ratings outside the scope of the Certification Program. See Krueger's selection program for specific sound data for optional liners; 1/2", dual density liner shown. Dash indicates a NC is less than 20. See Krueger's Terminal Unit Engineering section for reductions and definitions.

## CONTROL INFORMATION

### SEQUENCE OF OPERATION

The standard QFC sequence of operation has the induced airflow fan operating continuously, providing a constant volume of discharge air to the conditioned space.

### HEATING MODE

When the zone is at maximum heating demand, the primary air damper maintains a minimum flow and the fan runs constantly, inducing the maximum amount of warm ceiling plenum air. Electric or hot water heat, if supplied, operates at maximum capacity.

As the zone temperature rises, the optional heat, if supplied, cycles off. The fan continues to induce a maximum amount of ceiling plenum air. As the zone temperature rises above the thermostat setpoint, the QFC unit enters the cooling mode.

### COOLING MODE

As the zone temperature rises above setpoint, the primary air damper begins to modulate toward the full open damper position. As the amount of conditioned primary air increases, the amount of induced ceiling plenum air decreases.

When the conditioned zone is at maximum cooling demand, the primary air damper will maintain a constant maximum flow setting. With pressure independent controls, the damper will maintain the maximum flow setting regardless of system pressure fluctuations. The fan will discharge virtually 100% primary air if installed and balanced properly.

### NIGHT SETBACK

One of the most popular QFC control arrangements is the night setback feature. With this control arrangement, the QFC induced air fan will operate whenever central system pressure is sensed (day mode). When the central system is off (night mode), the QFC induced air fan and optional heat will cycle on in response to thermostat demand.

### CONTROL OPTIONS

- **Pneumatic Controls:** Pressure independent control packages are available with or without hot water or electric heat, night shutdown and/or unoccupied heating. All control arrangements include an inlet flow sensor and fan speed controller.
- **Analog Controls:** Pressure independent control packages are available with or without hot water or electric heat, automatic or remote night shutdown and automatic night setback. All control arrangements include an inlet flow sensor, control enclosure, fan speed controller, transformer to 24 volts, and wall thermostat to match the control type.
- **Direct Digital Controls:** Smart Equipment control packages are provided and programmed by the factory for in-house mounting, piping, and wiring.
  - BACnet Compatible: 7201-7209
  - Standalone: 6201-6209

Other digital control packages can be supplied to the factory for mounting, piping, and wiring.

Contact your Krueger representative for a complete list of direct digital control arrangements.

- **No Control Unit:** Units are factory supplied without controls, assuming that the unit is being used for field mounting of direct digital control equipment. This arrangement includes an inlet flow sensor, control enclosure, fan speed controller, transformer to 24 volts, and fan relay.

NOTES: Visit Krueger's website at [www.krueger-hvac.com](http://www.krueger-hvac.com) or contact your local Krueger representative for a complete list of direct digital control arrangements.

To prevent the blower from spinning backwards, the simplest solution is to require that the building control system energize the series box fans prior to starting the central system air handler. Some DDC controls for series boxes have a start-up procedure that closes the damper, de-energizes the fan, (resets to zero on the pressure transducer while the damper is closed) and then returns control to the unit. Most manufacturers' Series Fan boxes are designed to maximize starting torque to overcome this backward rotation. If, however, the primary airflow is available for long enough, and the fan speed control is set at a low enough value, any series fan terminal can be expected to start and operate backward. This will not damage the unit, and it will deliver approximately 60% of designed airflow. Until the space load exceeds 60% of the design load, it is probable that no one will notice the unit is running backward. When the thermostat calls for more than 60% of the design load the excess primary will spill into the plenum and the likely result will be cold plenum air 'falling' from return grilles onto room occupants. No manufacturer offers a mechanical device to prevent backward rotation. Krueger can supply a special sequence that employs a pressure sensor installed in the high-pressure side of the inlet sensor to detect any airflow in the primary duct and energize the fan if the building's control system cannot be properly configured to avoid this problem.

## CONTROL INFORMATION (CONTINUED)

The following list shows the standard control arrangements available with the QFC product offering. Each control approach offers a variety of pressure independent operating functions; combinations of control functions are identified by the Krueger control package number.

### **PNEUMATIC CONTROL ARRANGEMENTS**

- 1300 - Single Function Controller; DA-NO with or without Hot Water or Electric Heat
- 1301 - Single Function Controller; DA-NO with or without Hot Water or Electric Heat and with Night Shutdown
- 1302 - Single Function Controller; DA-NO with or without Hot Water or Electric Heat, with Night Shutdown and Unoccupied Heating
- 1303 - Single Function Controller; RA-NC with or without Hot Water or Electric Heat
- 1304 - Single Function Controller; RA-NC with or without Hot Water or Electric Heat and with Night Shutdown
- 1305 - Single Function Controller; RA-NC with or without Hot Water or Electric Heat, with Night Shutdown and Unoccupied Heating
- 1306 - Multi-function Controller; DA-NO with or without Hot Water or Electric Heat
- 1307 - Multi-function Controller; DA-NO with or without Hot Water or Electric Heat and with Night Shutdown
- 1308 - Multi-function Controller; DA-NO with or without Hot Water or Electric Heat, with Night Shutdown and Unoccupied Heating
- 1309 - Multi-function Controller; DA-NC with or without Hot Water or Electric Heat
- 1310 - Multi-function Controller; DA-NC with or without Hot Water or Electric Heat and with Night Shutdown
- 1311 - Multi-function Controller; DA-NC with or without Hot Water or Electric Heat, with Night Shutdown and Unoccupied Heating
- 1312 - Multi-function Controller; RA-NC with or without Hot Water or Electric Heat
- 1313 - Multi-function Controller; RA-NC with or without Hot Water or Electric Heat and with Night Shutdown
- 1314 - Multi-function Controller; RA-NC with or without Hot Water or Electric Heat, with Night Shutdown and Unoccupied Heating
- 1315 - Multi-function Controller; RA-NO with or without Hot Water or Electric Heat
- 1316 - Multi-function Controller; RA-NO with or without Hot Water or Electric Heat and with Night Shutdown
- 1317 - Multi-function Controller; RA-NO with or without Hot Water or Electric Heat, with Night Shutdown and Unoccupied Heating

### **Pneumatic Control Legend:**

- DA - Direct Acting Thermostat
- RA - Reverse Acting Thermostat
- NO - Normally Open Damper Position
- NC - Normally Closed Damper Position
- Single Function Controller - Provides Single Function, DA-NO or RA-NC
- Multi-function Controller - Capable of Providing DA-NO, DA-NC, RA-NC or RA-NO Functions

### **ANALOG CONTROL ARRANGEMENTS**

- 2200 - Cooling Only
- 2201 - Cooling Only with Automatic Night Shutdown
- 2203 - Cooling Only with Automatic Night Setback
- 2204 - Cooling with On/Off Hot Water Heat
- 2205 - Cooling with On/Off Hot Water Heat and Automatic Night Shutdown
- 2207 - Cooling with On/Off Hot Water Heat and Automatic Night Setback
- 2208 - Cooling with Proportional Hot Water Heat
- 2209 - Cooling with Proportional Hot Water Heat and Automatic Night Shutdown
- 2211 - Cooling with Proportional Hot Water Heat and Automatic Night Setback
- 2212 - Cooling with Up to Two Stages of Electric Heat
- 2213 - Cooling with Up to Two Stages of Electric Heat and Automatic Night Shutdown
- 2215 - Cooling with Up to Two Stages of Electric Heat and Automatic Night Setback
- 2217 - Cooling/heating with Automatic Changeover
- 2218 - Cooling with Proportional Electric Heat

### **DIRECT DIGITAL CONTROL ARRANGEMENTS**

Visit Krueger's website at [www.krueger-hvac.com](http://www.krueger-hvac.com) or contact your Krueger representative for a complete list of factory mounted direct digital control arrangements.

## SUGGESTED SPECIFICATION & CONFIGURATION

### QFC UNIT

Fan powered terminal unit shall be completely factory assembled and wired with motor, blower, mixing plenum and primary air damper contained in a single unit housing. Unit shall be Krueger model QFC.

The induced air fan shall operate continuously during central system operation. Primary airflow controller shall compensate for central system pressure fluctuations. When room temperature requires maximum heating, the (direct digital) (analog) (pneumatic) pressure, independent velocity controller maintains the minimum primary airflow setting by modulating the damper. The electric heating coil or hot water coil, if supplied, is energized (activated). As room temperature begins to rise, the heating coil is de-energized (deactivated). As room temperature rises above the setpoint, the primary air damper will modulate to maintain room temperature. When the room temperature calls for maximum cooling, the velocity controller maintains the maximum primary airflow setting.

To prevent the fan/motor from running in the backward direction, the unit induced air fan shall be field wired so that it is electrically or pneumatically interlocked with the central system fan.

Terminals shall be certified by use of the AHRI Standard 880 Certification Program and carry the AHRI seal.

The terminal unit shall be ETL listed as a complete assembly. All electrical components shall be UL listed and installed in accordance with the National Electric Code. All electrical components shall be mounted in sheet metal control enclosures. Electrical connection shall be single point.

Unit casing shall be constructed of not less than 22 gage galvanized steel. All primary air inlet collars shall accommodate standard flex duct sizes. Unit discharge shall be rectangular, suitable for flanged duct connections.

Unit labels shall be adhered to each unit including model, size, airflow (CFM), balancing chart, electrical information, and tagging data.

The primary air damper assembly shall be constructed of heavy gage galvanized steel with solid shaft rotating in self lubricating Delrin® bearings. Damper shaft shall be marked on the end to indicate damper position. Damper blade shall incorporate a flexible gasket for tight airflow shutoff and operate over a full 90 degree rotation.

QFC unit shall be equipped with a factory installed airflow sensing device. Provide a K4 LineaCross, four quadrant, multi-point center averaging sensor with an amplified signal.

- **(Optional)** Provide a linear, multi-point, velocity averaging sensor with an amplified signal. Provide balancing taps to allow for easy airflow verification.

Fan motor and all interior components must be accessible through a removable bottom access panel.

Fan shall be of the forward curve, centrifugal type. The fan motor shall be single speed, multi-voltage (120, 208/240, 277), 60 cycle, 1-phase, energy efficient design, permanently lubricated, using permanent split capacitor for starting and be specifically designed for use with an SCR fan speed controller. Motor must have thermal overload protection. The fan motor shaft shall be connected directly to the fan, and fan motor shall be isolated from the unit casing to prevent transmission of vibration.

- **(Optional)** ECM Fan Motor: The fan motor shall be 120, 208/240, or 277 volt, 1-phase ECM (electronically commutated motor) fan motors including either a manual or remote adjustable speed controller. The manual adjustable speed controller is field set and adjustable with digital display, alternating between RPM and percentage full airflow. The remote adjustable speed controller shall provide a means to remotely set and/or adjust the fan speed.

The radiated and discharge attenuation factors for the specified NC levels shall be based on either room absorption, plus an environmental adjustment factor or the attenuation factors from AHRI Standard 885-08 Appendix E, which includes room absorption, environmental adjustment factor, duct insertion, end reflection and duct branching.

## SUGGESTED SPECIFICATION & CONFIGURATION (CONTINUED)

### CASING LINERS

Unit casing shall be lined with 1/2" thick, 1 1/2 lb. dual density fiberglass insulation that meets UL 181 and NFPA 90A. Insulation shall be attached to the unit casing by adhesive and weld pins.

- **(Optional) 1" Thick Insulation:** Unit casing shall be lined with 1" thick, 1 1/2 lb. dual density fiberglass insulation that meets UL 181 and NFPA 90A. Insulation shall be attached to the unit casing by adhesive and weld pins.
- **(Optional) Cellular Insulation:** Unit casing shall be lined with 1/2" or 1" thick, 1 1/2 lb. density, smooth surface, polyolefin, closed-cell foam insulation for fiber free application. Cellular insulation meets UL 181 and NFPA 90A and does not support mold or bacteria growth. Insulation shall be attached to the unit casing by adhesive and weld pins.
- **(Optional) Foil Encapsulated Insulation:** Unit casing shall be lined with foil reinforced, wrapped edges, 1/2" or 1" thick, 1 1/2 lb. density fiberglass insulation that meets UL 181 and NFPA 90A. Insulation shall be attached to the unit casing by adhesive and weld pins.

### ELECTRIC HEATING COILS

Electric coils shall be supplied by the terminal unit manufacturer and shall be ETL listed in accordance with UL standards. Construct coil casing with minimum of 20 gage zinc coated steel. Elements shall be 80/20 Ni-Cr and supported by ceramic insulators. The integral control panel shall be housed in a NEMA 2 enclosure with access to all controls and safety devices.

Electric coils shall contain a primary automatic reset thermal cutout and differential pressure airflow switch for proof of airflow.

- **(Optional)** Electric coils shall include fused or non-fused door interlocking disconnect switch, AC solid state relay, fuse-block, manual reset cutout, and/or dust tight enclosure construction.
- **(Optional)** LineaHeat solid state electronic proportional control of electric heat with or without leaving air temperature control shall meet the requirements of ASHRAE Standard 62, Addenda N.

### HOT WATER COILS

Hot water coil casing shall be constructed with minimum 20 gage galvanized steel with flanged discharge for attachment to downstream ductwork. Coils shall be factory installed on the terminal unit. Fins shall be rippled and corrugated heavy gage aluminum, mechanically bonded to tubes. Tubes shall be copper with minimum wall thickness of 0.016" and with male solder header connections. Coils shall be leak tested to 400 psi. Number of coil rows and circuits shall be selected to provide performance as required by the plans. Coil performance data shall be based on tests run in accordance with AHRI Standard 410.

**SUGGESTED SPECIFICATION & CONFIGURATION (CONTINUED)**
**1. SERIES: (XXX)**

QFC - Fan Powered Terminal Unit

**2. SENSOR TYPE: (X)**

 1 - Linear Averaging  
 3 - K4 LineaCross (Four Quadrant, Standard)

**3. LINER TYPE: (X)**

0 - 1/2" Liner	6 - 1/2" Foil Encapsulated
1 - 1" Liner	9 - 1" Foil Encapsulated
F - 1/2" Cellular	H - 1" Cellular

**4. UNIT CASING CONTROLS: (XX)**

 0L - Left-hand Side, 22 Gage  
 1L - Left-hand Side, 20 Gage  
 0R - Right-hand Side, 22 Gage  
 1R - Right-hand Side, 20 Gage

**5. UNIT SIZE: (X)**

 2 - Available Inlet Size: 6"  
 3 - Available Inlet Sizes: 6", 8"  
 4 - Available Inlet Sizes: 8", 10", 12"  
 5 - Available Inlet Sizes: 10", 12"  
 6 - Available Inlet Sizes: 12", 14"  
 7 - Available Inlet Sizes: 16"

**6. INLET CODE: (XX)**

 06 - 6"  
 08 - 8"  
 10 - 10"  
 12 - 12"  
 14 - 14"  
 16 - 16"

**7. MOTOR VOLTAGE: (X)**

 1 - 120V, 1-Phase \*  
 2 - 208/240V, 1-Phase  
 3 - 277V, 1-Phase  
 4 - ECM Motor, 120V, 1-Phase \*\*  
 5 - ECM Motor, 208/240V, 1-Phase \*\*  
 6 - ECM Motor, 277V, 1-Phase \*\*

**8. CONTROL TYPE: (XXXX)**

 (2XXX) - Analog  
 (7XXX) - Digital, BACnet Compatible  
 (6XXX) - Digital, Standalone  
 (XXXX) - Digital Mounted, Provided by Others  
 (1XXX) - Pneumatic

**9. UNIT ACCESSORIES: (X) (X) (X) (X) (X) (X)**

 0 - None  
 A - Motor Toggle Disconnect ^  
 E - Dust-tight Control Enclosure  
 F - Fan Motor Fuse  
 N - Induction Inlet Attenuator with Filter  
 R - Induction Inlet Filter  
 S - Hanger Brackets  
 T - Induction Inlet Attenuator

**10. WATER HEAT:**
**(ROWS/CONNECTION HAND) (XXX)**

 000 - N/A / None  
 W11 - 1 Row/Right/No Access  
 W12 - 2 Row/Right/No Access  
 W21 - 1 Row/Left/No Access  
 W22 - 2 Row/Left/No Access  
 W31 - 1 Row/Right/Access  
 W32 - 2 Row/Right/Access  
 W41 - 1 Row/Left/Access  
 W42 - 2 Row/Left/Access

**11. ELECTRIC HEAT: (XX)**

 00 - None  
 E1 - 120v/1-Phase  
 E2 - 208v/1-Phase  
 E3 - 240v/1-Phase  
 E4 - 277v/1-Phase  
 E6 - 208v/3-Phase/3-Wire  
 E9 - 480v/3-Phase/4-Wire

**LINEAHEAT: (XX)**

 L1 - 120v/1-Phase  
 L2 - 208v/1-Phase  
 L3 - 240v/1-Phase  
 L4 - 277v/1-Phase  
 L6 - 208v/3-Ph/3-Wire  
 L9 - 480v/3-Ph/4-Wire

**12. ELECTRIC HEAT STEPS: (X)**

 0 - None  
 1 - 1-Stage  
 2 - 2-Stage  
 3 - 3-Stage

**13. HEAT COIL ACCESSORIES: (X) (X) (X) (X) (X)**

 0 - None  
 C - Fuse Block  
 E - Chicago Code Construction  
 F - Manual Reset Cutout  
 G - Dust-tight Construction  
 H - Staged Solid State Relays  
 K - Door-interlocking Fused Disconnect  
 L - Door-interlocking Non-fused Disconnect  
 P - Water Coil Vent & Drain

\* QFC unit Size 7 not available with 120V.

\*\* Manual or remote adjustable speed controller for ECM motor option is required.

^ Motor Toggle Disconnect not available with electric heat.

**SAMPLE CONFIGURATION: QFC - 3 - 5 - 1L - 4 - 08 - 3 - 6207 - 0 - 0 - 0 - 0 - W21**