



**KSB, KSL - VERTICAL DOWNSIZED BLOWER COIL**  
 COIL CONNECTION LOCATION - 1 & 2 ROW HOT WATER COIL IN DISCHARGE SECTION

**SUBMITTAL SHEET**

**FIG. 3**  
**1-2 ROW HOT WATER**  
**MOUNTED IN DISCHARGE SECTION**

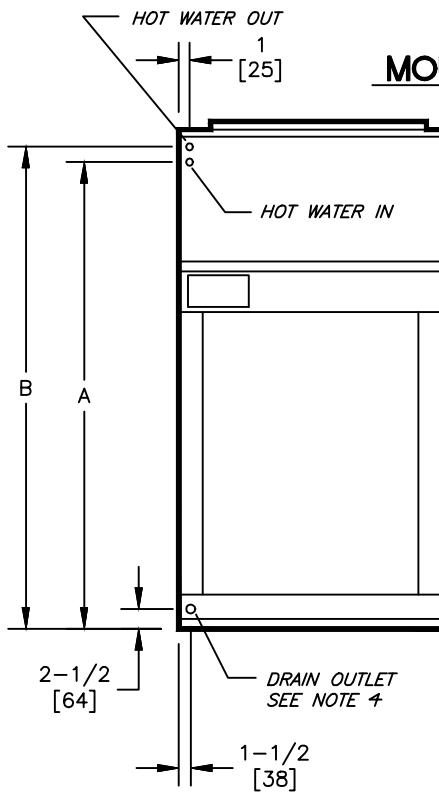

**LEFT HAND UNIT**

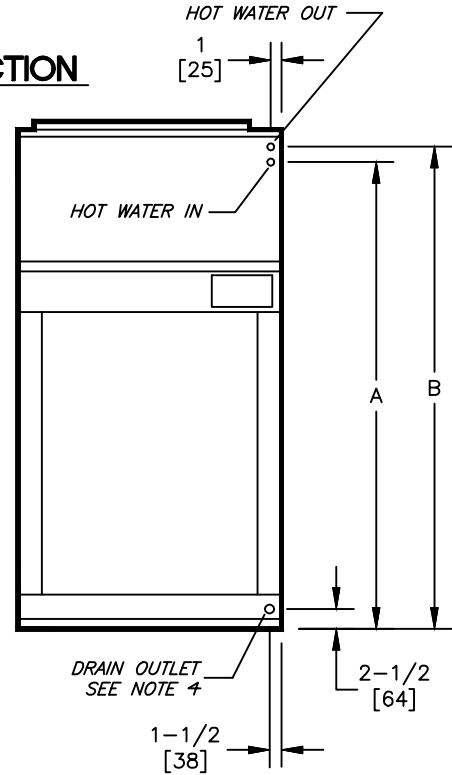

**RIGHT HAND UNIT**

SIZE	1 ROW HOT WATER COIL			2 ROW HOT WATER COIL		
	COIL CONNECTION	A	B	COIL CONNECTION	A	B
08	5/8 [16]	53-3/4 [1378]	55-1/4 [1416]	5/8 [16]	53-3/4 [1378]	55-5/8 [1403]
12						
16		63-3/4 [1632]	65-1/4 [1626]		63-3/4 [1632]	65-5/8 [1664]
20						
25		73-3/4 [1632]	75-1/4 [1880]	7/8 [23]	73-3/4 [1632]	75-5/8 [1918]
30						

**NOTES:**

- ALL DIMENSIONS ARE INCHES [MM]
- ALL DIMENSIONS ARE  $\pm 1/2"$  [13]
- METRIC VALUES ARE SOFT CONVERSION
- STANDARD GALVANIZED DRAIN PAN HAS 1-18" ODM COPPER CONNECTION; OPTIONAL STEEL DRAIN PAN HAS 1" GALVANIZED SCH. 40 THREADED STEEL CONNECTION
- DISCHARGE SECTION IS REQUIRED FOR HEATING COIL ON 4 PIPE UNITS WITH 6 ROW COOLING AND ALL UNITS WITH STANDARD STEAM HEATING
- HEATING ONLY UNITS MAY NOT INCLUDE A DRAIN PAN; SEE ACTUAL ORDER DOCUMENTS
- HEATING COILS IN DISCHARGE SECTION HAVE CONNECTIONS ON SAME SIDE AS COOLING COIL CONNECTIONS
- DIMENSIONS ARE BASED ON UNIT CABINET ONLY, AND DO NOT INCLUDES FILTER RACK OR BASE RAIL

Revision Date: 12/14

Form: BCS20-SWC04

Replaces: NEW