


JOB NAME ENGINEER	
CONTRACTOR	
TAG	

SUBMITTAL SHEET

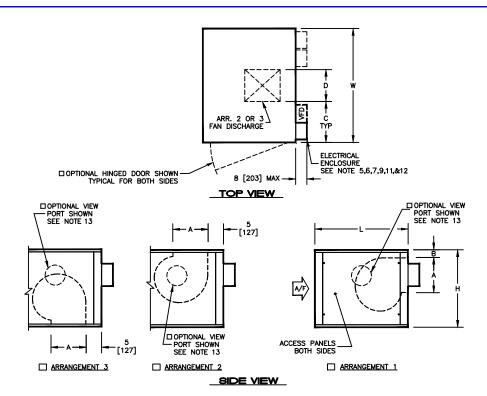

SIZE	Н	w	L A		В	С	D	ACCESS PANEL H X W	WEIGHT (SEE NOTES)	
				Α					SINGLE WALL	DOUBLE WALL
									LBS (kg)	LBS (kg)
02	22	30	32	10-1/2	2-3/8	11-7/16	7-1/8	20 X 26	110	140
	[559]	[762]	[813]	[267]	[603]	[291]	[181]	[508 X 660]	[50]	[64]
03	22	36	32	10-1/2	2-3/8	13-3/4	8-1/2	20 X 26	125	155
	[559]	[914]	[813]	[267]	[603]	[349]	[216]	[508 X 660]	[57]	[70]
04	22	44	32	11-5/8	2-3/8	17-1/16	9-7/8	20 X 26	140	170
	[559]	[1118]	[813]	[295]	[603]	[433]	[251]	[508 X 660]	[64]	[77]
06	30	44	36	13-3/4	3	15-3/4	12-1/2	28 X 30	185	230
	[762]	[1118]	[914]	[349]	[76]	[400]	[318]	[711 X 762]	[84]	[104]
08	34	48	36	13-3/4	3	16-1/16	15-7/8	32 X 30	215	270
	[864]	[1219]	[914]	[349]	[76]	[408]	[403]	[813 X 762]	[98]	[123]
10	34	58	36	16-1/8	3-3/8	21-9/16	14-7/8	32 X 30	255	310
	[864]	[1473]	[914]	[410]	[86]	[548]	[378]	[813 X 762]	[116]	[141]
12	44	66	40	19-1/8	8	24-3/16	17-5/8	42 X 34	310	390
	[1118]	[1676]	[1016]	[486]	[203]	[614]	[448]	[1067 X 864]	[141]	[177]
14	44	70	40	19-1/8	8	23-15/16	22-1/8	42 X 34	325	405
	[1118]	[1778]	[1016]	[486]	[203]	[608]	[562]	[1067 X 864]	[148]	[184]
17	44	82	40	19-1/8	8	29-15/16	22-1/8	42 X 34	370	470
	[1118]	[2083]	[1016]	[486]	[203]	[760]	[562]	[1067 X 864]	[168]	214]

NOTES:

- ALL DIMENSIONS ARE INCHES [MM]
- ALL DIMENSIONS ARE ±1/8" [3]
- METRIC VALUES ARE SOFT CONVERSION 3.
- ALL DRAWINGS SUBJECT TO CHANGE WITHOUT PRIOR NOTICE 4.
- MOTOR/DRIVE LOCATION SPECIFIED LEFT OR RIGHT WITH AIR TO BACK 5.
- STANDARD CONTROL ENCLOSURE LOCATION MATCHES MOTOR/DRIVE POSITION. 6.
- RIGHT HAND UNIT SHOWN
- WEIGHT DOES NOT INCLUDE MOTOR WEIGHT; SEE AHMS05-WC04 FOR COIL & AHMS04-FN04 FOR MOTOR WEIGHTS 8.
- CONTROL ENCLOSURE WILL BE MOUNTED ON SUPPLY FAN MODULE 9.
- 10. ALTERNATE CONTROL ENCLOSURE AND VFD LOCATIONS ARE SUBJECTED TO COMPLIANCE WITH NEC 2002 ARTICLE 110.26 AND ARE LIMITED; CONTACT FACTORY FOR AVAILABLE ALTERNATE LOCATION Y BY APPLICATION
- OPTIONAL VFD WILL BE LOCATED ON THE SAME SIDE OF THE UNIT AS CONTROL ENCLOSURE 11.
- VFD SHALL BE MOUNTED ADJACENT TO OR AS CLOSE TO CONTROL ENCLOSURE AS POSSIBLE, DEPENDING UPON UNIT SIZE
- A) OPTIONAL VIEWPORT IS ONLY AVAILABLE WITH DOUBLE WALL OPTION 13.
- B) OPTIONAL VIEWPORT IS 8" DIAMETER, DOUBLE PANE, CLEAR POLYCARBONATE, UV RESISTANT, WITH BOTH INTERIOR AND EXTERIOR GASKETING 14. OPTIONAL HINGED DOOR IS REMOVABLE, BUT MUST BE OPENED 90 DEGREES FOR REMOVAL

AHMS04-FN01 NEW Revision Date: 11/14 Form: Replaces: