
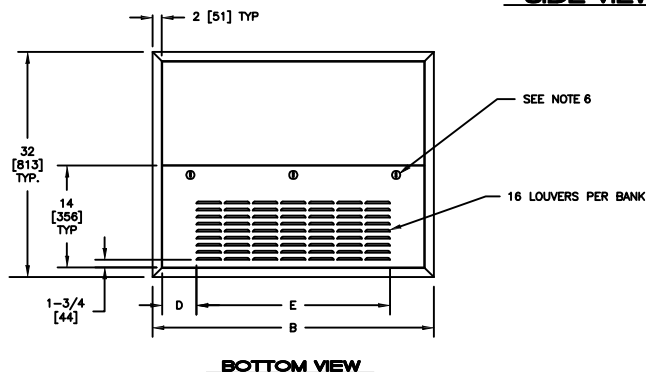
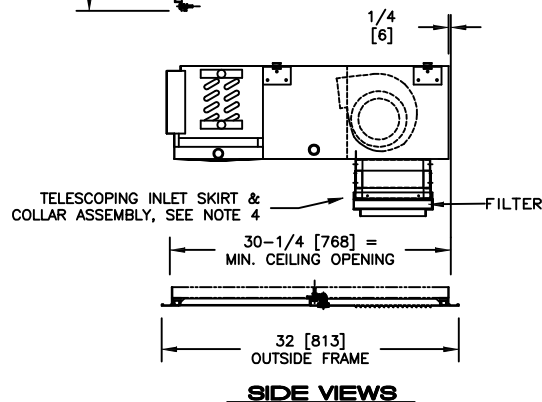
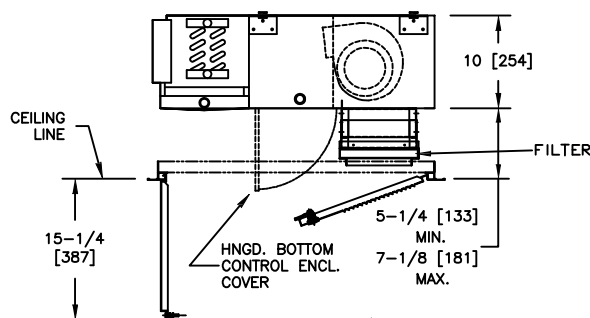
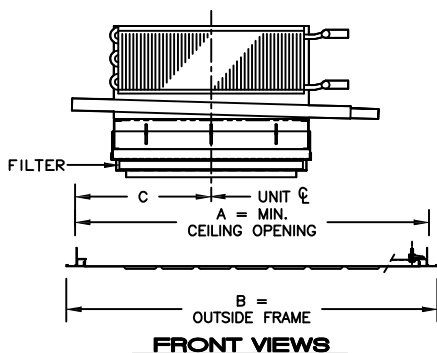


KHFE, KHFH, KHFP- HORIZONTAL FAN COIL FAN COIL UNIT OPTIONAL TELESCOPING BOTTOM PANEL ASSEMBLY

JOB NAME _____
 ENGINEER _____
 CONTRACTOR _____
 TAG _____

SUBMITTAL SHEET

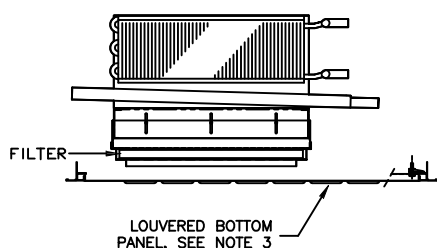

SIZE	STANDARD PANEL				
	A	B	C	D	E
20	38-1/8 [968]	40 [1016]	14-1/2 [368]	4-1/4 [108]	27-1/2 [699]
25	44-1/8 [1121]	46 [1168]	17-1/2 [445]	3-1/4 [83]	35-1/2 [902]
30	48-1/8 [1222]	50 [1270]	19-1/2 [495]	3-1/4 [83]	39-1/2 [1003]
40	58-1/8 [1476]	60 [1524]	24-1/2 [622]	4-1/4 [108]	47-1/2 [1207]
50	68-1/8 [1730]	70 [1778]	29-1/2 [749]	3-1/4 [83]	59-1/2 [1511]
60	78-1/8 [1984]	80 [2032]	34-1/2 [876]	4-1/4 [108]	67-1/2 [1715]

NOTES:

- ALL DIMENSIONS ARE INCHES [MILLIMETERS]. ALL DIMENSIONS +/- 1/4" [6MM]. METRIC VALUES ARE SOFT CONVERSION
- LEFT HAND UNIT SHOWN, RIGHT HAND UNIT OPPOSITE
- PORTIONS OF THE INLET LOUVER NOT DIRECTLY BELOW UNIT INLET MAY REQUIRE COVERING IN THE FIELD ON APPLICATIONS WHERE INFILTRATION OF CEILING PLENUM AIR INTO SPACE IS UNDESIRABLE
- TELESCOPING SKIRT & COLLAR ASSEMBLY MUST BE FIELD ADJUSTED TO PROPERLY FIT BETWEEN FILTER FRAME & LOUVERED INLET PANEL ASSEMBLY
- 1/4 TURN LATCH, (2) QTY FOR STANDARD SIZES, (3) QTY FOR SIZES 40-60

Revision Date:

04/15

Form:

FCS01-KHF03

Replaces:

NEW