


JOB NAME ENGINEER		-
CONTRACTOR		-
TAG		_
	SUBMITTAL SHEET	

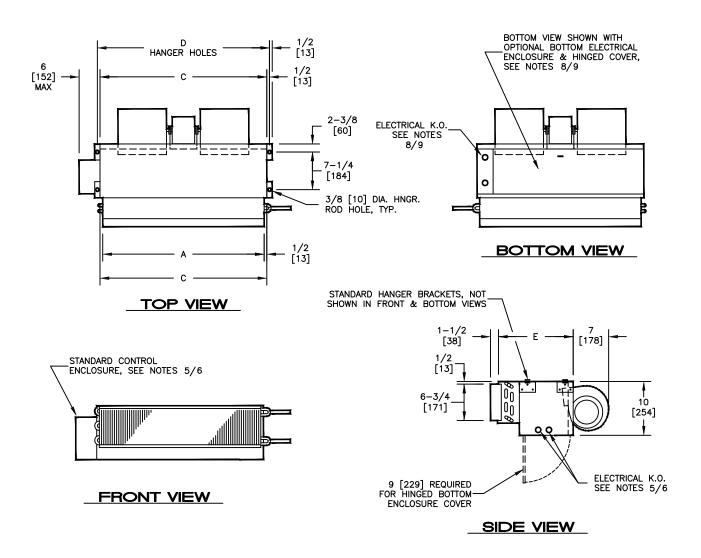

SIZE	Α	С	D	Е
20	20	21	22	19-1/2
	[508]	[533]	[559]	[495]
25	26	27	28	19-1/2
	[660]	[686]	[711]	[495]
30	30	31	32	19-1/2
	[762]	[787]	[813]	[495]
40	40	41	42	19-1/2
	[1016]	[1041]	[1067]	[495]
50	50	51	52	19-1/2
	[1270]	[1295]	[1321]	[495]
60	60	61	62	19-1/2
	[1524]	[1549]	[1575]	[495]

## NOTES:

- ALL DIMENSIONS ARE INCHES [MM] 1.
- ALL DIMENSIONS ARE ±1/4" [6]
- METRIC VALUES ARE SOFT CONVERSION
- LEFT HAND UNIT SHOWN, RIGHT HAND UNIT OPPOSITE
- STANDARD CONTROL ENCLOSURE IS MOUNTED ON UNIT SIDE OPPOSITE COOLING COIL INSTRUCTIONS UNIT CASING INCLUDES (2) KNOCKOUTS ON EACH SIDE.
- 6.
- PROVIDE SUFFICIENT CLEARANCE TO ACCESS ELECTRICAL CONTROLS AND COMPLY WITH APPLICABLE CODES AND ORDINANCES
- OPTIONAL BOTTOM CONTROL ENCLOSURE WITH HINGED COVER REPLACES STANDARD SIDE MOUNTED ENCLOSURE
- INCLUDES (2) ADDITIONAL KNOCKOUTS ON BOTTOM OF UNIT, ON LEFT SIDE
- SEE COIL CONNECTION DRAWINGS FOR COIL CONNECTION SIZES AND LOCATIONS

Revision Date: 04/15 FCS01-KHFH03 NEW Form: Replaces: