


KHGE - HORIZONTAL HIGH CAPACITY FAN COIL

MODEL "KHGE" FAN COIL UNIT EXTERNAL SPACE REQUIREMENTS

 JOB NAME _____
 ENGINEER _____
 CONTRACTOR _____
 TAG _____

SUBMITTAL SHEET

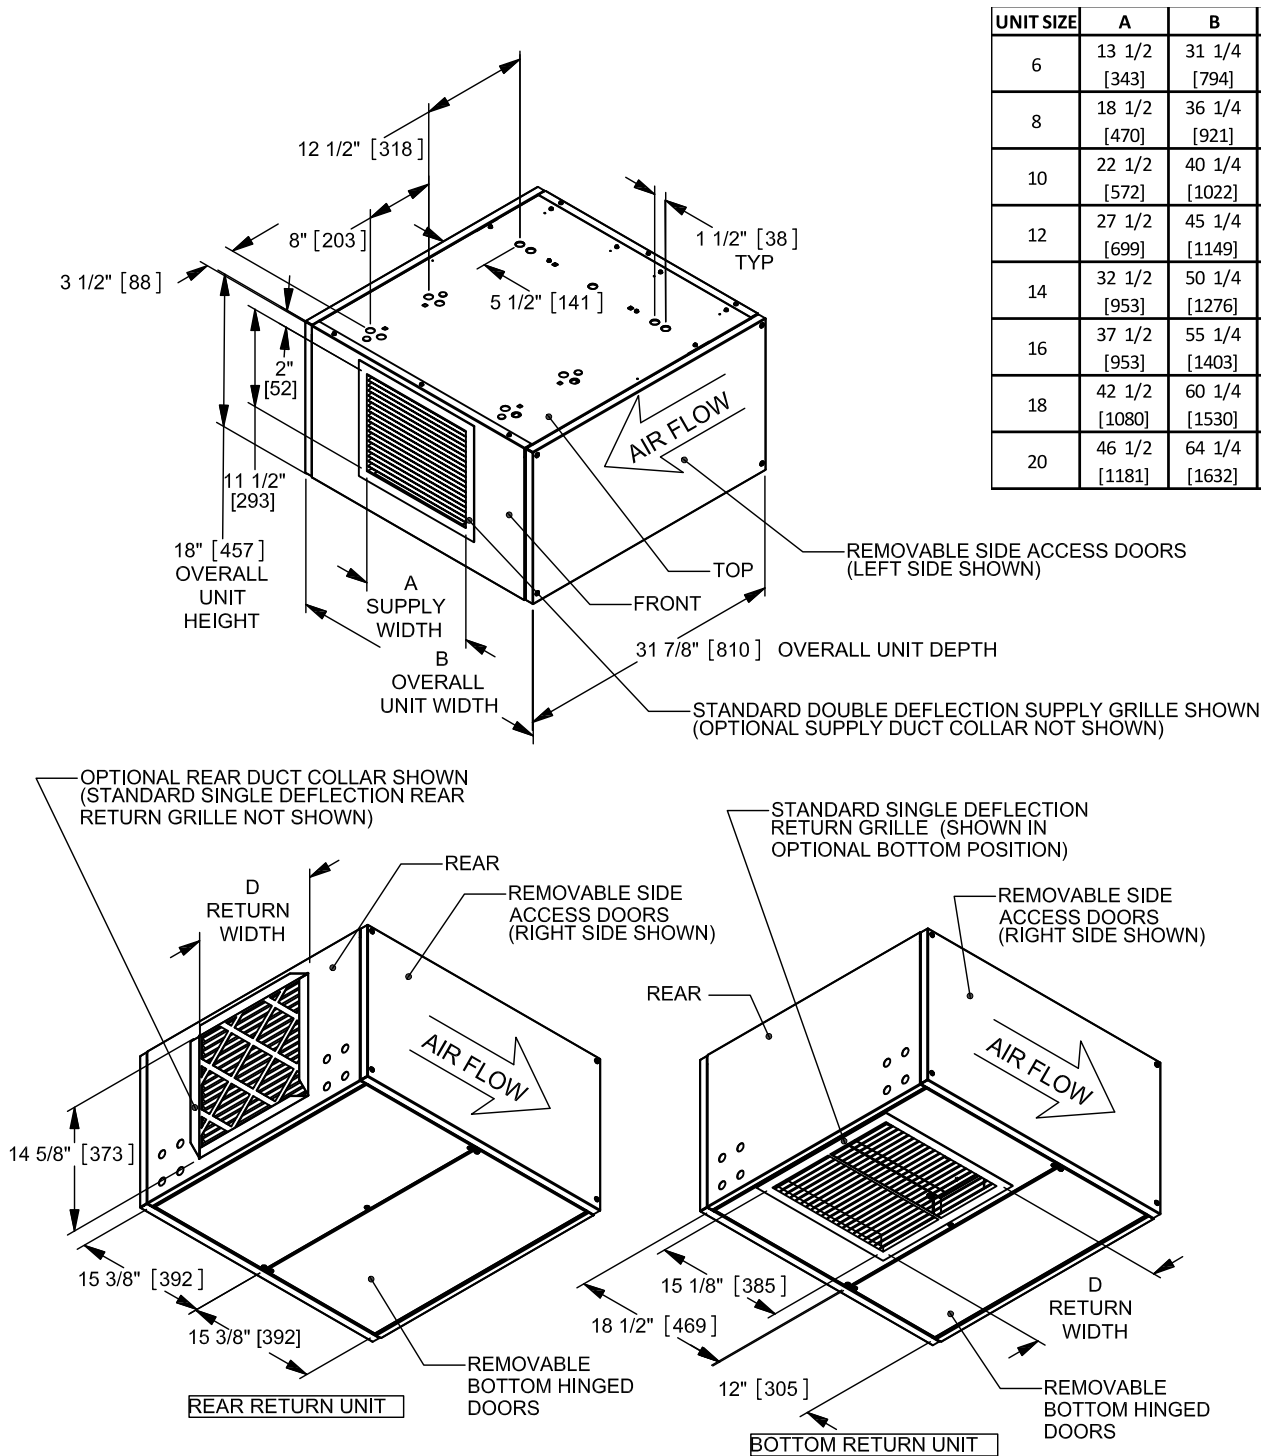

UNIT SIZE	A	B	C	D
6	13 1/2 [343]	31 1/4 [794]	20 [508]	15 1/2 [394]
8	18 1/2 [470]	36 1/4 [921]	25 [635]	19 1/2 [495]
10	22 1/2 [572]	40 1/4 [1022]	29 [737]	24 1/2 [622]
12	27 1/2 [699]	45 1/4 [1149]	34 [864]	31 1/2 [800]
14	32 1/2 [953]	50 1/4 [1276]	39 [991]	35 1/2 [902]
16	37 1/2 [953]	55 1/4 [1403]	44 [1118]	39 1/2 [1003]
18	42 1/2 [1080]	60 1/4 [1530]	49 [1245]	44 1/2 [1130]
20	46 1/2 [1181]	64 1/4 [1632]	53 [1346]	49 1/2 [1257]

- NOTES:**
- ALL DIMENSIONS ARE IN INCHES [MM] AND ARE ±1/8"
 - SEE KHG SUBMITTAL FOR ADDITIONAL KHG SERIES PRODUCT DIMENSIONS
 - INTERNAL HINGED ELECTRICAL ENCLOSURE NOT SHOWN
 - OPTIONAL 1" OR 2" PLEATED FILTERS AVAILABLE (SHOWN)
 - STANDARD 1" THROWAWAY FILTER NOT SHOWN
 - 1-1/4" DUCT COLLAR STANDARD ON ALL DUCTED UNITS
 - IT IS RECOMMENDED TO PROVIDE 3' ACCESS ON PIPE CONNECTION SIDE
 - SIZE DETERMINED BY SELECTED COMPONENTS
 - PROVIDE ACCESS CLEARANCE FOR ELECTRICAL ENCLOSURE PER LOCAL AND NATIONAL ELECTRICAL CODE REQUIREMENTS

INTERNAL CONTROL ENCLOSURE SIZES (SEE NOTE #2)	
10 X 16 X 6	[250 X 406 X 152]
10 X 20 X 6	[250 X 500 X 152]

Revision Date:

04/15

Form:

FCS02-KHGE01

Replaces:

NEW