


KHGH - HORIZONTAL HIGH CAPACITY FAN COIL

MODEL "KHGH" FAN COIL UNIT EXTERNAL SPACE REQUIREMENTS

JOB NAME _____
 ENGINEER _____
 CONTRACTOR _____
 TAG _____

SUBMITTAL SHEET 2 OF 2

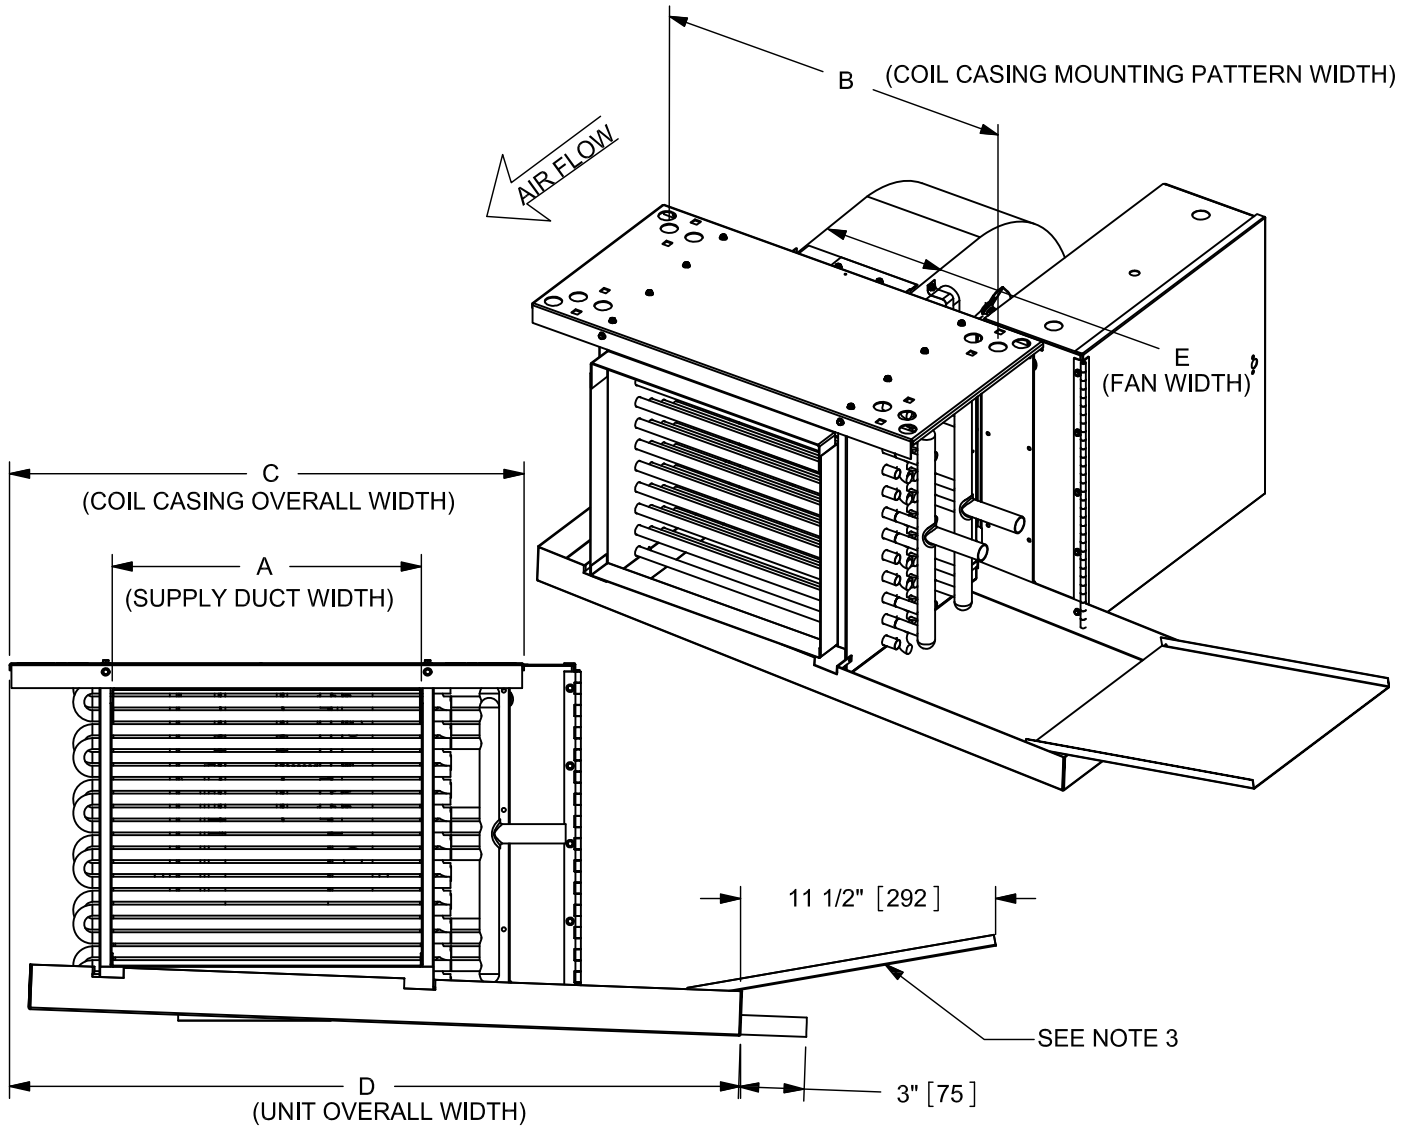

UNIT SIZE	FAN QTY	A	B	C	D	E
6	1	14 [356]	20 [508]	23 1/8 [587]	34 [864]	6 7/8 [175]
8		19 [483]	25 [635]	28 1/8 [714]	39 [991]	8 1/4 [210]
10		23 [584]	29 [737]	32 1/8 [816]	43 [1092]	8 1/4 [210]
12	2	28 [711]	34 [864]	37 1/8 [943]	48 [1219]	6 7/8 [175]
14		33 [838]	39 [991]	42 1/8 [1070]	53 [1346]	8 1/4 [210]
16		38 [965]	44 [1118]	47 1/8 [1197]	58 [1473]	8 1/4 [210]
18		43 [1092]	49 [1245]	52 1/8 [1324]	63 [1600]	8 1/4 [210]
20		47 [1194]	53 [1346]	56 1/8 [1426]	67 [1702]	8 1/4 [210]

NOTES:

- ALL DIMENSIONS ARE IN INCHES [MM] AND ARE $\pm 1/8"$
- DRAIN PAN IS FIELD REVERSIBLE 180° AND EXTERNALLY INSULATED
- OPTIONAL AUXILIARY DRIP PAN AVAILABLE FOR PIPING PACKAGE CONDENSATE
- COIL HAND IS FIELD REVERSIBLE (LEFT HAND UNIT SHOWN)

Revision Date: 04/15

Form: FCS02-KHGH01

Replaces: NEW