


KHGP - HORIZONTAL HIGH CAPACITY FAN COIL

MODEL "KHGP" FAN COIL UNIT EXTERNAL SPACE REQUIREMENTS

 JOB NAME _____
 ENGINEER _____
 CONTRACTOR _____
 TAG _____

SUBMITTAL SHEET 1 OF 2

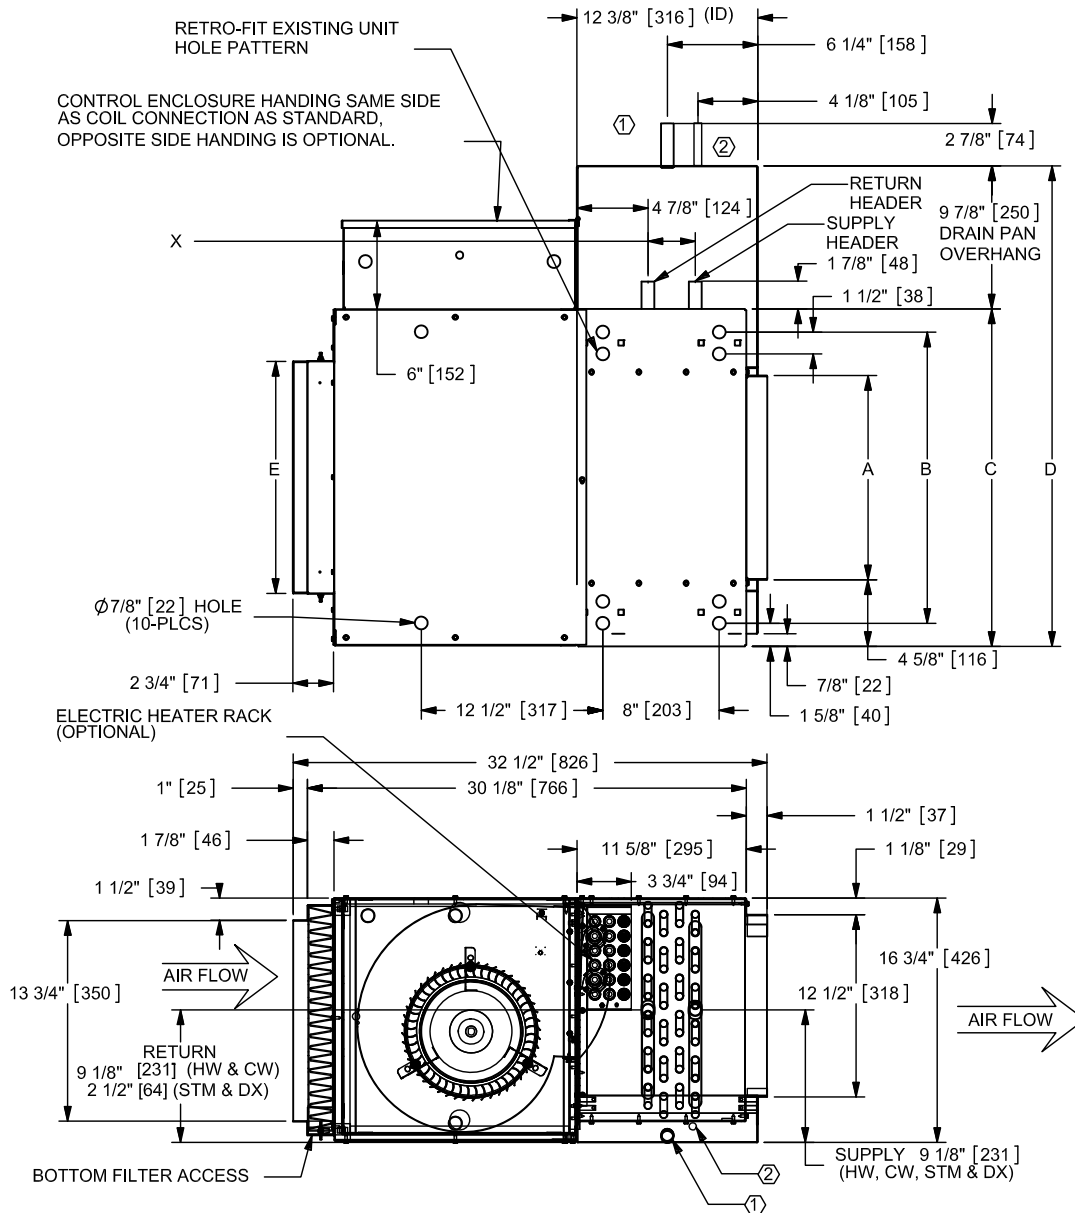

CONTROL ENCLOSER SIZES (SEE NOTE #6)

10 X 16 X 6 [250 X 406 X 152]
16 X 16 X 6 [406 X 406 X 152]

COIL ROWS	COIL CIRC.	"X" DIM.
1*	1	0.00 [0]
1	2	1.08 [55]
2	ANY	1.08 [55]
3	ANY	2.17 [82]
4	ANY	3.25 [110]
6	ANY	5.42 [165]

DRAIN PAN MATERIAL	SINGLE CONNECTION (STD) ^①	SECONDARY CONNECTION (OPT) ^②
GALVANIZED (STD)	7/8" OD COPPER	5/8" OD COPPER
STAINLESS (OPT)	3/4" MPT GALV.	1/2" MPT GALV.

NOTES:

- ALL DIMENSIONS ARE IN INCHES [MM] AND ARE $\pm 1/8"$
- SEE SHEET 2 FOR SPECIFIC UNIT DIMENSION, OPTIONS & SPECIFICATIONS
- *1 ROW SINGLE CIRCUIT COILS ARE ON THE SAME AXIS, BUT ARE 13 3/4" APART IN HEIGHT
- IT IS RECOMMENDED TO PROVIDE 3' ACCESS ON PIPE CONNECTION SIDE
- PROVIDE ACCESS CLEARANCE FOR ELECTRICAL ENCLOSURE PER LOCAL AND NATIONAL ELECTRICAL CODE REQUIREMENTS
- SIZE DETERMINED BY SELECTED COMPONENTS

Revision Date:

04/15

Form:

FCS02-KHGP01

Replaces:

NEW